


OKW-231

Service to Machine Shop Jan. 16, 1920
 Fire Dept. - #1558 Purchase etc.
 Service 2-3" Fibre ducts = 38.1'


FF'

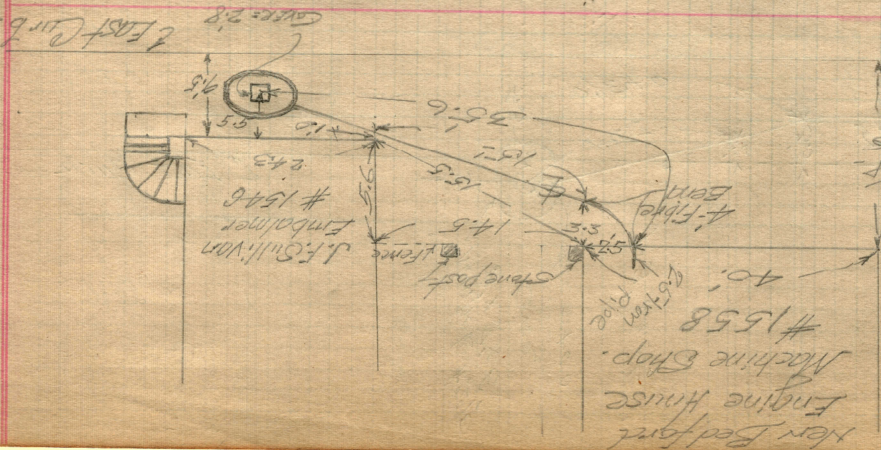

2-3" Fibre = 35.6
 Iron pipe 2.5
 Total = 38.1

OKW 197

Jan 23, 1920
 Box Yard Service
 House #36 North St.
 3" Fibre Duct = 103 feet
 F-1'

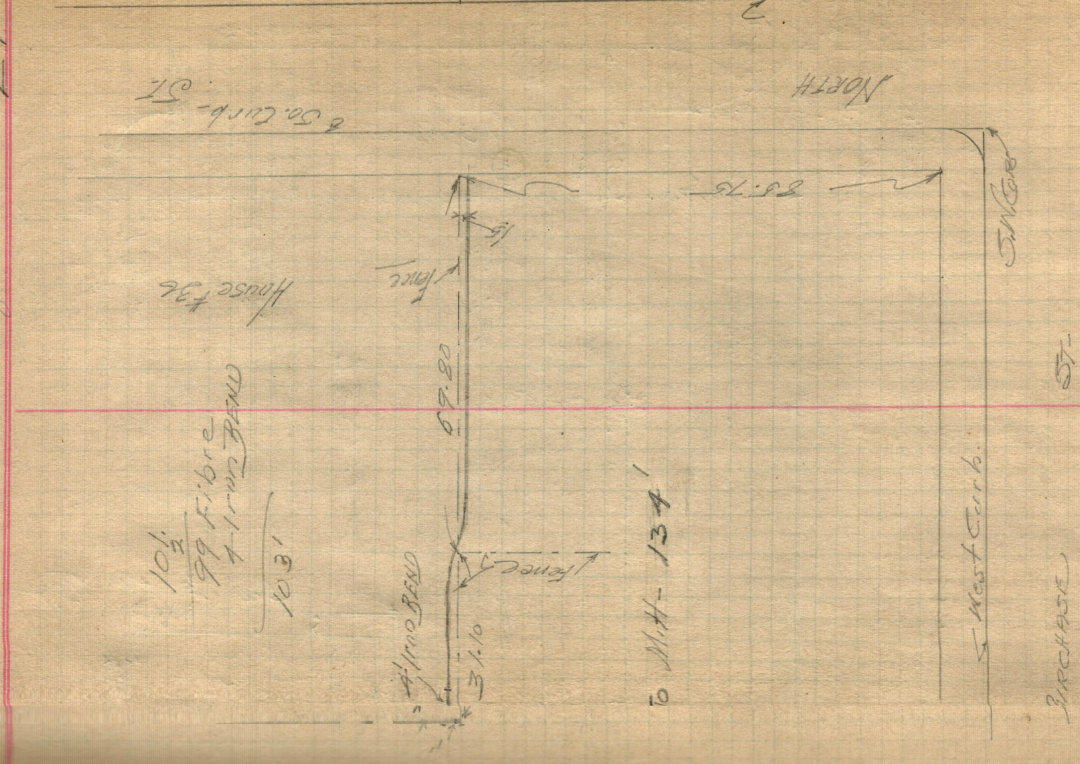

ST-