


Plotted J.W. 12.3.32.

X

11-9-32

2-3" Fibre
relocated
w/c installation
of oil tank
just w. of service.

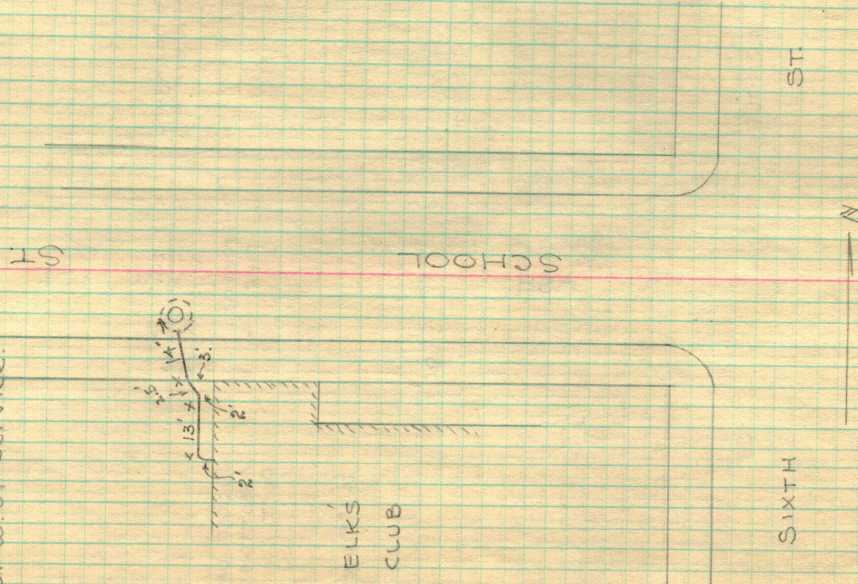

Installed 4-20-33

1-3" Fibre Pipe
laid in concrete trough
at foot of R.R. embankment
wall.
3 #26 lead 2200' cables

