


Middle St. Serv. to City Serv. Taxi

Installed 11-12-1943

Inst. 1-3/4" Fibre Pipe

11 2W. Service to Stand Pipe

For City Serv. Taxi

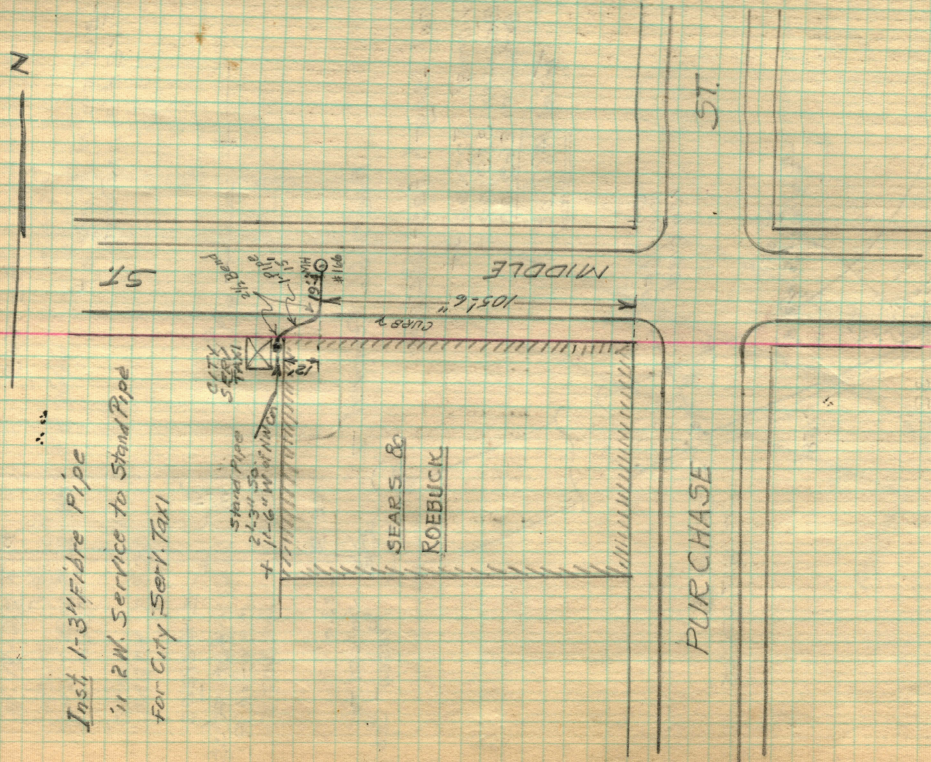


Electrolysis Cable & New Bend Conduit

Mar. 16-1945

stalled 1-3" U-Bend & Connected to Pres. LRG Duct & Pres. U.S. Ry Co. Duct.

11 2-500 MCM Cable

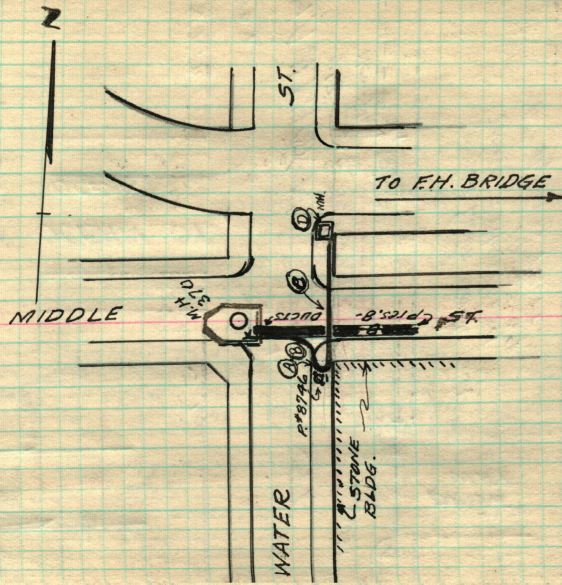

NOTES Electrolysis cable 2-500 MCM -

- 1) New 3" R Pipe U-Bend located in Sidewalk 27' N of P. # 8746 + 1' W. Stone Bldg.
- 2) Present 3/4" R Pipe inside bend connected to new 3" U-Bend West side of side walk about 16' to 8' of Duct from P. # 8746
- 3) New U-bend connected to old 3/4" U.S. Ry. Duct across Middle St. 1' from Stone Bldg.
- 4) U.S. Ry. Co. M.H. near entrance to Bridge in So. side walk to U.S. Ry. M.H.