


NO. END LAUNDRY 4-11-47


Installed 1-4" Fibre Pipe
From Riser Pole #4164 on County St. to a point
located 102'-4" from W.L. of Bldg. and Easterly
102'-4" 24" out from No. line of
Bldg. or Total distance from
P. 4164 of 144'-8"
Aver. cover = 22 inches.

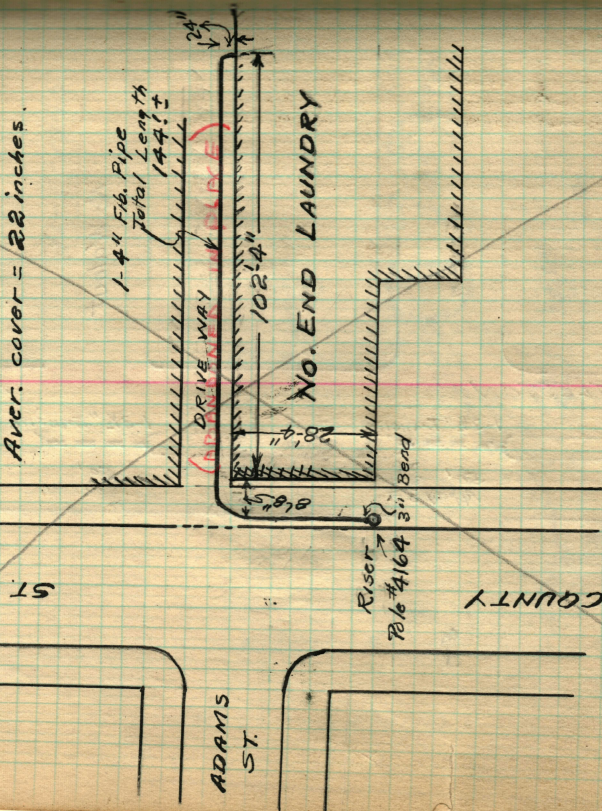

Installed 3" 4/0 lead pri. cables 5-13-47
REMOVED 3" 4/0 LEAD PRI. C.A. (J.A. 5-13-47)

STON W.B.S.M. - FAIRHAVEN BRIDGE - 12-20-48

Installed 3 1/2" Iron L-nipple - 10' Duct & Junc. Box
3" 6 Lead Cable - 2-4" FIBRE PIPE

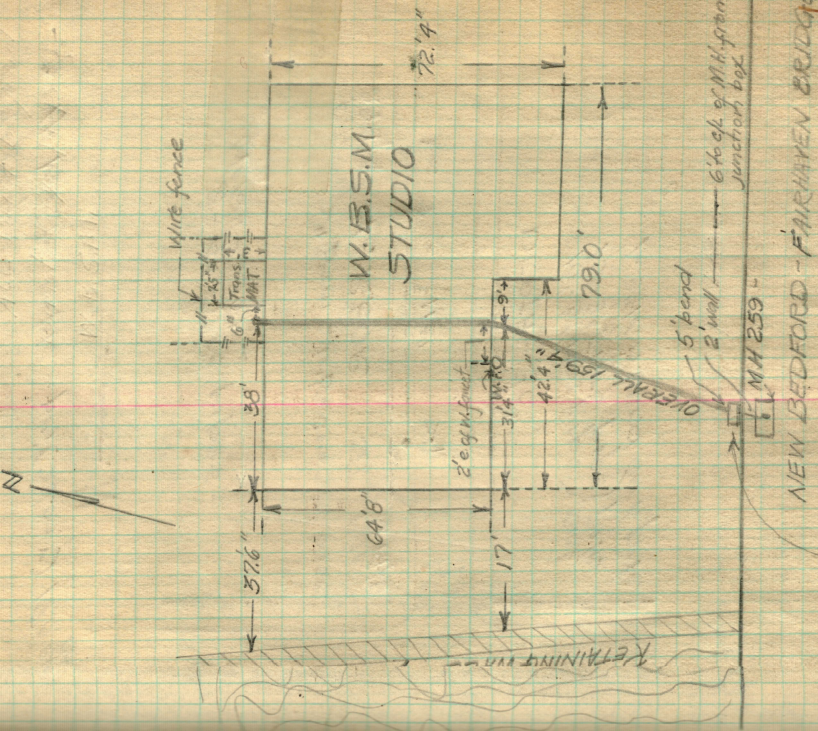

JUNCTION BOX - PROPERTY OF COMPANY.
ALL DUCT BEYOND INSTALLED BY W.B.S.M.