



1-3" FIRE DUCT
SERVICE TO
110 SCHOOL ON
HATHAWAY ST.
MONDAY MARCH 18th 1900
6:00 AM
MANHOLE COVER
50.00

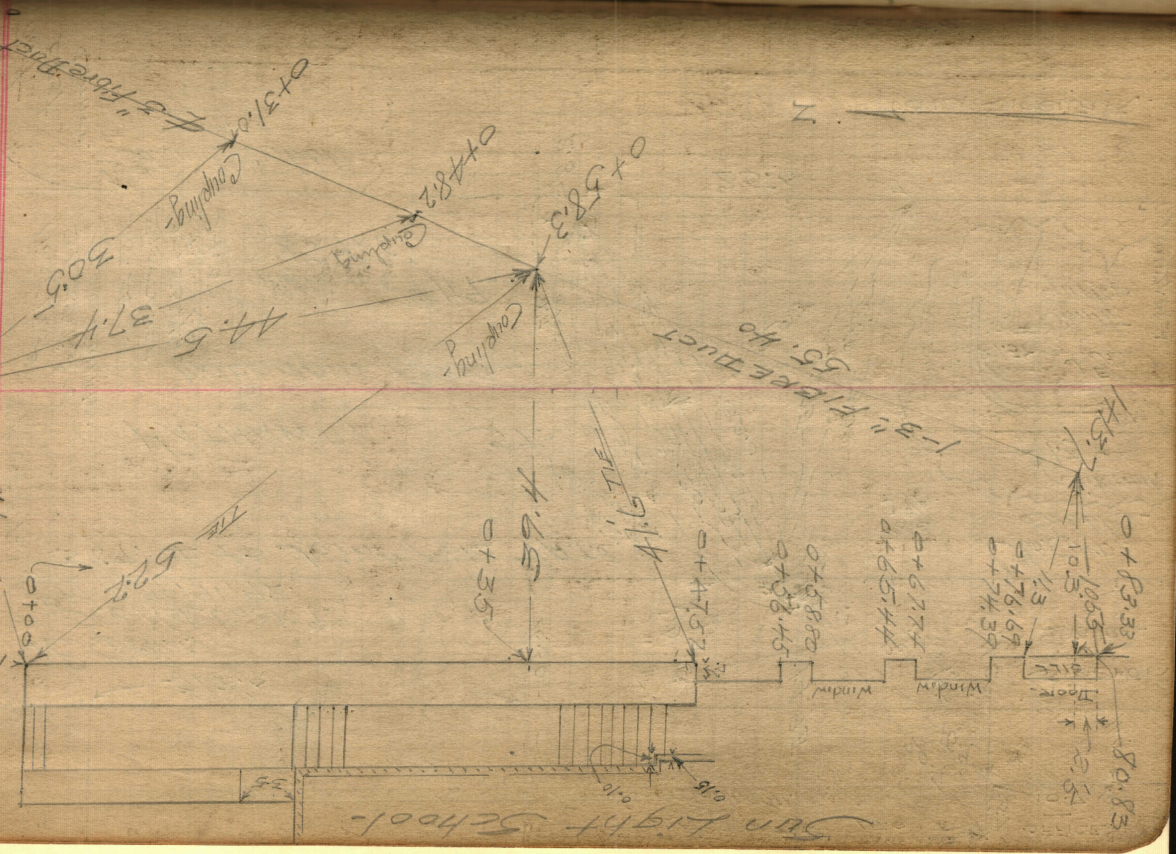

11111
55.40
1-3" FIRE DUCT

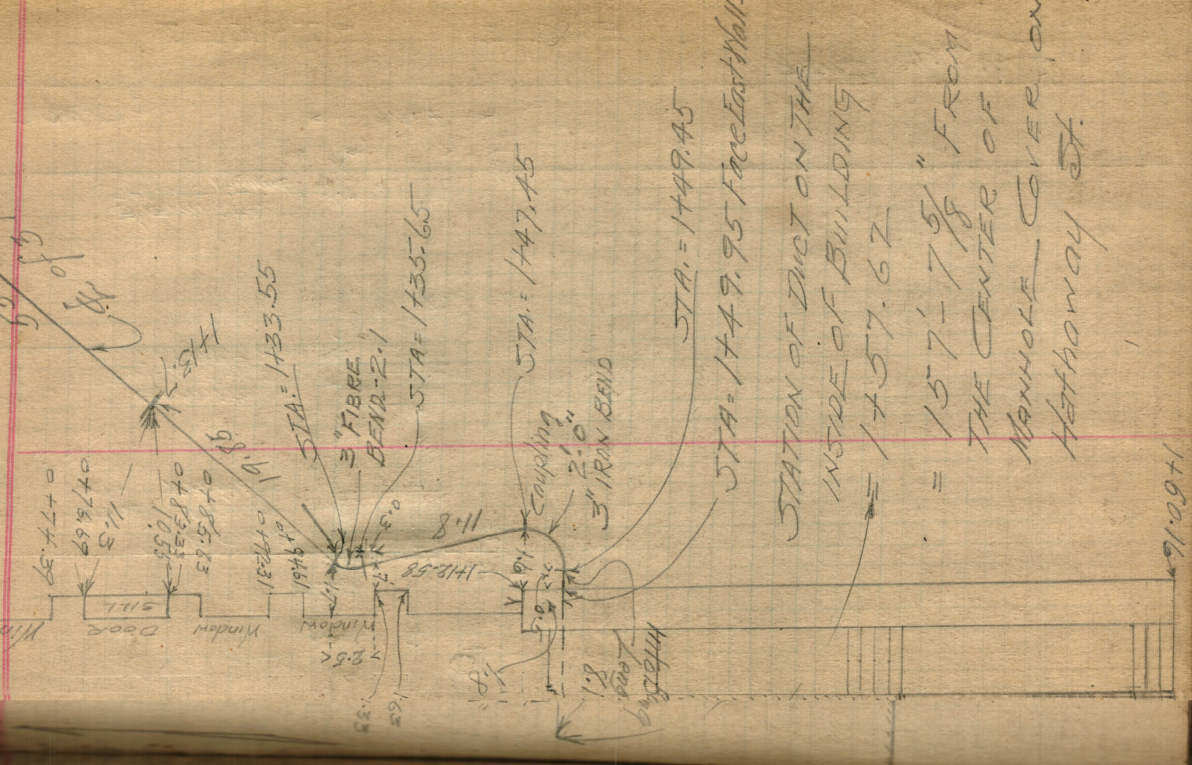

STATION OF DUCT ON THE
INSIDE OF BUILDING
= 157'-7 5/8" FROM
THE CENTER OF
MANHOLE COVER ON
HATHAWAY ST.