


NOTE
APNEA MONITOR
35 RODNEY FR. BLVD. 2-S
"VIEIRA" 994-8508
"MH 653"

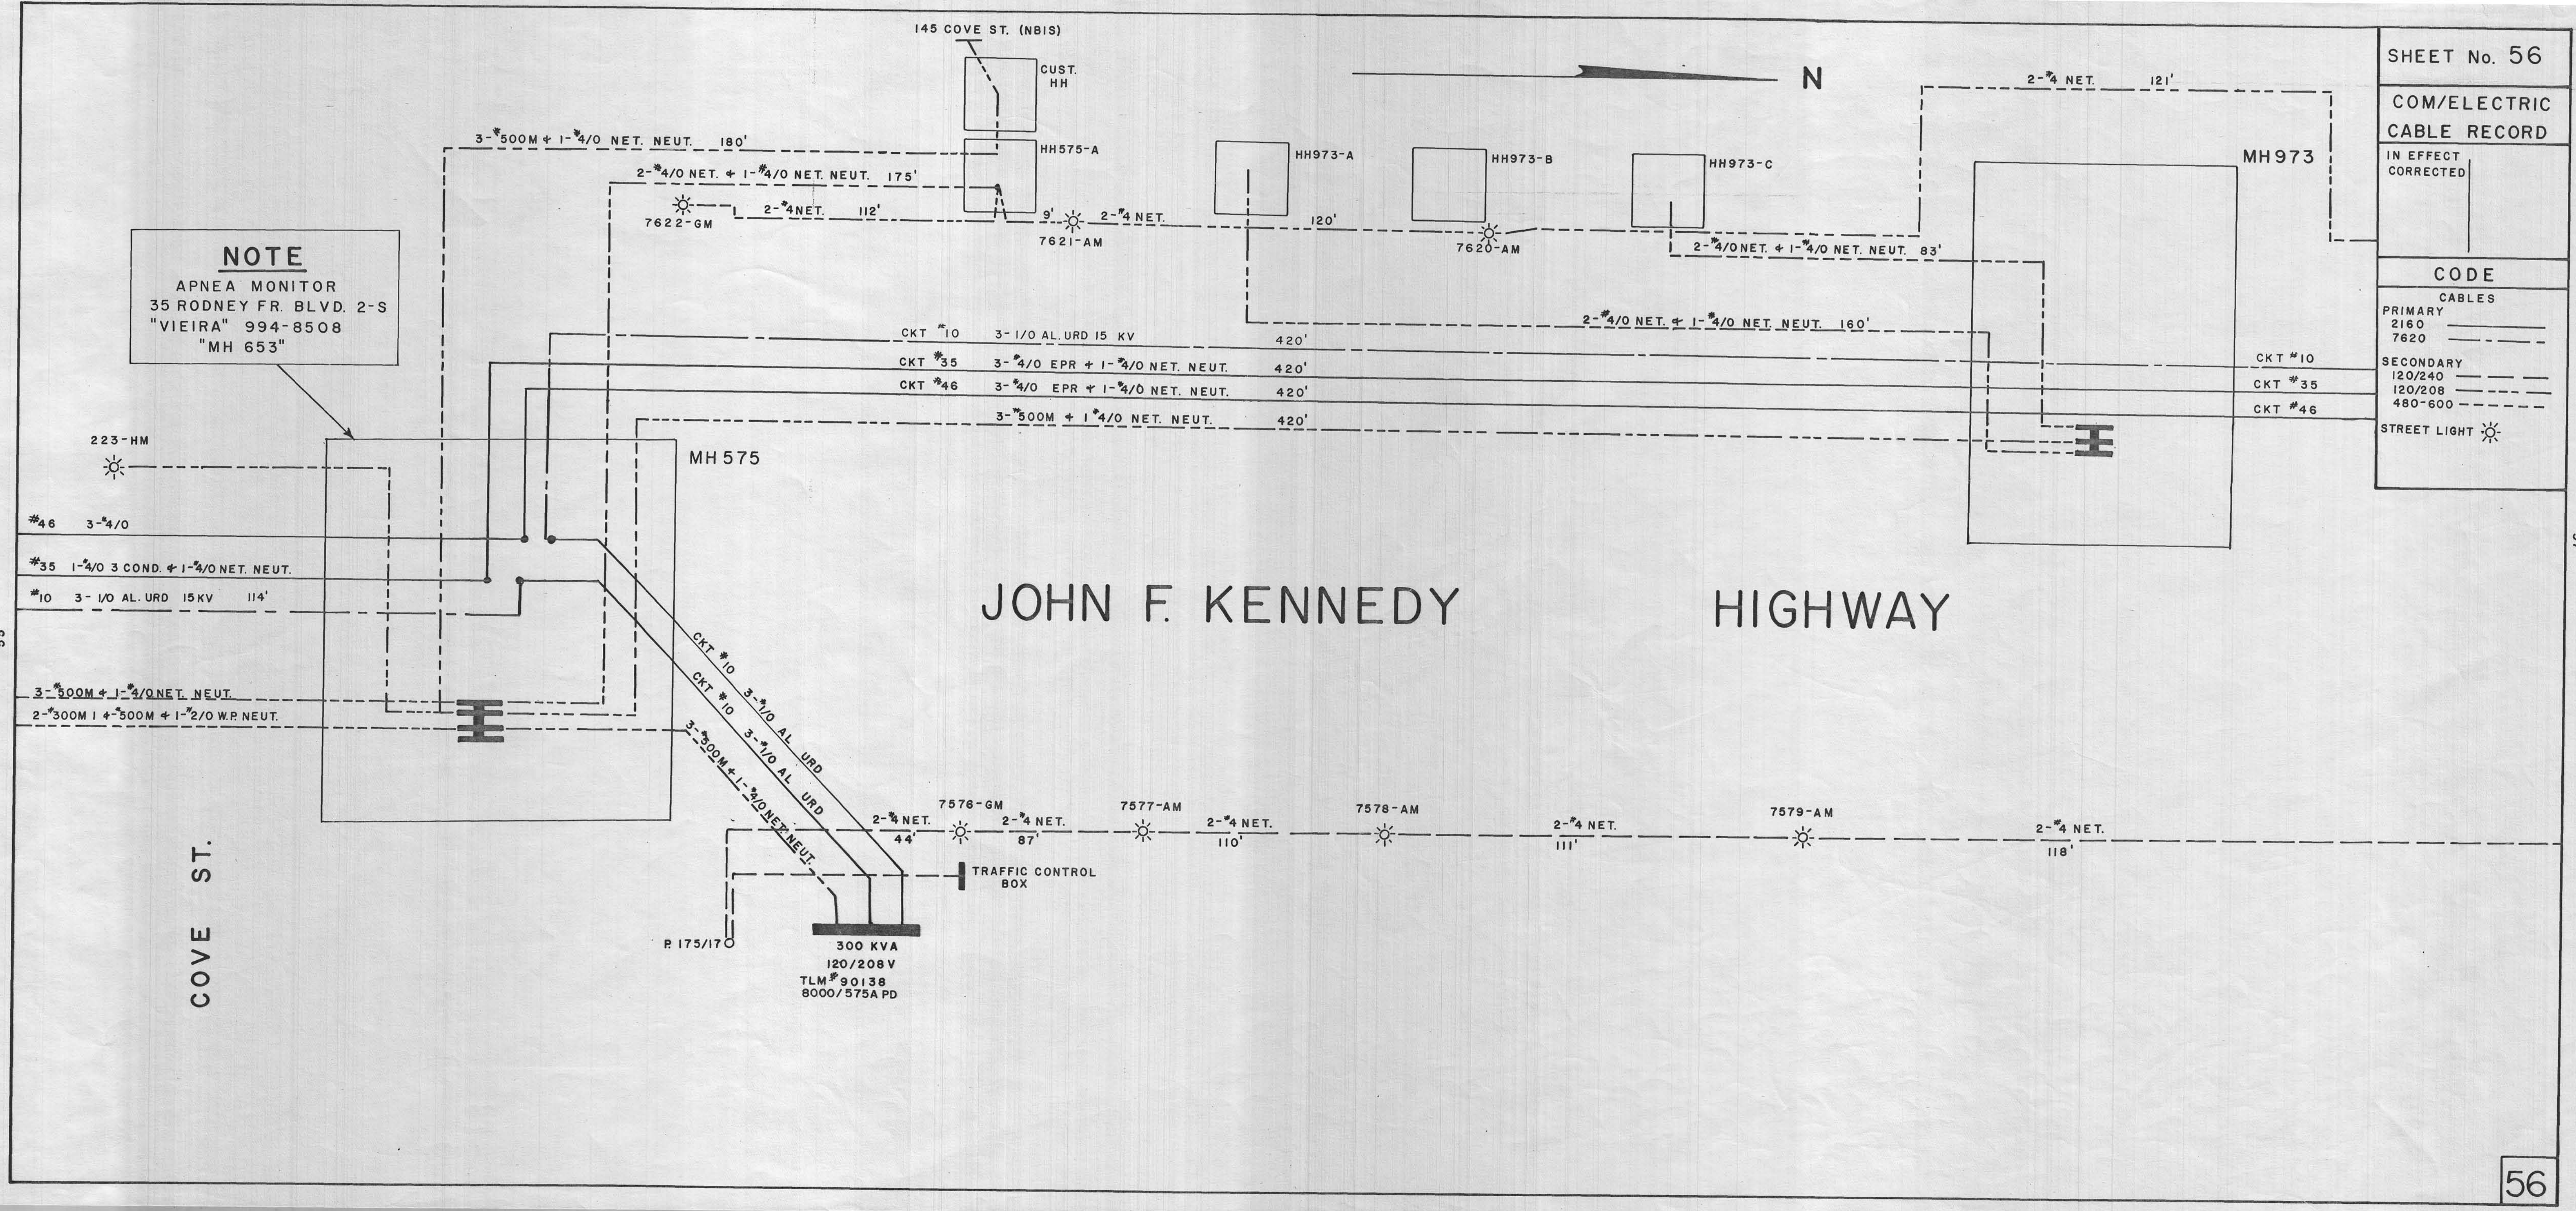

SHEET No. 56

COM/ELECTRIC
CABLE RECORD

IN EFFECT
CORRECTED

CODE

CABLES	
PRIMARY	
2160	
7620	
SECONDARY	
120/240	
120/208	
480-600	

STREET LIGHT

CKT #10	3-1/0 AL. URD 15 KV	420'
CKT #35	3-4/0 EPR + 1-4/0 NET. NEUT.	420'
CKT #46	3-4/0 EPR + 1-4/0 NET. NEUT.	420'
	3-500M + 1-4/0 NET. NEUT.	420'

CKT #10	
CKT #35	
CKT #46	

300 KVA
120/208 V
TLM #90138
8000/575A PD