

APPLICATION / AGREEMENT

For DISTURBANCE PERMIT within the City of New Bedford

Permit # 885-2007  
Dig Safe # 20222512083  
Date Issued: \_\_\_\_\_

This permit shall be posted at the work site, and shall remain until the work is completed. It is subject to inspection at all times.

TO THE MAYOR AND CITY COUNCIL: \_\_\_\_\_ DISTURBANCE PERMIT

Permission is hereby requested to excavate the surface of: \_\_\_\_\_ City Property

Location of work: Corner of Rockdale Avenue and Allen Street

Substantially as per plan annexed, for the purpose of: installation of manhole and electrical conduit by 9-18-2007

text pits only

Work will begin (weather permitting) on 09-14-2007

Work will end (weather permitting) on: 12-14-2007

Applicant Name: Kirk Franklin

Excavator(s) Name: Kirk Franklin

Company Name: Frank Corp. Services

Hoisting Equipment License Number: HF-076597

Grade: 2A Expiration Date: 9-6-22

Contact Name: Kevin Kelso Name & Contact Number of Insurer: Smithwick & Mariners #207-791-5553

Approved By: Stephen Cooper Date: 9-12-2007


Title: Asst. City Engineer

Roadway closures will require authorization from the Commissioner of Public Infrastructure.

Traffic management plans may be required.

For inspection, 24 hour notice is required and the Contractor / Applicant is required to notify the D.P.I. @ 508-979-1550 Press 4 Repair. Permit Expires in 3 Months from work start date.


Provide Sketch

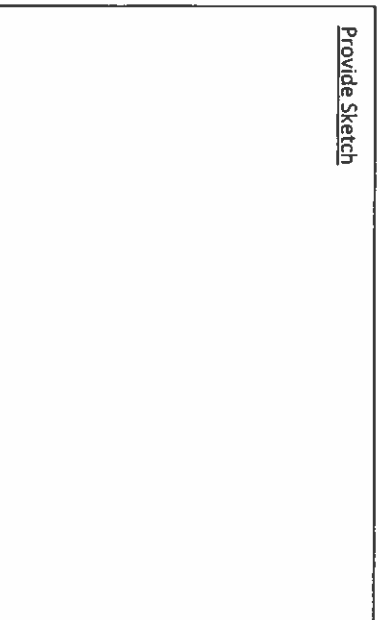



Please note... Not all existing non-electric infrastructure is shown on this sketch. Only the infrastructure relevant to the project is shown.

The manhole to be installed for this project is Eversource Std. #m1204... 6' x 10' x 8' (ht).

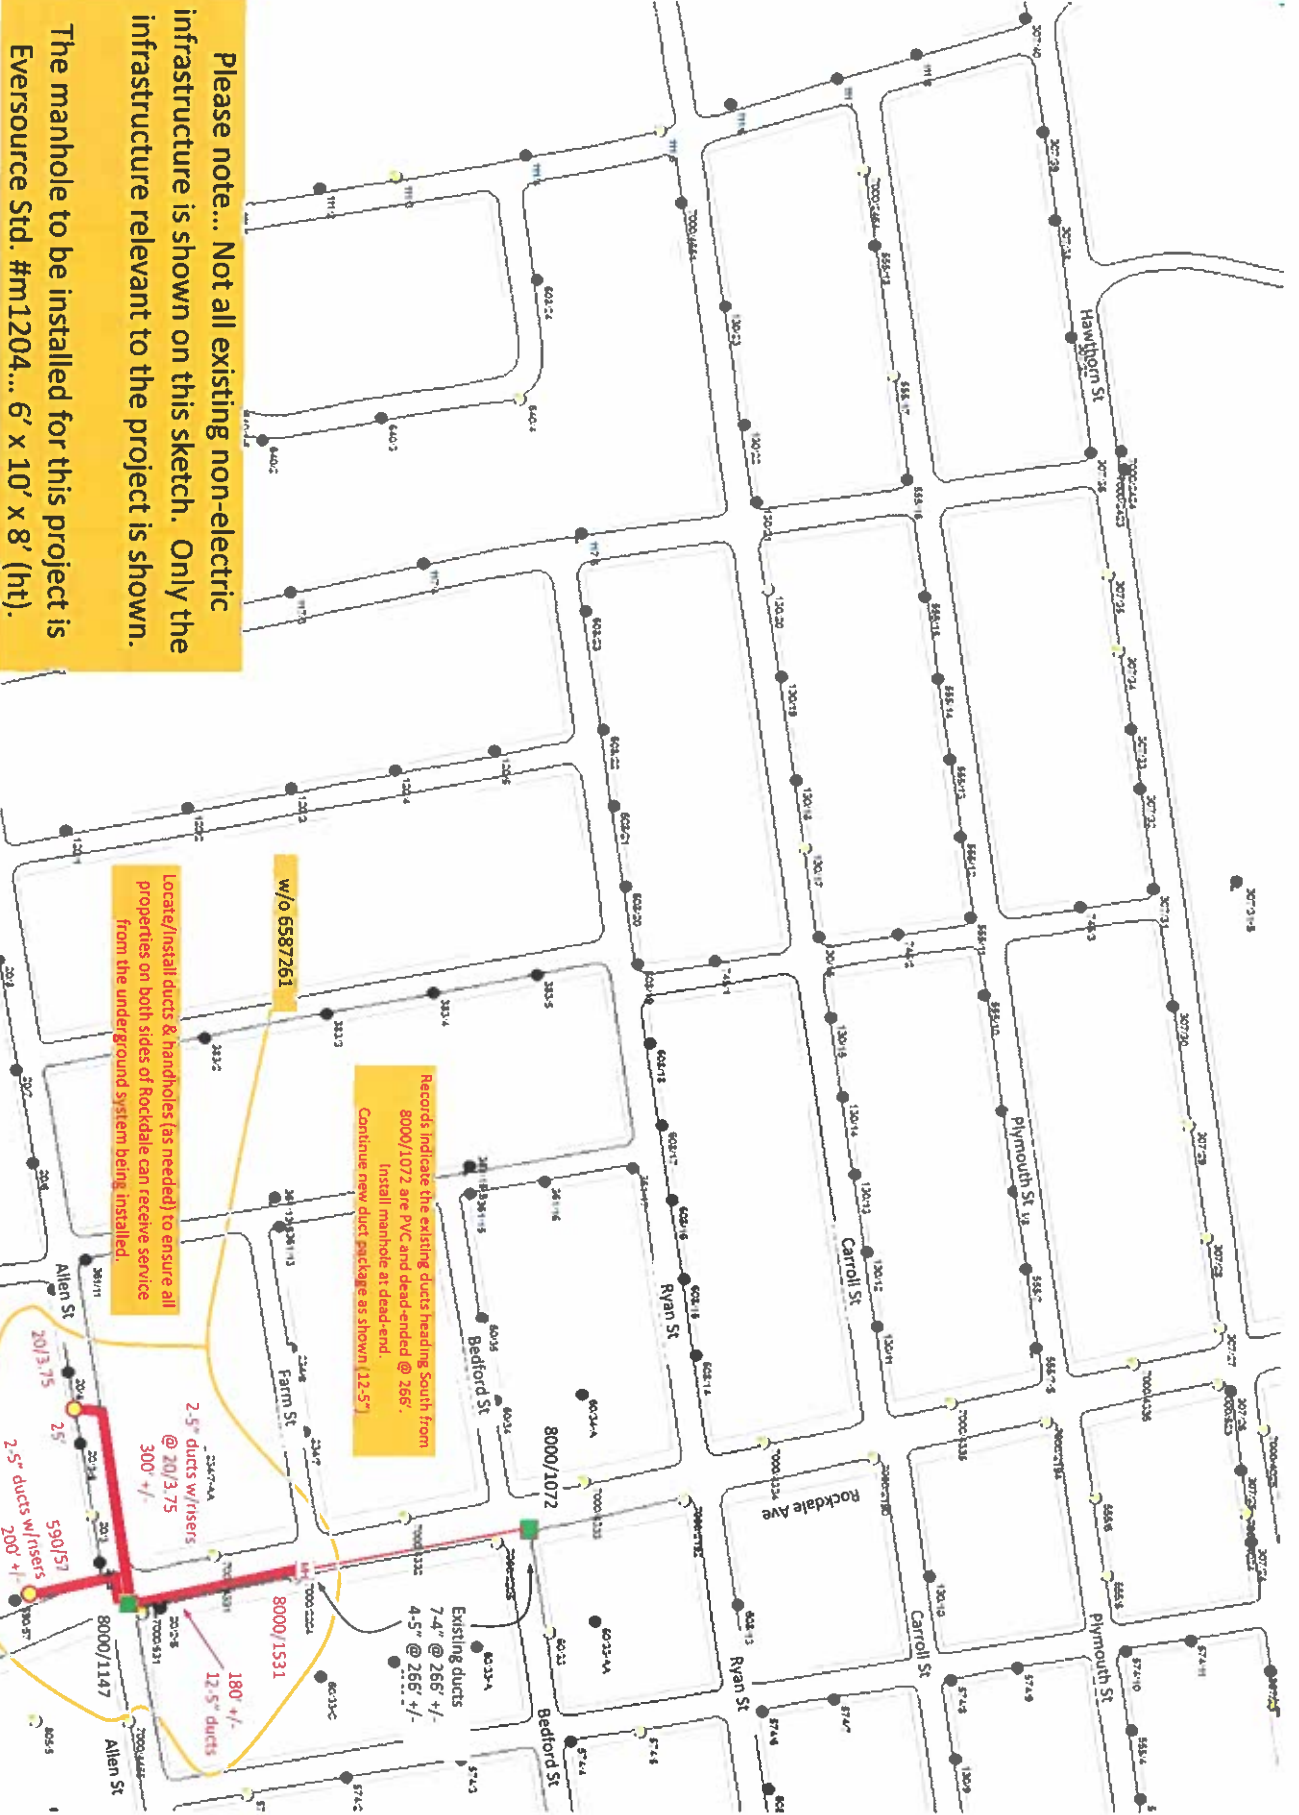

Locate/Install ducts & handholes (as needed) to ensure all properties on both sides of Rockdale can receive service from the underground system being installed.

Records indicate the existing ducts heading South from 8006/1072 are PVC and dead-ended @ 266'.  
Install manhole at dead-end.  
Continue new duct package as shown (12-5)

w/o 6587261

2-5" ducts w/risers

2.5" ducts w/risers  
200' +/-

**EVERSOURCE**

**Project Name: Rockdale Ave Non-electric System Improvement (Rockdale @ Allen)**

Sheet #:

Rev. # - Date: 1/7/2022

**Engineering:**  
**Billy Sobieraj**  
**Stephanie Gracie**

**Voltage (kV):**

**Circuitry:**

**Town(s):**



AWC:















































WO(s):

## Non-Electric Sketch

450' + 5" EB

# Non-Electric Key

 Item(s) to be removed by Eversource.  
 Item(s) to be removed by Customer.

Eversource Provide/Install/Own/Maintain (Unless Otherwise Indicated)		Customer Provide/Install (Unless Otherwise Indicated)		Status	Description
Existing	New	Existing	New	n/a	Pole
				n/a	Riser pole, non-electric portion In compliance with Note 1
				n/a	Ducts, concrete encased Quantity/Size as indicated In compliance with Note 7
				n/a	Transformer Foundation Type as indicated
3-phase: In compliance with Notes 4 – 6 Pad #1 (transformers up to 300 kVA) (Cat ID #579134) Pad #2 (transformers 500 to 2500 kVA) (Cat ID #579135)					
1-phase: 43"x37"x32", Cat ID #581386 In compliance with Note 3 & 6					
				n/a	Manhole, 6' x 10' x 8' (m) Eversource Std. #m1204 In compliance with Note 2
				n/a	Secondary handhole, 30"x17"x18" In compliance with Note 3 Fiberglass: Cat ID #574317 Composite: Cat ID #521914
				n/a	Switching Station (turtle) Box Pad In compliance with Note 3 & 6 Cat ID #574926
				n/a	Padmounted Recloser Foundation In compliance with Note 2, 6, & 8 Cat ID #586691
				n/a	Padmounted Switch Box Pad Type as indicated In compliance with Note 3 & 6 PME-3: Cat ID #579185 PME-5: Cat ID #579614
				n/a	Primary Meter Foundation In compliance with Note 3, 6, & 9. Cat ID #585731
				n/a	Anchor with guy wire
				n/a	Push Brace
				n/a	Protective Vehicle Posts In compliance with Note 6

## Notes

The following Eversource standards are available online, unless otherwise stated, at <https://www.eversource.com/content/ci-about-us/doing-business-with-us/builders-contractors/eastern-massachusetts/importants-documents>

General: Reference Eversource Std. #d3820 "Construction, Material, and Work Specifications for New 15/25 kV Primary Underground Distribution Systems Up to 200 Amps".

- 1) Eversource Std. #c2021 "Primary URD Riser Construction".
- 2) Eversource Std. #c3813 "Installation of Precast Concrete Manholes".
- 3) Eversource Std. #c3814 "Installation of Handholes & Box Pads".
- 4) Eversource Std. #m3801 "Precast Concrete Transformer Foundations – Up to 2500 kVA".
- 5) Eversource Std. #c3801 "Installation of Precast Pad Foundation for 4kV, 15kV, & 25kV Padmounted, Three-Phase Distribution Transformers".
- 6) Eversource Std. #c3802 "Recommended Minimum Clearances from Three-Phase Distribution Transformer Foundation to Buildings, Building Openings, Landscaping or Traveled Way". Please note the information provided within this specification is also applicable to single phase distribution transformer foundations EVEN THOUGH it is not specified. Also reference "Information & Requirements for Electric Service (Revised 2009)", page 119, Sketch 10.
- 7) Eversource Std. #c1100 "Distribution Ductbank Construction and Materials".
- 8) Eversource Std. #c4250 "Cooper Padmounted Recloser Installation". Standard available upon request.
- 9) Eversource Std. #c4600 "Primary Metering Construction Standard". Standard available upon request.