

APPLICATION / AGREEMENT
For DISTURBANCE PERMIT within the City of New Bedford

Permit # 213 2023

Dig Safe # 20231313593

Date Issued: April 11, 2023

This permit shall be posted at the work site, and shall remain until the work is completed. It is subject to inspection at all times.

TO THE MAYOR AND CITY COUNCIL: ☒ DISTURBANCE PERMIT

Permission is hereby requested to excavate the surface of: ☒ City Property

Location of work: 40 Edison Street

Substantially as per plan annexed, for the purpose of: Electric Conduits and Handholes

Work will begin (weather permitting) on: 4-10-23

Work will end (weather permitting) on: 7-10-23

Applicant Name: Kirk Franklin

Excavator(s) Name: Kirk Franklin

Company Name: Frank Corp. Environmental

Hoisting Equipment License Number: HE-076597

Grade: 2A Expiration Date: 9-6-24

Contact Name: Kevin Rocha

Name & Contact Number of Insurer: Smithwick & Mariners

Approved By: Stephen Cuyton Date: 4-11-2023

Title: Asst. City Engineer

Roadway closures will require authorization from the Commissioner of Public Infrastructure.

Traffic management plans may be required.

For inspection, 24 hour notice is required and the Contractor / Applicant is required to

notify the D.P.I. @ 508-979-1550 Press 4 Repair. Permit Expires in 3 Months from work start date.

Provide Sketch

Attached



Sheet: 1 of 5

Rev. #:

Date: 1/5/2022

Engineer:
Corey Lopes

13.2/7.6

Voltage

Circuit (5):
Non-Electro


Town(s): New Bedford

NEW RECORD

AWC

09066111

:(S)OM

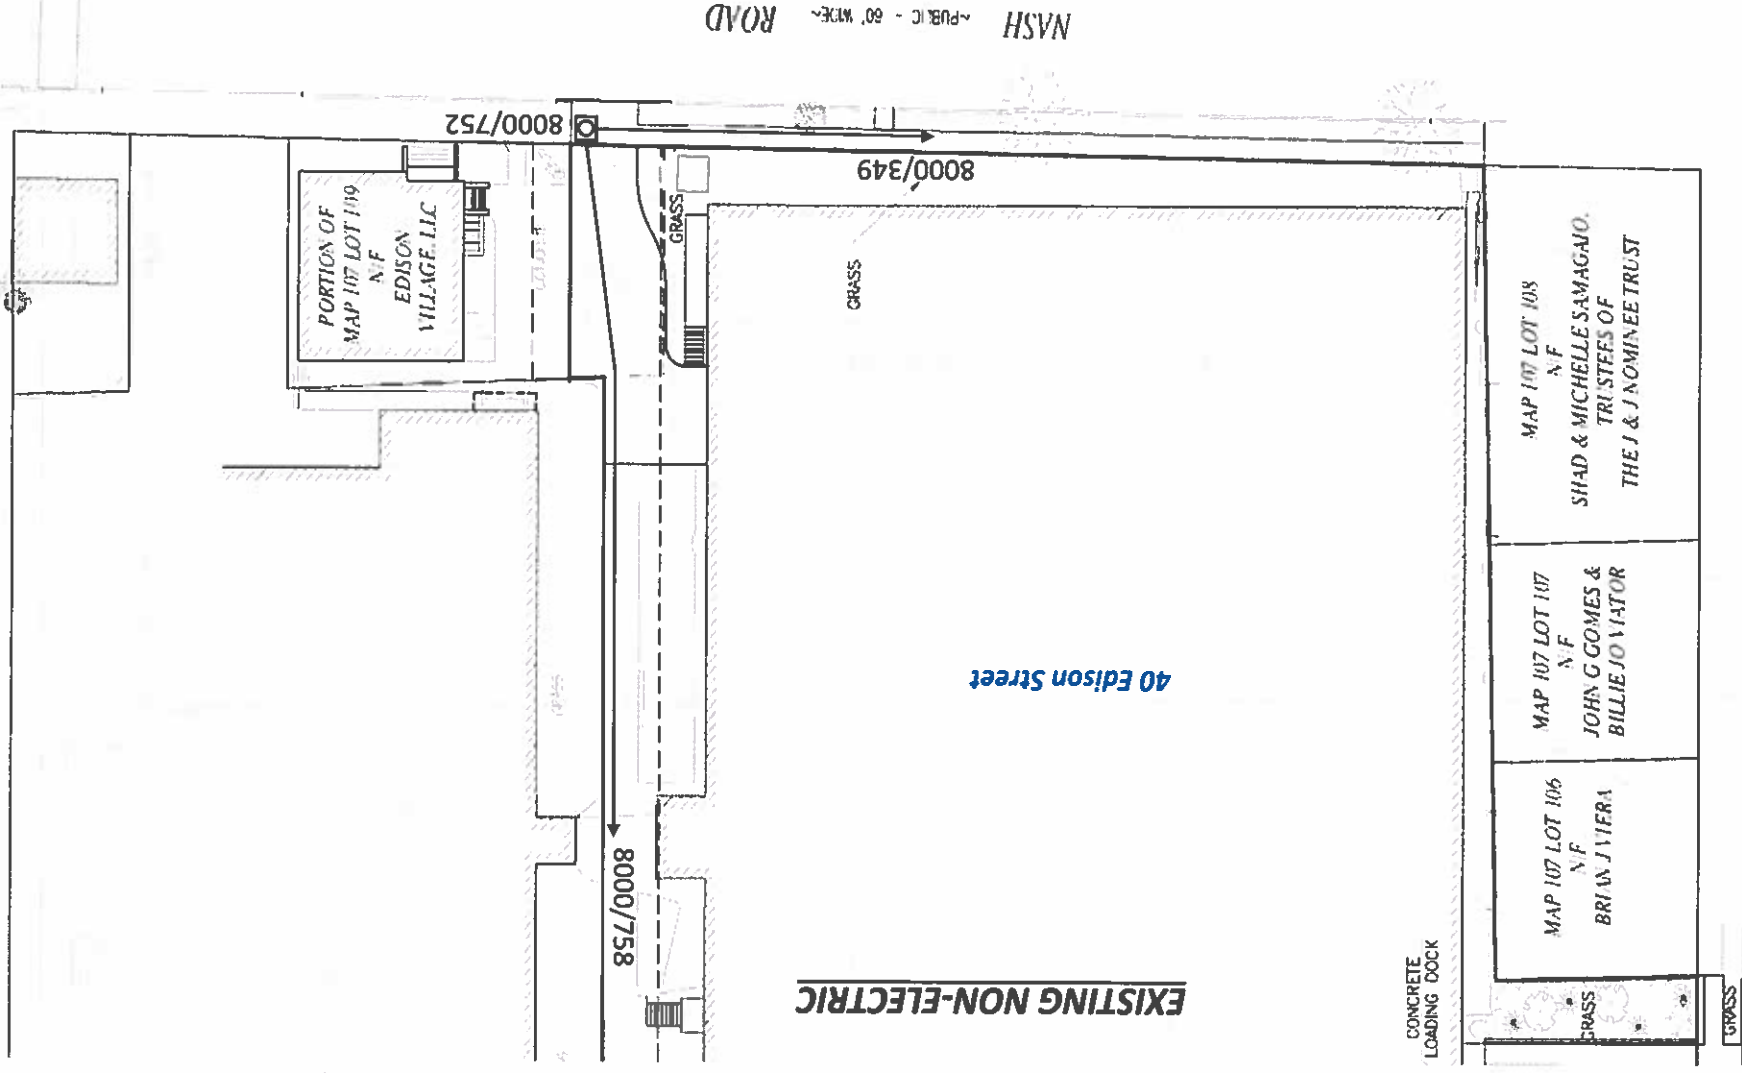

ELECTRICAL KEY:


T

THREE PHASE TRANSFORMER
FOUNDATION CAT ID#579134

S

S&C PME-9 SWITCH, MOTOR
OPERATED, CAT ID# 603869 DTR 60.856.0A

40 Edison Street

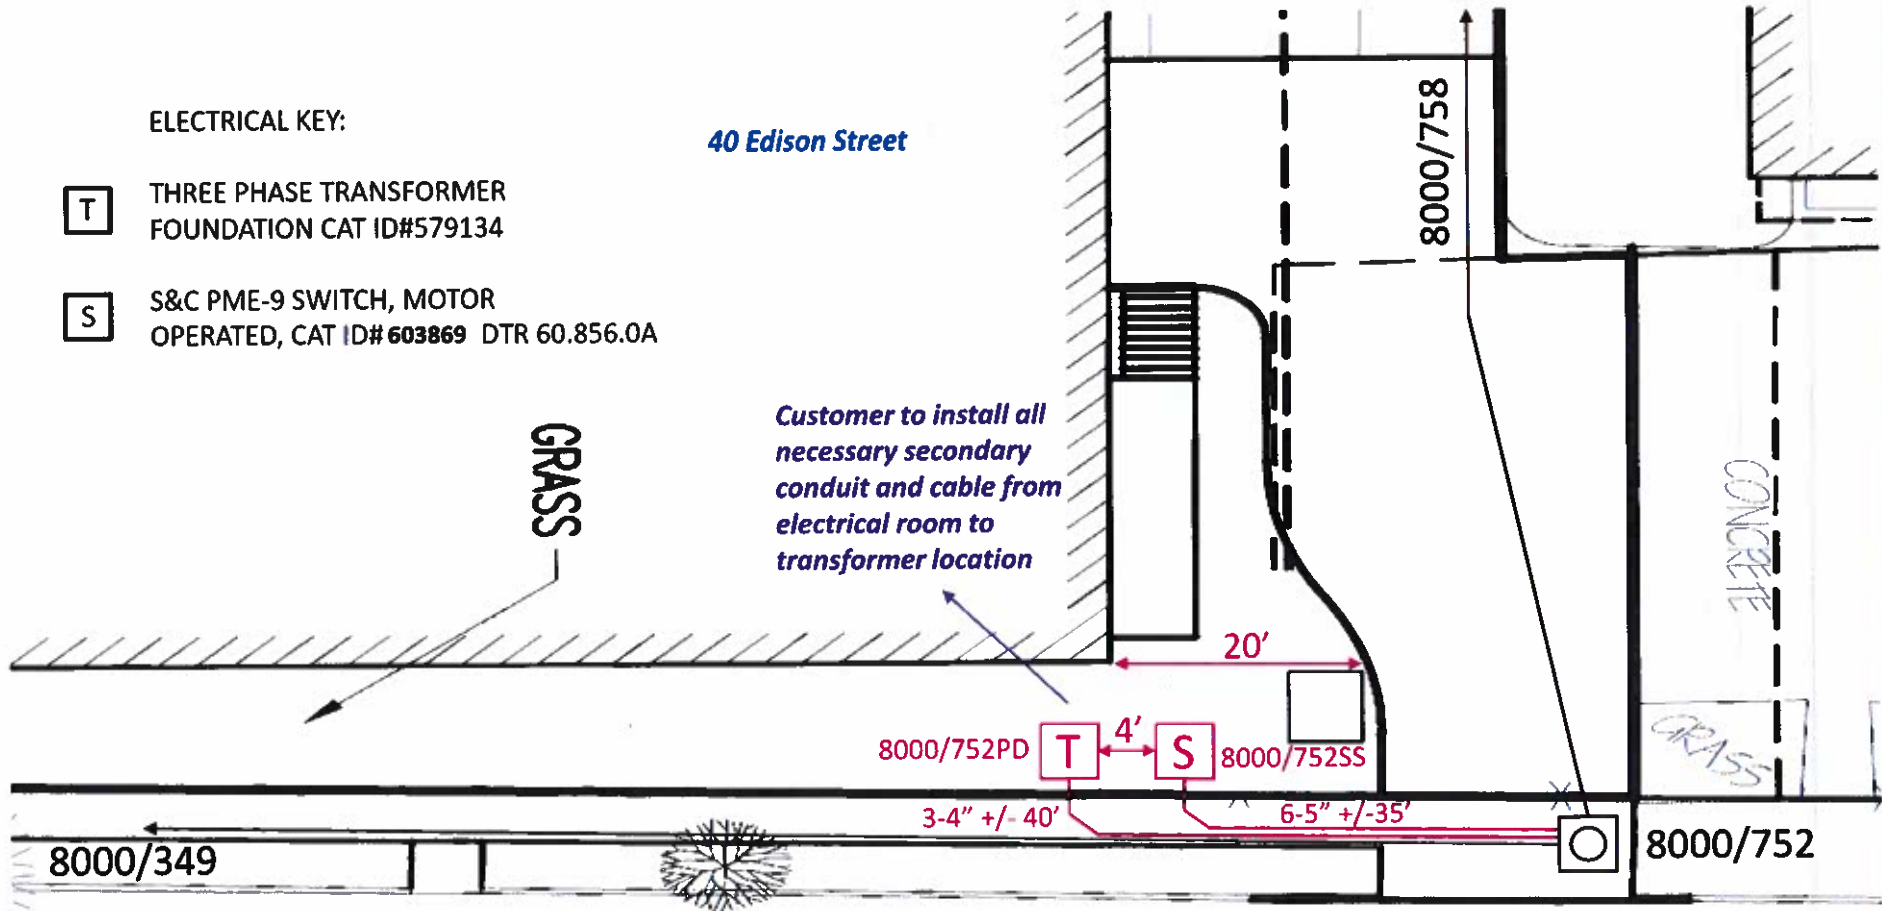

WO(s):
11199080
AWC:
New Bedford

Town(s):
New Bedford

Circuit(s):
Non-Electric

Voltage (kV):
13.2/7.62


Engineer:
Corey Lopes

Date:
1/5/2022

Rev. #:
Original

Sheet:
2 of 5

EVERSOURCE
40 Edison Street

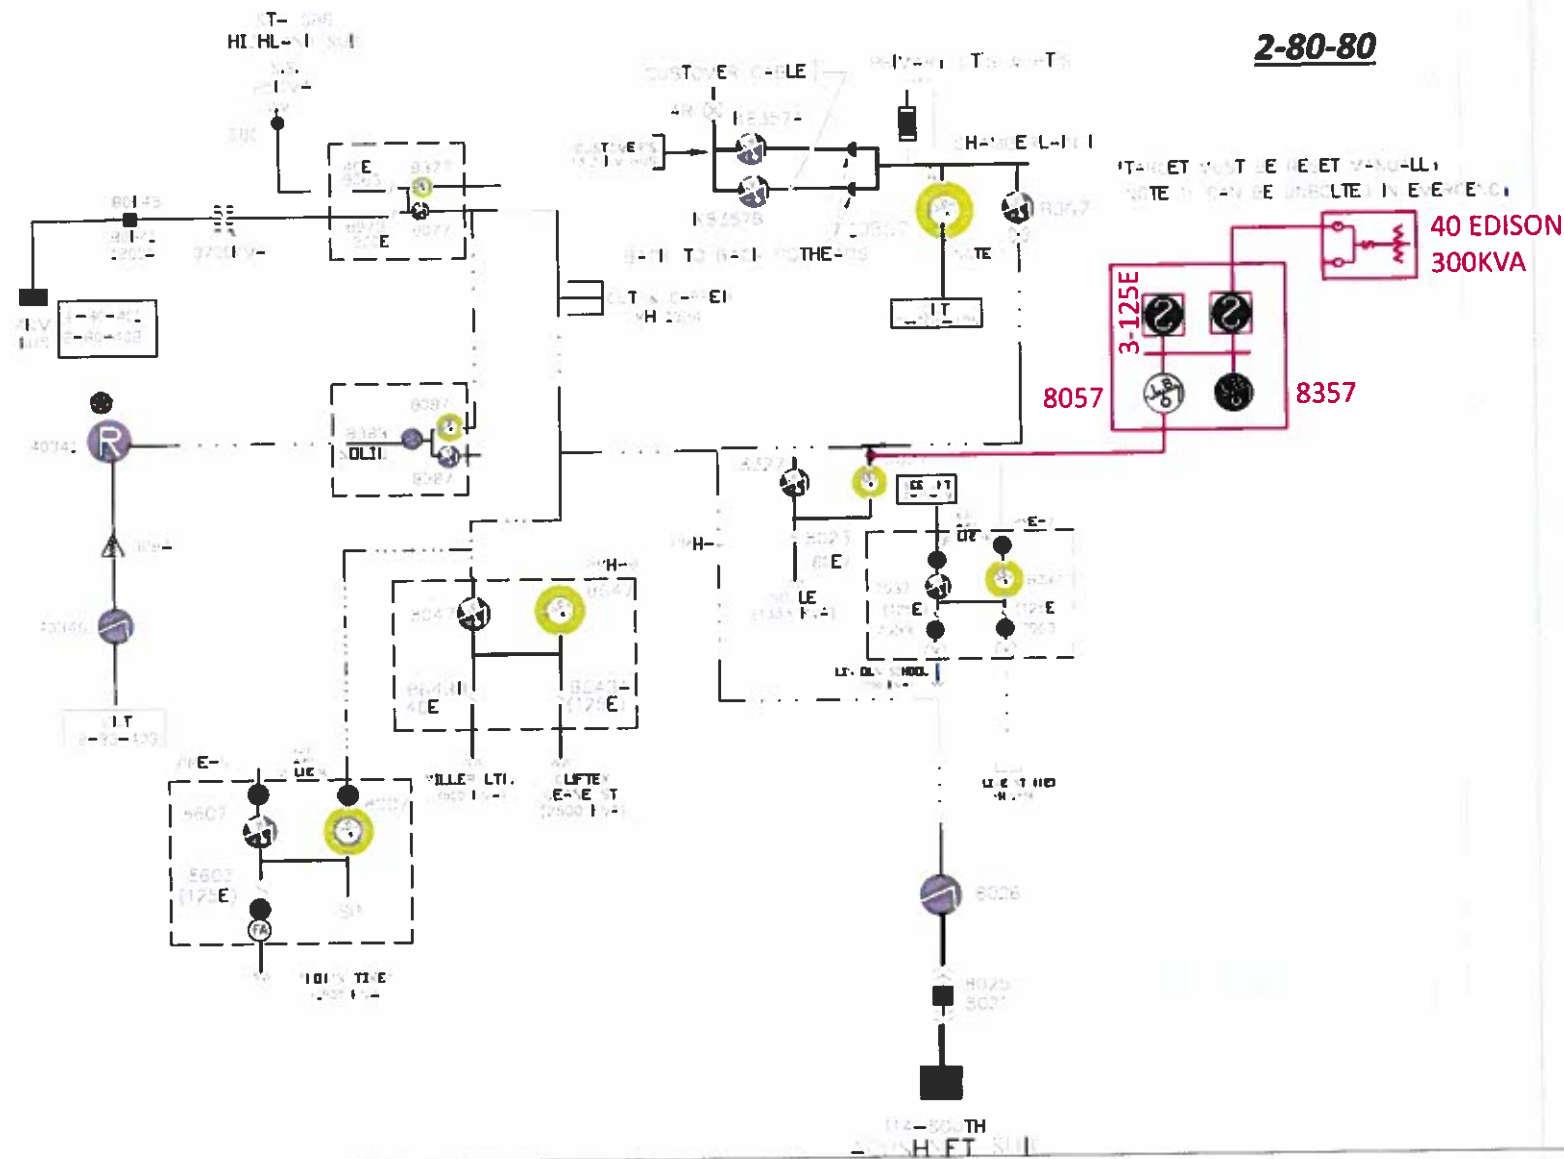

WO(s):
11199060
AWC:
New Bedford

Town(s):
New Bedford

Circuit(s):
2-80-80

Voltage (kV):
13.2/7.62

Engineer:
Corey Lopes

Date:
1/5/2022

Rev. #:
Original

Sheet:
4 of 5