


PINE ST. SUB STATION

SHEET NO. 2

CODE

CABLES	
SECONDARY	120/208
	120/240
PRIMARY	2200-4400
	13,200
STREET LIGHT	

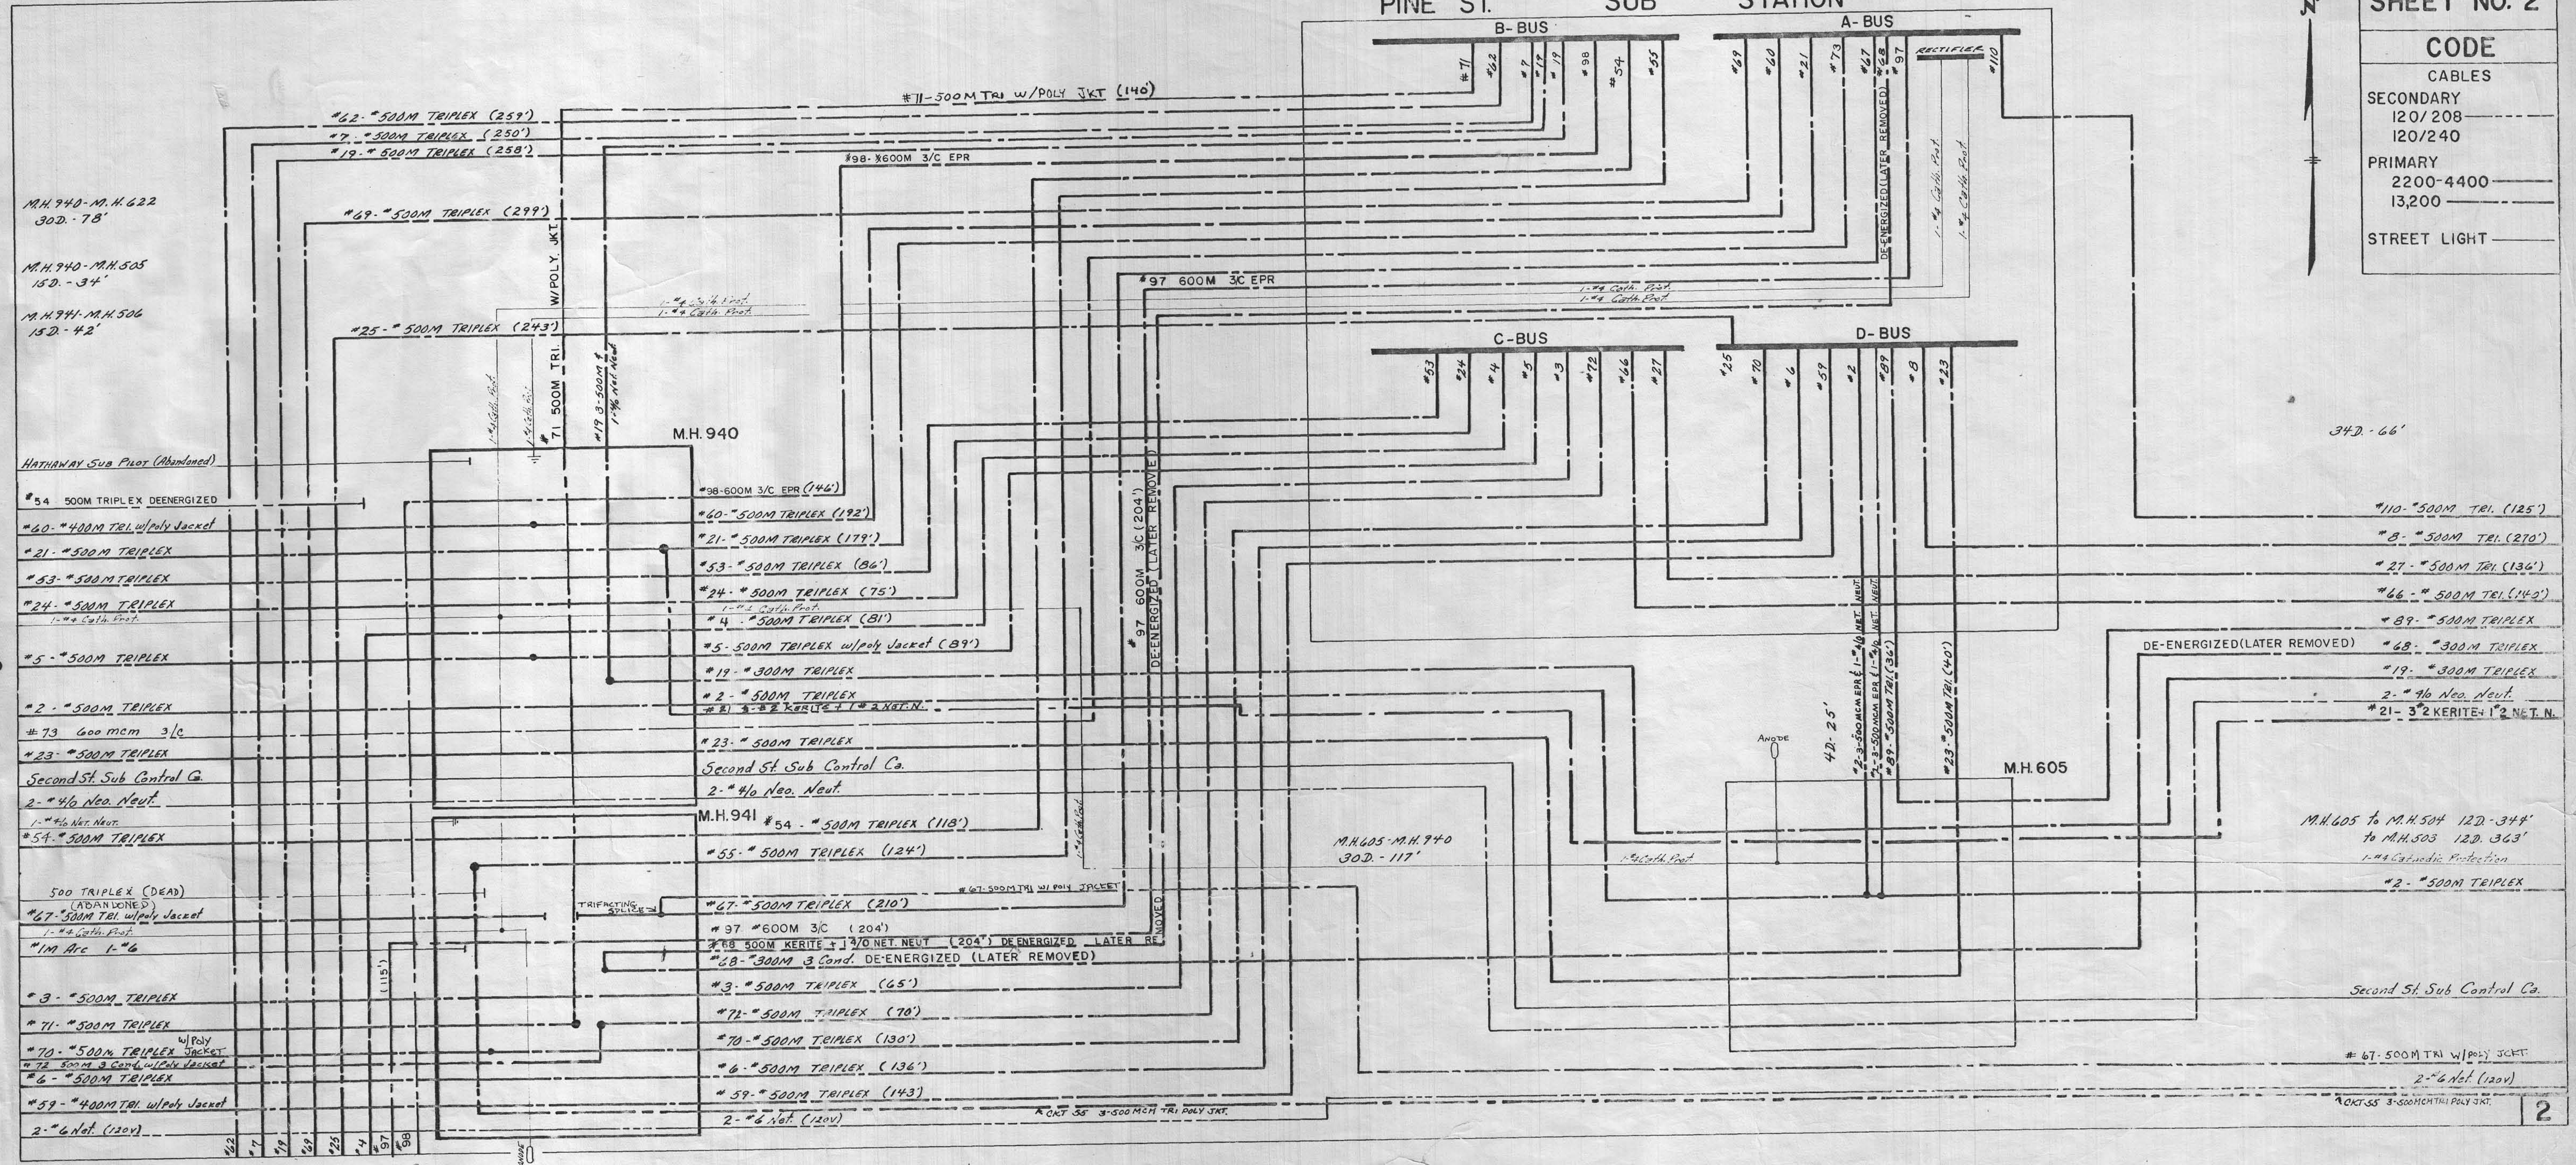

M.H. 940-M.H. 622
30D-78'

M.H. 940-M.H. 505
15D-34'

M.H. 941-M.H. 506
15D-42'

HATHAWAY SUB PILOT (Abandoned)

#54 500M TRIPLEX DEENERGIZED

#60-400M TRI w/poly Jacket

#21-500M TRIPLEX

#53-500M TRIPLEX

#24-500M TRIPLEX
1-# Cath. Prot.

#5-500M TRIPLEX

#2-500M TRIPLEX

#73 600 MCM 3/C

#23-500M TRIPLEX

Second St. Sub Control Co.

2-4/0 Neo. Neut.

1-#4 Neo. Neut.

#54-500M TRIPLEX

500 TRIPLEX (DEAD)
(ABANDONED)

#67-500M TRI w/poly Jacket
1-# Cath. Prot.

#1M Hic 1-#6

#3-500M TRIPLEX

#71-500M TRIPLEX
w/poly Jacket

#70-500M TRIPLEX
w/poly Jacket

#72-500M 3 Cond. w/poly Jacket

#6-500M TRIPLEX

#59-400M TRI w/poly Jacket

2-#6 Neut. (120V)

M.H. 940

#98-600M 3/C EPR (146)

#40-500M TRIPLEX (192)

#21-500M TRIPLEX (179')

#53-500M TRIPLEX (86')

#24-500M TRIPLEX (75')

1-# Cath. Prot.

#4-500M TRIPLEX (81')

#5-500M TRIPLEX w/poly Jacket (39')

#19-300M TRIPLEX

#2-500M TRIPLEX

#21-3-2 KERITE+1-2 NET. N.

#23-500M TRIPLEX

Second St. Sub Control Co.

2-4/0 Neo. Neut.

M.H. 941

#54-500M TRIPLEX (118')

#55-500M TRIPLEX (124')

#67-500M TRI w/poly JACKET

#97 600M 3/C (204')

#68 500M KERITE+1-2/0 NET. NEUT. (204') DE-ENERGIZED LATER REMOVED

#68-300M 3 Cond. DE-ENERGIZED (LATER REMOVED)

#3-500M TRIPLEX (65')

#72-500M TRIPLEX (70')

#70-500M TRIPLEX (130')

#6-500M TRIPLEX (136')

#59-500M TRIPLEX (143')

2-#6 Neut. (120V)

M.H. 605-M.H. 940
30D-117'

M.H. 605

M.H. 605 to M.H. 504 12D-344'
to M.H. 503 12D-363'
1-# Cath. Protection

#2-500M TRIPLEX

Second St. Sub Control Co.

#67-500M TRI w/poly JKT

2-#6 Neut. (120V)

#67-500M TRI w/poly JKT