

93

December 27, 1951

#23677

Grim-Grip Inc.

N.S. 123 Sawyer St., Ex Mitchell
St.

Please install 6" Cast Iron Fire
Supply to supply mfg. plant. Lay with
drain.

Measure of 6" Gate Valve, All Bell:

Ex E Line Mitchell St.	158.0
S x N " Sawyer St.	6.0
Ex W " Building	57.0

(over)

152' $\frac{1}{2}$ " of Cast Iron Cement Lined Pipe (short)	
1-6" x 6" x 6" x 6" Cross, Builders	
4-6" Bend, Bell & Spigot, Builders	SHORT
1-6" Bend, Bell & Spigot, B. 6 FT. LONG.	
1-6" Solid Sleeve, Builders	
1-6" Gate Valve, All Bell	
1-6" C. I. Gate Box, complete	
1-6" x 6" x 6" Branch, Builders	
1-6" Round Riser	
1-6" Pipe Strap (special)	6.00
27 Lbs. of Leadite	
5 $\frac{1}{2}$ " of Gasket	
Use of Compressor	3.00
1 sidewalk cut: 4' x 4' Cement	
Carting	15.00
Labor (Ser. #23676 and Ser. #23677)	136.62

SAWYER STREET

MAIN PIPE

NORTH CURB

LINE

NEW HYDRANT LOCATION
ABOUT 5.0 EAST OF FORMER

6x6x6
BRANCH

FORMER HYD.
LOCATION

6" C.I. PLUG WITH THREADED BRASS 15x15x6 2" C.I. X MALE COUPLER

6" ALL BELL GATE (HYD)

6" ALL BELL GATE

6" SOLID SLEEVE

BRASS 45 90°

COPPER ELBOW 90°

2" ALL BELL

2-2" COUPLING NIPPLS

2" COPPER

CELLAR WALL

INSIDE CELLAR


6" - 1/4 BEND 6"

SHORT - 1/4 BEND 6"


End here

FIRE SUPPLY

(BUILDING WEST SIDE)

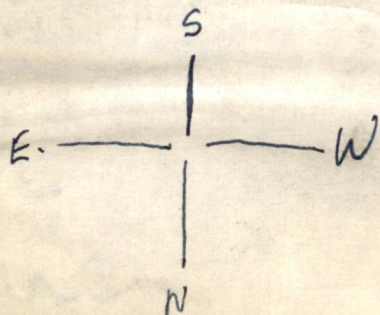



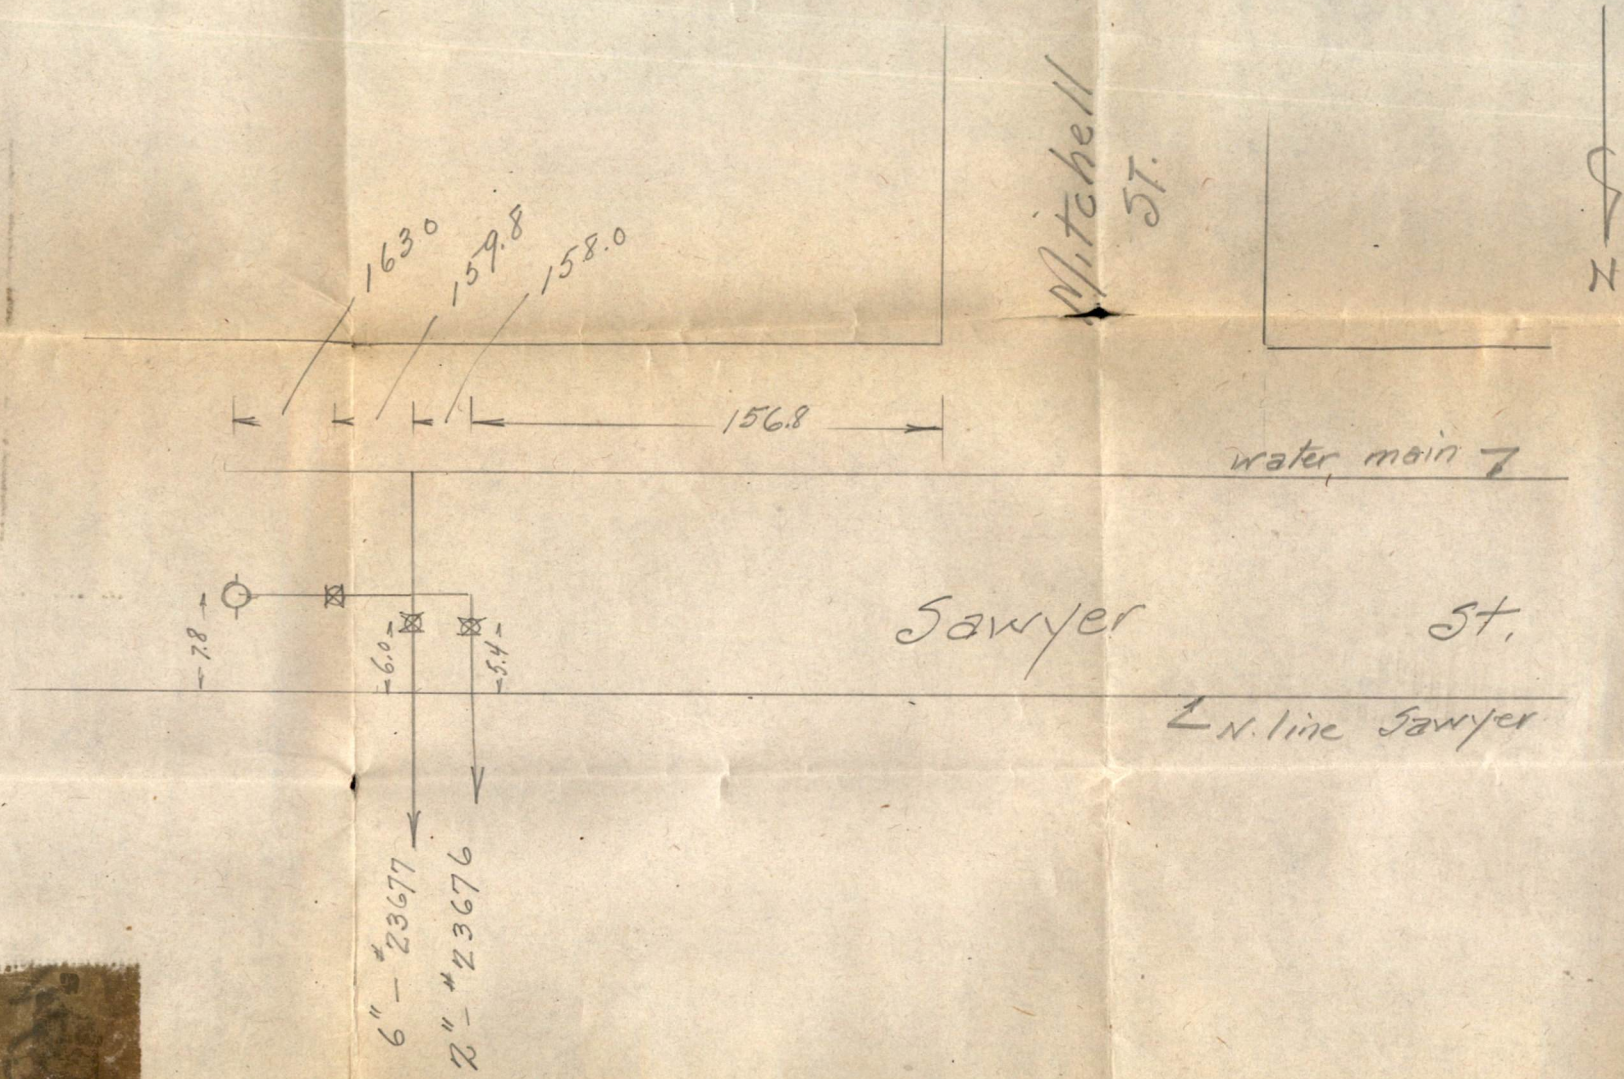

Myer St.
E. x Mitchell
