

Owner's plumber installed 20' of 2" copper from the
July 15, 1955 line to inside bldg.
January 13, 1956

#24559 Dept. of Public Works(City of N.B.)
S.S.#1101 Cove Rd., W x Shore St.

Please install 2" City Meter & 2"
Copper service to supply sewerage disposal
station. Tap man & D.P.W. to do digging.
Replaces 1" #15063.


Measure of 2" Gate Valve:

E x E line Margin Street	74.8
N x S " COVE RD.	8.0
West line Building	0.0

Work done October 26, 1955

(over)

Supervision.....	\$ 14.96
18 ft. of 2" copper tubing type K, soft.....	38.88
2 ft. of 1" copper tubing type K, soft.....	1.80
1-2" Darling gate valve, all bell.....	
1-2" Corporation #1200 - Walsbach.....	
2-2" Cop. to hub caulk. conns., A-7086.....	
1-2" cop. to cop. cplg., A-1671.....	
1-2" x 1" cop. reducing cplg., A-1716.....	
1 H-10527 Mueller Service Clamp, 6" x 2".....	
8 lbs. caulking lead.....	
1/2 lb. braided jute.....	
1 lb. wiping solder.....	1.20
1 R-144 Caldwell valve boxes.....	
Use of compressor.....	2.--
Use of tapping machine.....	5.--
1 sidewalk cut: 2' x 2 1/2' Warrenite.....	
1 street cut: 6' x 2 1/2' Warrenite.....	
Grating.....	
Labor.....	56.62

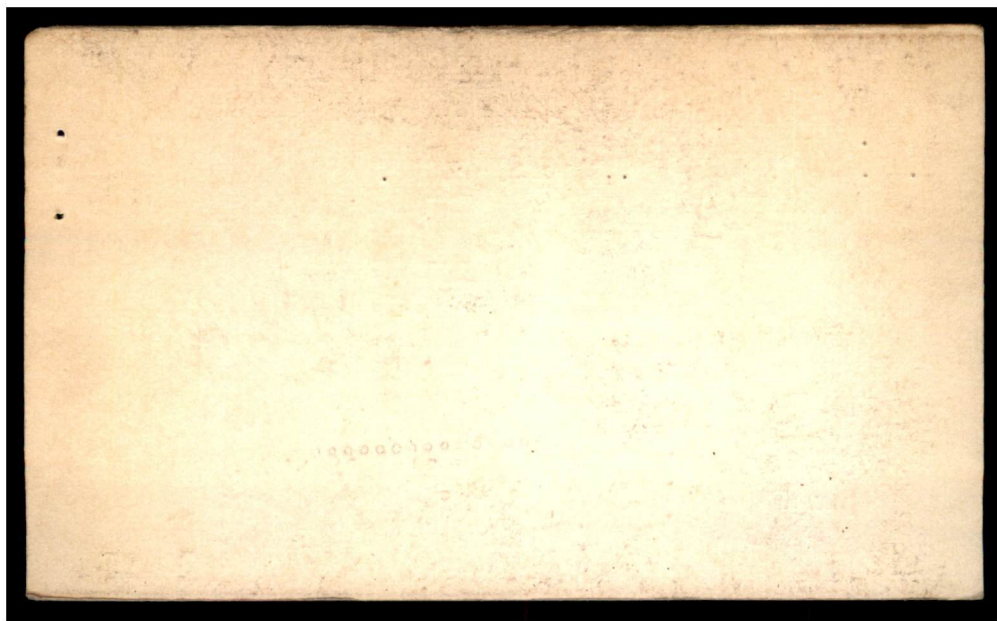


Attachment to Application Card


#24559

Dept. of Public Works

S. S. #1101 Cove Rd., W x Shore St.



2 ELECTRIC DUCTS ↗



○ STOP
BOX

○ STREET
LIGHT.