

March 28, 1956

53.28

#24772 Martin B. Ferrero
N. E. Cor. #958 Acushnet Ave. and
Kenyon St.

Please install 2" City Meter and 2"
Copper service to supply building.
Replaces 2" C. I. Service #16540.
To be laid in same location using
old tap and gate box, if possible.

Measure of 2" Gate Valve:


E x E line Acushnet Avenue	147.4
N x S " Kenyon Street	17.4
W x E " Building	12.2

Work done March 29, 1956

(over)

29 ft. of 2" copper tubing type K, soft.....	\$ 71.92
1-2" Darling Gate Valve, all bell.....	\$
1-4" Cop. to hub caulk. conn., A-7220.....	\$
2-2" " " " " " A-7086.....	\$
1-2" Cop. to cop. cplg., A-1671.....	\$
2 street cuts: 6' x 2½' & 4' x 2' Warrenite..	\$
16 lbs. caulking lead.....	\$
1 lb. braided jute.....	\$
Solder.....	1.--
Use of compressor.....	6.--
Carting.....	2.--
Supervision.....	\$ 14.96
Labor.....	\$ 63.94
1-4" x 2" BRONZE REDUCING BUSHING, A-1939.#	

The 4" G. I. gate box for previous service was reused.

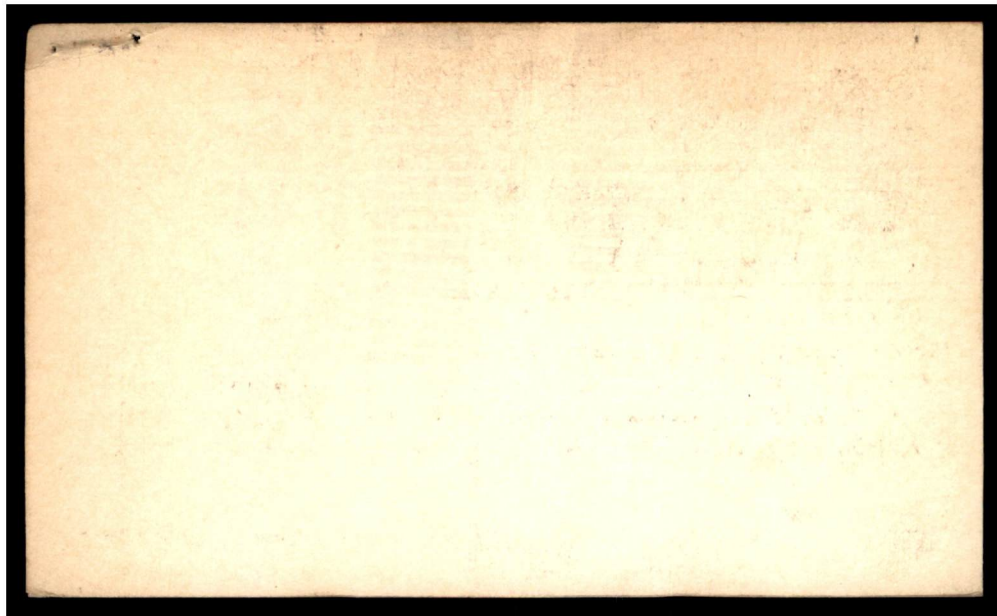

SOUTH LINE OF KENYON STREET

MAIN PIPE

RED LINE REPRESENTS THE
LIGHT STANDARD ELECTRIC
DUCT WHICH IS 2 FT
BELOW THE STREET
SURFACE

LIGHT STANDARD

6"X6"X4" TEE

2" GATE

2" COPPER
SERVICE
#24772

4'

N