

Tel: 5-8105

Main St. Norton, Mass.

April 28, 1960

#25719

Fernandes Realty Corp.

Junction of Acushnet Ave. & Rte. 140

Please install 6" Fire Supply C.L.C.I
Service to supply super market. To street line
only.

Measure of 6" Tapping Gate Valve: O-ring

W x E line Fox Street 10.0

S x N " Acushnet Avenue 10.5

E x W " Building 17.0

Measure of 6" All Bell Gate Valve: O Ring

W x E Line Fox Street 10.0

S x N " Acushnet Avenue 3.6


E x W " Building 17.0


Work done May 2 & 3, 1960

(over)

Service laid to a point 7.4 ft. inside property

Supervision.....	\$ 34.51
17 ft. of 6" Cast iron cement lined pipe.....	
Labor.....	\$136.02
2-6" C. I. gate boxes, complete - 224 lbs. ea.	
Carting.....	\$ 15.--
Tapping machine use.....	\$ 13.--
Compressor use.....	\$ 12.--
Motocrane use.....	\$ 21.--
Loader use.....	\$ 77.--
1-36"x36"x6" Tapping sleeve - A. P. Smith.....	\$
1-6" Darling tapping gate - O-ring.....	\$
1-6" O-ring All Bell Darling Gate Valve.....	\$
52 lbs. leadite.....	\$
3 1/2 lbs. braided jute.....	\$
1 Street cut: 10' x 4' Warrenite.....	
1 Sidewalk cut: 10' x 4' Dirt	
#25719 and #25736 laid in same trench - labor, carting, and supervision combined.	

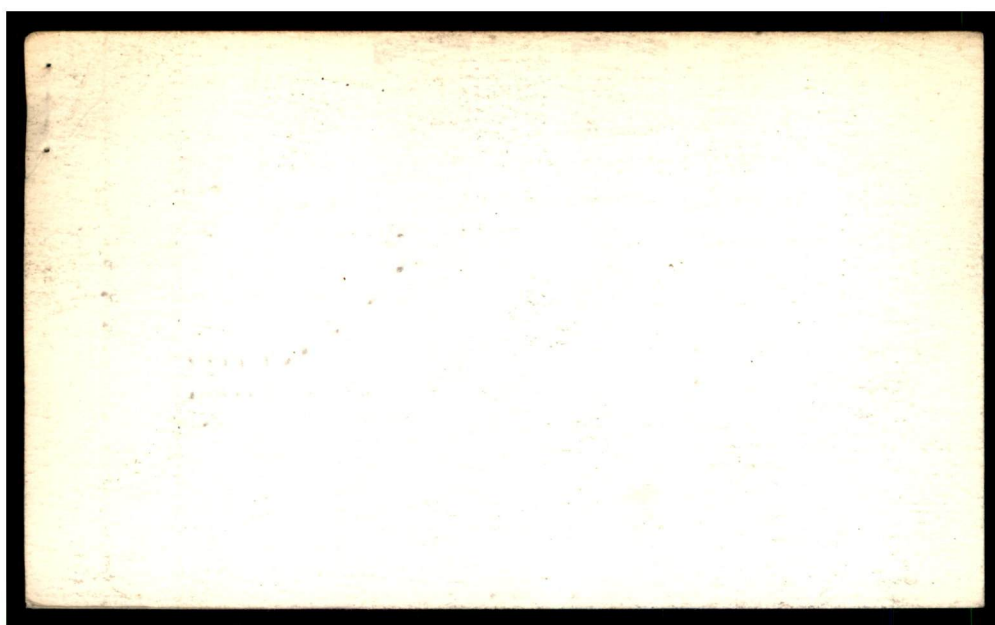

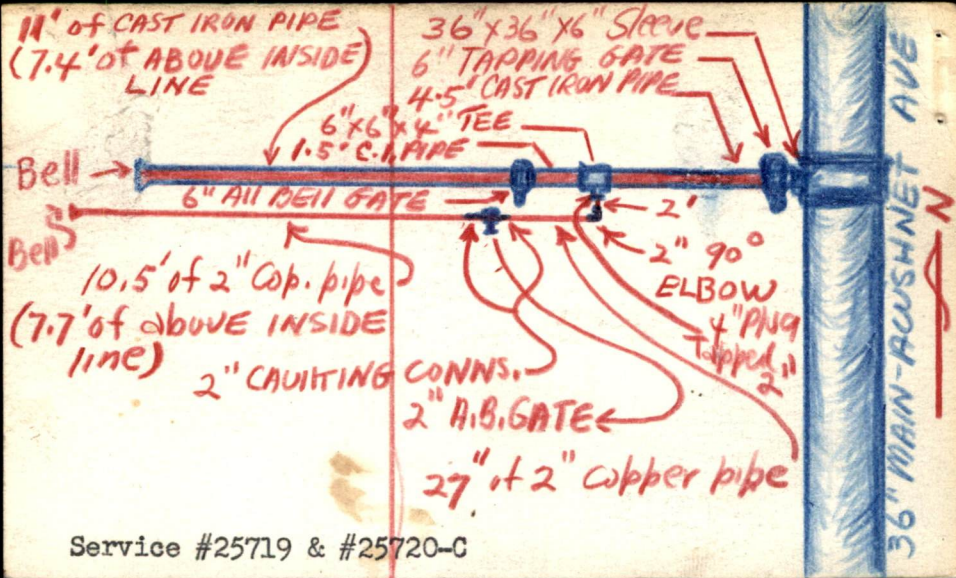

Service #25719 & #25720-C