

#29573

July 6, 1977

Building Dept.

Bldg. T-62 - Fort Rodman

Please install 2" copper service to supply building. Meter inside building.

Measures of 2" Curb Stop:

W x W line Bldg. T62 5.0 ft.

N x S line Bldg. T62 12.6 ft.


Measures of Tap:

N x 8" Gate (G15) 49.0 ft.



Work done July 5, 6, 7, 1977



All Stock supplied & installed by Water Dept.
Stock has been returned by Bldg. Dept.

114 ft. - 2" Copper tubing
1 - 2" Corporation
1 - 2" Curb Stop
1 - #10 Gate Box
2 - 2" Cplg.
2 - 2" Elbow
1 - 8" x 2" Service Saddle
D-4 Drilling Machine use
St. cut: 20' x 4' Warrenite

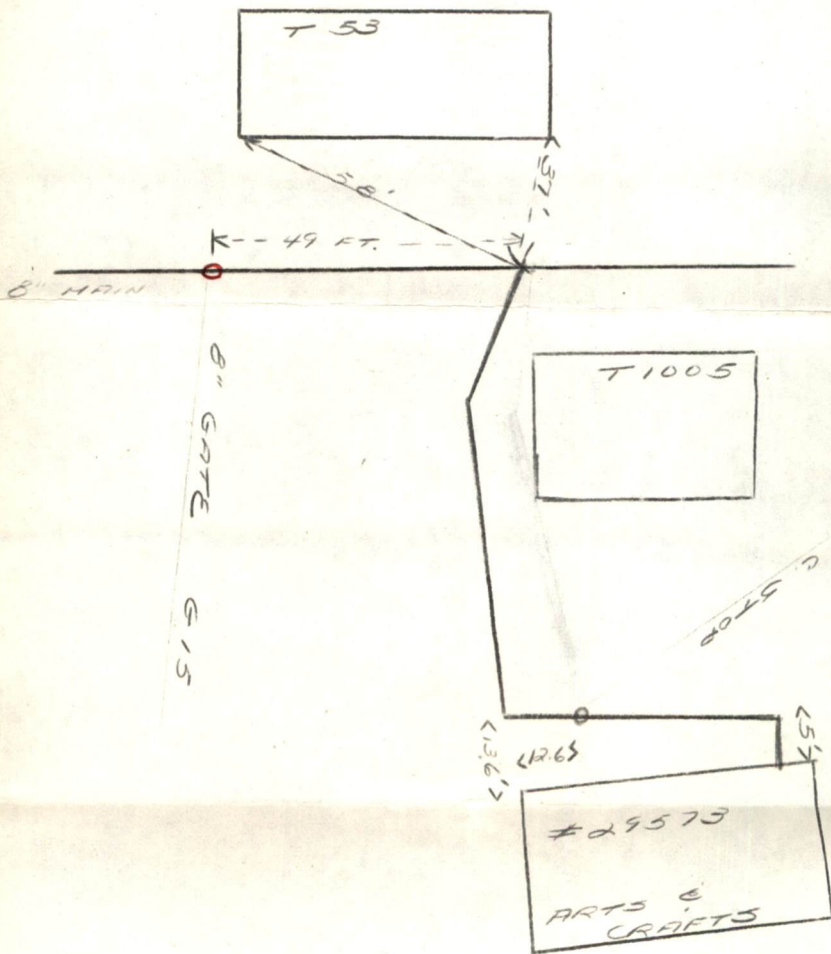


Hand-drawn signature or mark.

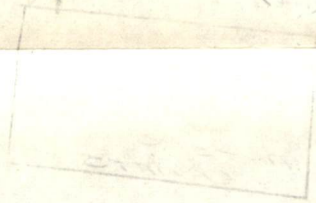

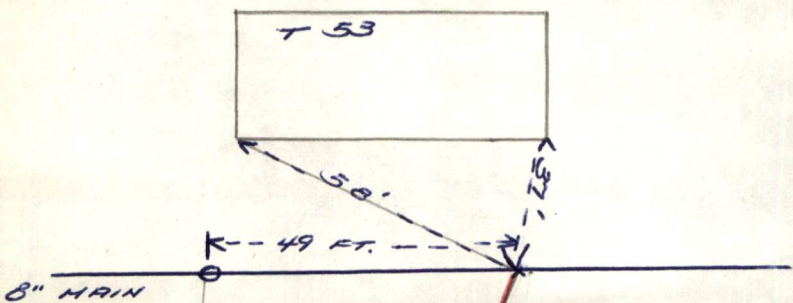

2" C. STOP

13.65
12.65

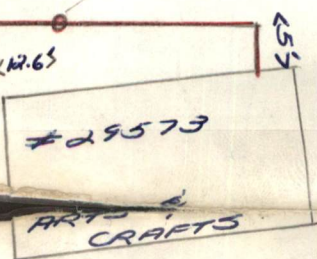

FOR TAP

JP.

h

