

Jonathan Bourne Count.House, New Bedford, Ma.

Tel. 993-1756 November 9, 1979

53

#29823

Sebastian T. Aiello

S.S.Homer's Wharf., E.xMacArthur R

Please install 6" fire supply service to supply commercial bldg. Service from Homer's Wharf. Contractor to do work. (M.Goldberg)

Measures of 6" A.P.Smith Gate Valve:

E x Frontage Road	34.7 ft.
S x N line Homers Wharf	6.3 ft.
W x E line Bldg.	65.3 ft.
S x S line Bldg.	21.9 ft.

Main is


Work done April 21, 1978

- 17.8 Ft. - 6" O.I., O.L. Ductile Pipe (17.8', out.)
- 1 - 8" x 8" x 6" Tee
- 1 - 6" A.P. Smith Gate Valve
- 1 - Gate Box, complete

Contractor supplied & installed all stock

Turn on Charge . . . . . \$ 7.50

JAN LOFT  
BUZG.

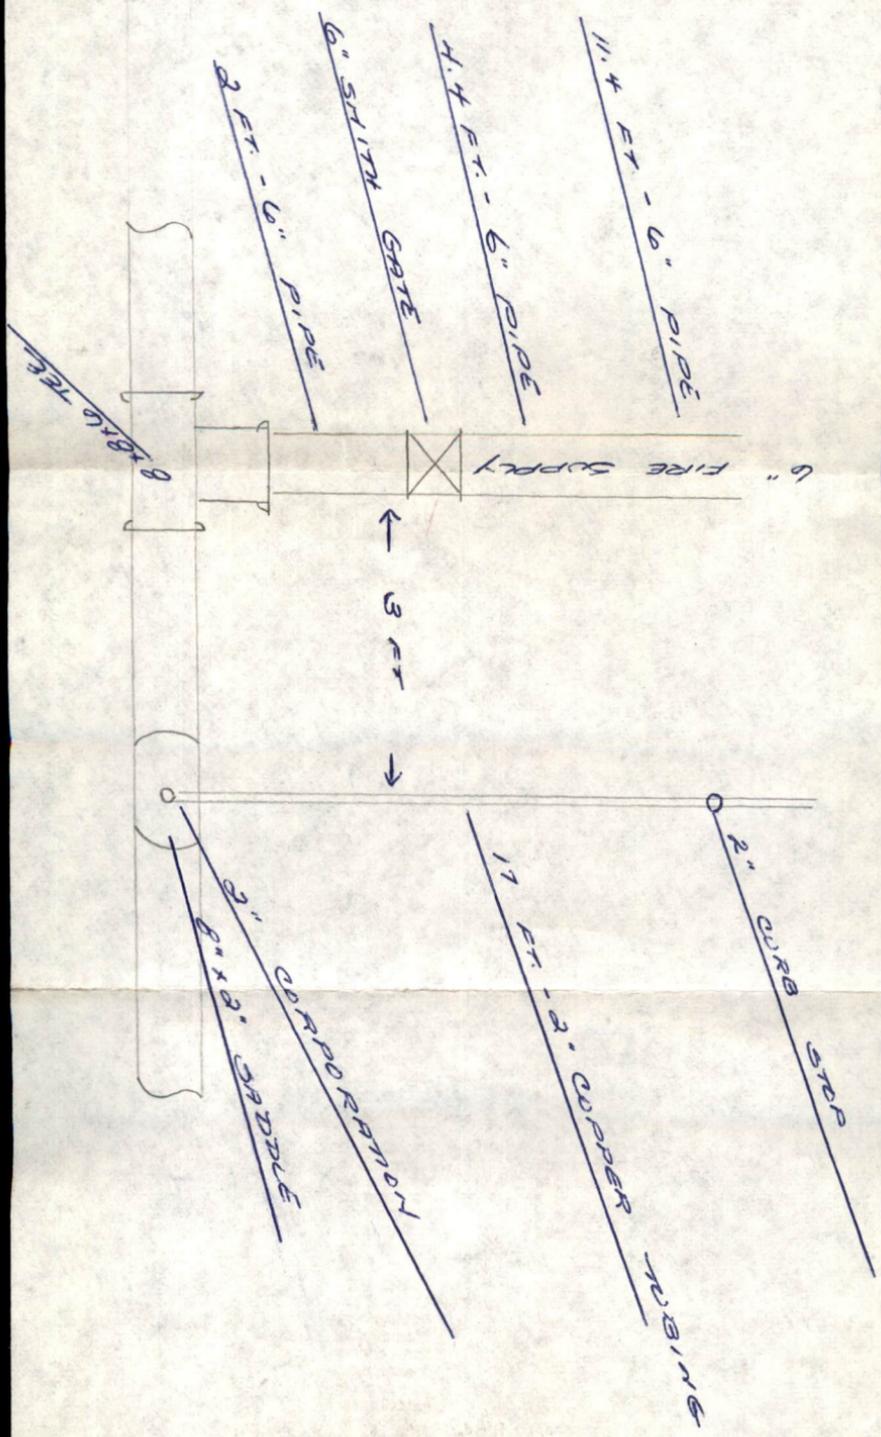

# 29823-6"

