

Tel. 998-2171

C.P. Bourg Inc.

Samuel Barnet Blvd., N.B. 02745

August 18, 1982

133³

S.E. cor. Samuel Barnet Blvd. & J. Vertente Blvd.

#30029 Please install 8" fire supply to supply

mfg. plant. From S. Barnet Blvd. NEW BLDG.

K.R. Resendes to supply material & do work.

Measures of 8" Darl. Tapping Gate Valve:

N x S line Barnet Blvd. 36.0 ft.

N x N line Bldg. 86.0 ft.

W x E line Bldg. 20.2 ft.

E x 16" Gate of John Vertente 237.0 ft.

Main is 30 ft. N x S line.

Work done August 1982

Contractor supplied & installed all stock:

8" Amer. Darling #565 Tapping Gate Valve done
by Sumner & Dunbar of Canton, Mass.

8" C.I.C.L. Tyton Jt. Ductile Pipe cl. 52
Valve located two feet from the main line on
C.P. Bourg side.

No inspector

Turn on charge. \$ 25.00

Contractor dug, backfilled & will maintain
trench.

Water pipe under footing

C.P. BOURG
N.B. IND PARK
BUILDING NO. 2

Roded And Block's

Building
2

4 1/2' min cover

9' MAX COVER

One 16" x 8" Tapen sleeve
one 16" x 4" Tapen sleeve

El. 84.00

Fin Floor

4 1/2'

Cover

Footing

10'

8" 45° Bend's

8" water pipe

25'

3" water pipe

3" 45° Bend's

8" 45° Bend's

3'

16" water main


8" G.V.

4" G.V.

4" to 3" Reducer

4"

3" 45° Bend's

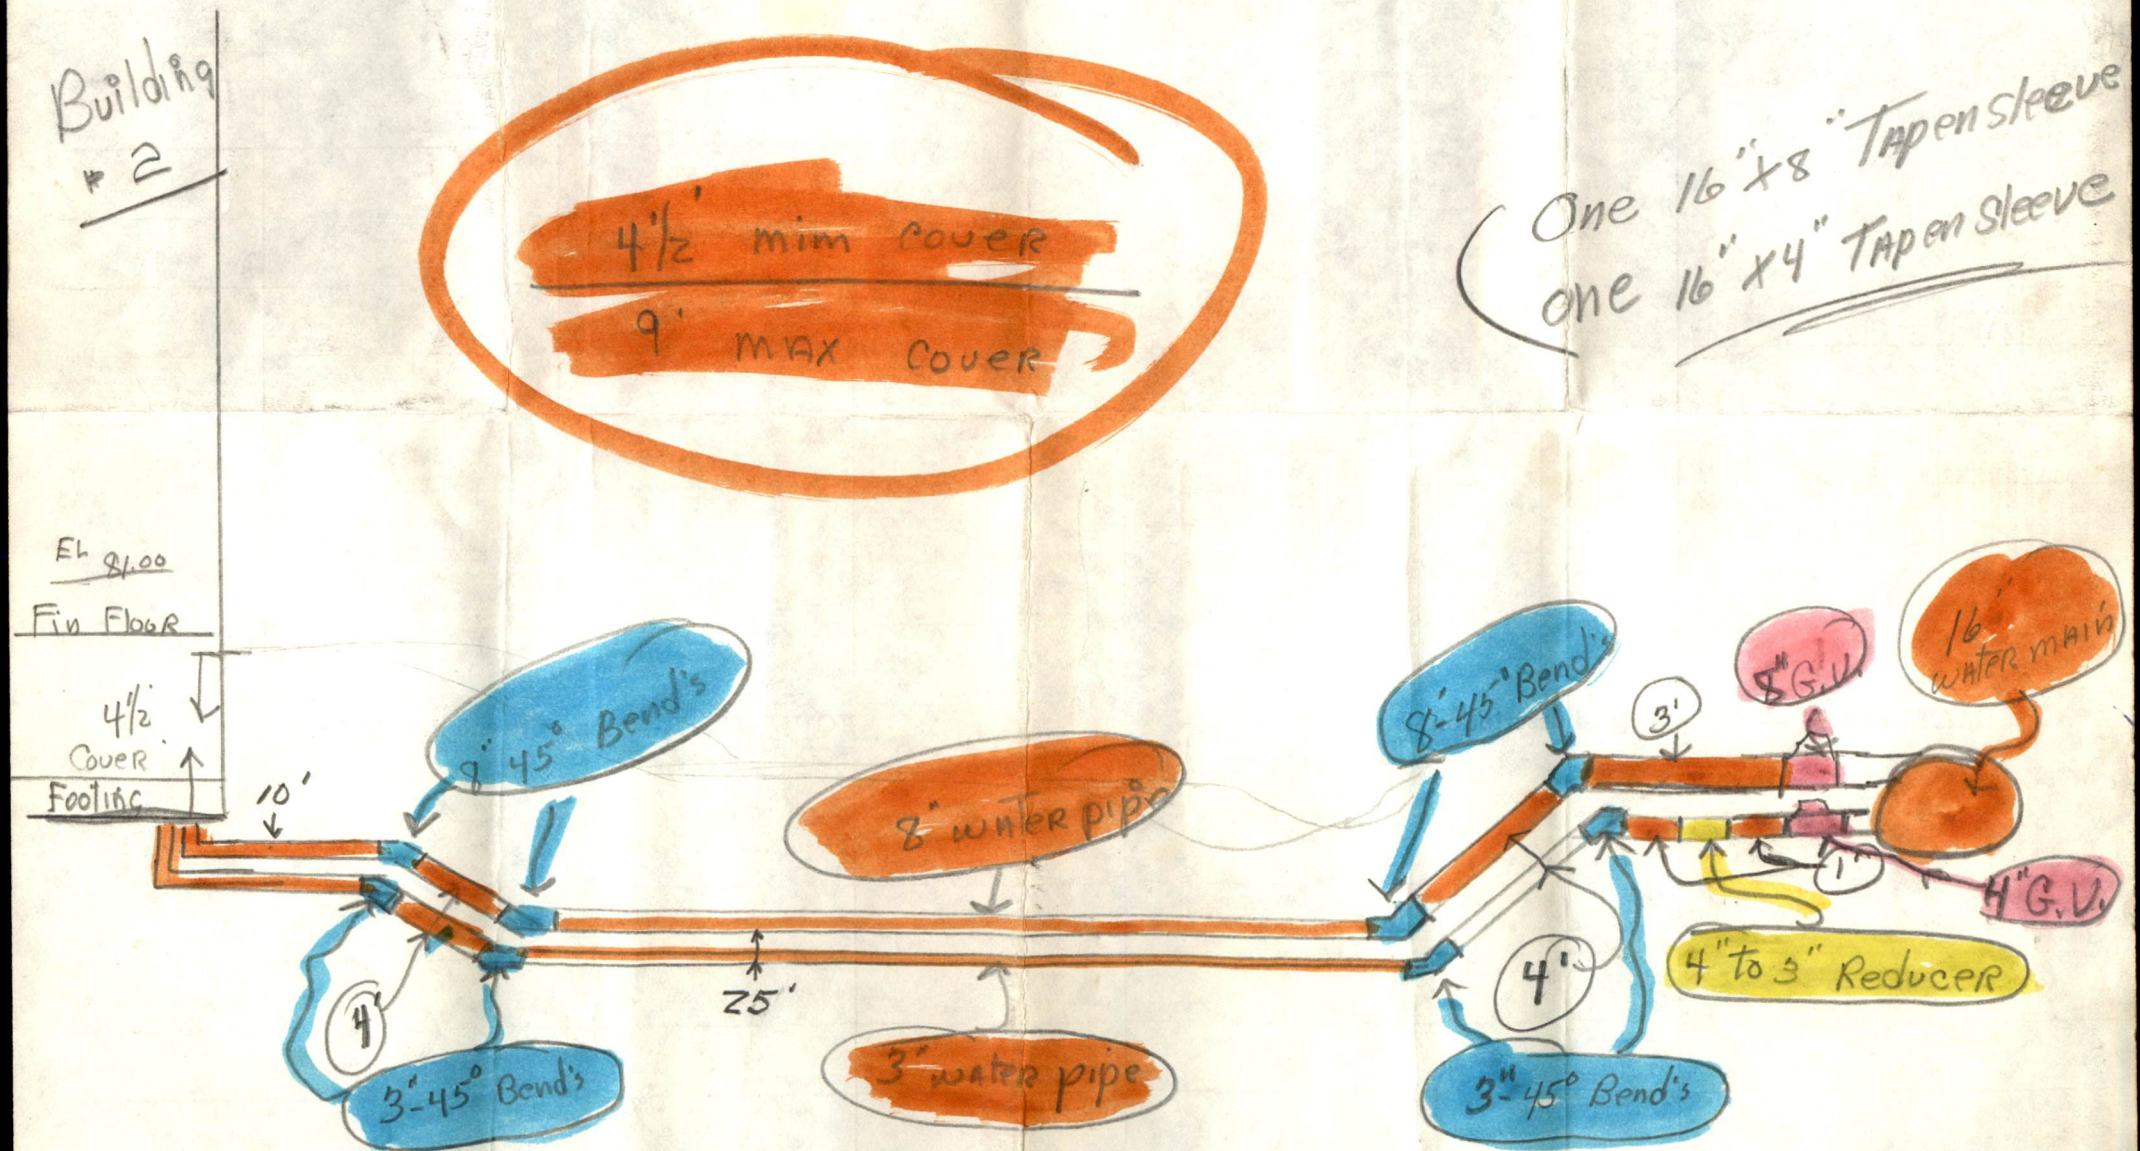

JOB NAME

K. R. REZENDES, INC.

SAMMY'S LANE

ASSONET, MASS. 02702

Weather.....

Date.....

Day of Week.....

Daily Time Record and Cost Distribution

[illegible]