

Tel. 391-5660

Imtra Corp. 151 Mystic Ave. Medford,

Oct. 16, 1987

MA 02155

#30870 S.S. #30 Road B E x Railroad Bldg.

133

Please install 8" CLCI FIRE SUPPLY to supply office
bldg. From Road B. *SAM'L BARNET BLDG.*

Measures of 8" Tapping Gate Valve:

W x W line Duchaine Blvd.

870.0 ft.

E x W line Bldg.

2.0 ft.

N x N line Bldg.

123.6 ft.

Work done Oct. 28, 1987

1½" Service is 1.6 ft. E x fire supply

Contractor supplied all material:

16" x 16" x 8" Smith Tapping Sleeve, M.J.

8" Smith Tapping Gate Valve, M.J.

4 - 8" 1/4 Bend, M.J. (to go under culvert)

Sumner & Dunbar tapped main.

Westport Plumbing hooked up service

Sherry Co. dug, backfilled & will maintain trench.


Insp.....\$ 9.77

Turn on charge.....\$ 25.00

\$ 34.77

30870

Bldg.
Inter
corr.

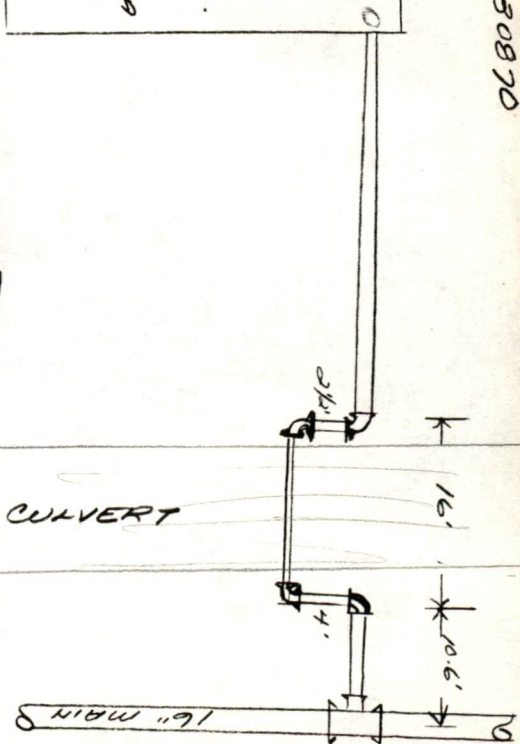

$\frac{1}{2}$

