

Tel. 997-2811

Acushnet Co.

754 Belleville Ave.

12/15/88

by Stuart K. Mills, Jr. N.B. Ma 02745

#31276 S.S. S. Barnet Blvd. W x N.B. city line. 1335

Please install 10" CLCI (Fire Supply) to supply a
mfg. facility. from S. Barnet Blvd. Nota Construction.

Measures of 12" Darling gate valve, Mech.

W x W line J. Vertente Blvd. 1,975.0 ft.

N x S line Barnett Blvd. 30.0 ft.

W x 6th hydrant 90.0 ft.

Work done Dec. 29, 1988

Sumner & Dunbar installed 16" x 12" Tapping sleeve &
12" Darling Tapping gate valve w/#10 Roadway gate box.

Nota Const. dug & will maintain trench.

Inspection.....	\$	10.78
Turn on charge.....	\$	25.00
	\$	35.78

#31276 = 12"

Acushnet Co.

S . S . S . Barnet Blvd. W x N.B. city line

Nota Const. laying 12" F.S. south from 12" tapping gate into property - going under drainage ditch.

Starting at 12" gate valve :

a 18" pc. of 12" Ductile pipe

12" 45° Bend, Mech. going down


3 ft. pc. of 12" ductile pipe


12" 45° Bend going south

2 lengths of 12" Ductile pipe going into property.

M. Rose

1-30-89

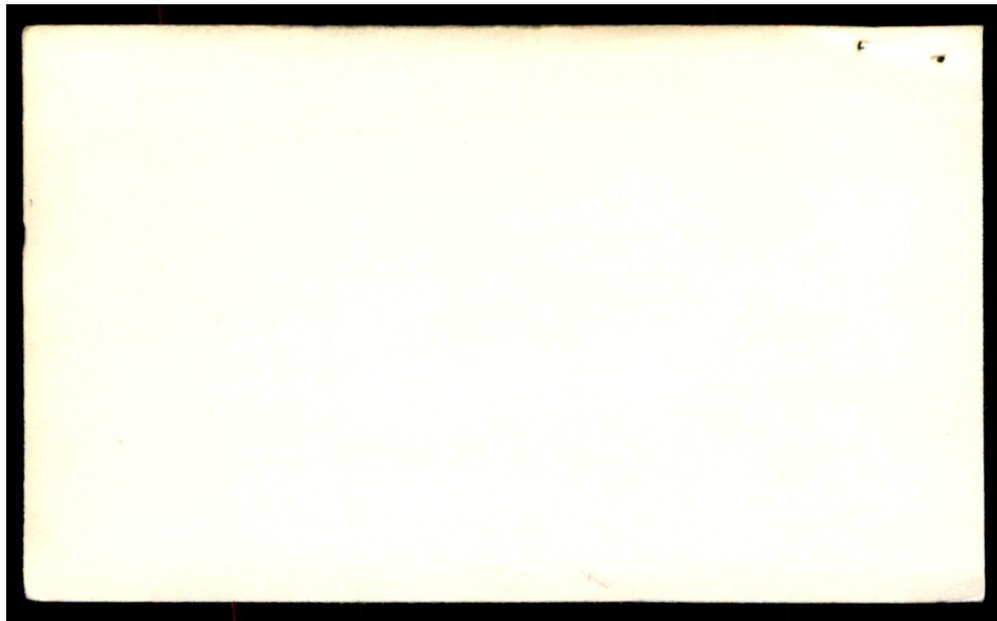

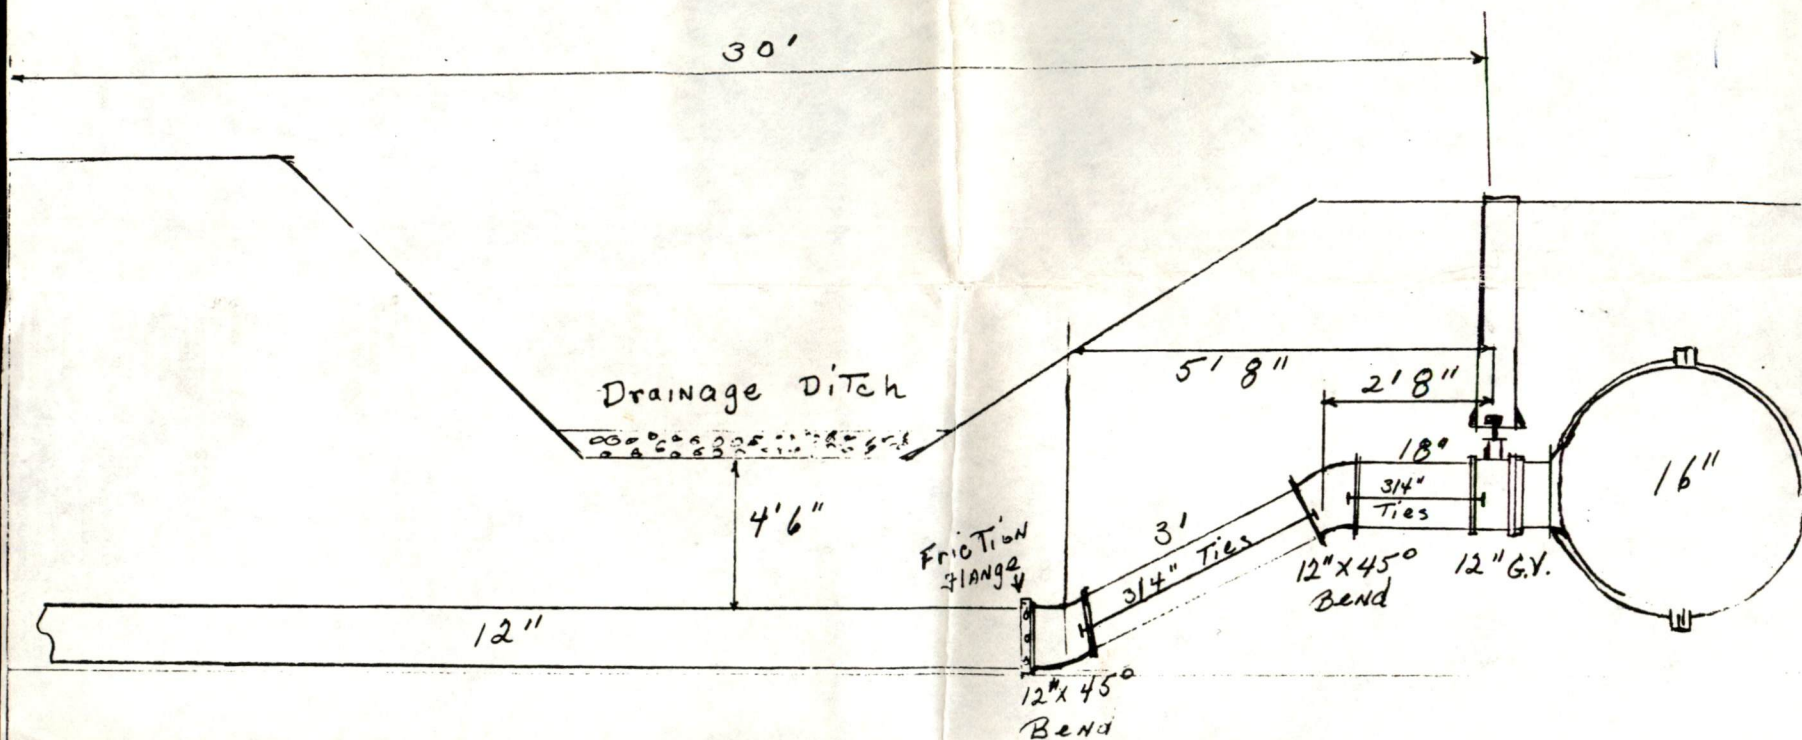

12" Fire Supply Roushnet Co. Ball Plant
 NOTA CONST. JAN. 12, 1988 M. ROSE III

31276-12"