

SERVICE No 32574

NEW BEDFORD WATER WORKS
APPLICATION FOR SERVICE AND METER

NEW BEDFORD

I HEREBY ACKNOWLEDGE the receipt of a copy of the Regulations prescribed in the Ordinance of the City, for the use of Water and I request that the water may be furnished through a

8" inch fire supply meter at 1245 Shawmut Ave

at such rates as may from time to time be established by the City.

I hereby agree to pay promptly the bill for the Service pipe laid down for my premises, and to pay all dues for water, and I agree to conform to the said Regulations and to all provisions of the Water Ordinances, until written notice is given by me or my agent to cut off the supply.

Billed on domestic acct 32573

X ABC Disposal Service, Inc.

X Michael Blom

TELEPHONE X

Service laid

Size and kind of pipe

8"

From

Shawmut Ave

St.

Turned on

Meter Set

Reading


Location

Building rates

Paid

Cost of Service

Paid

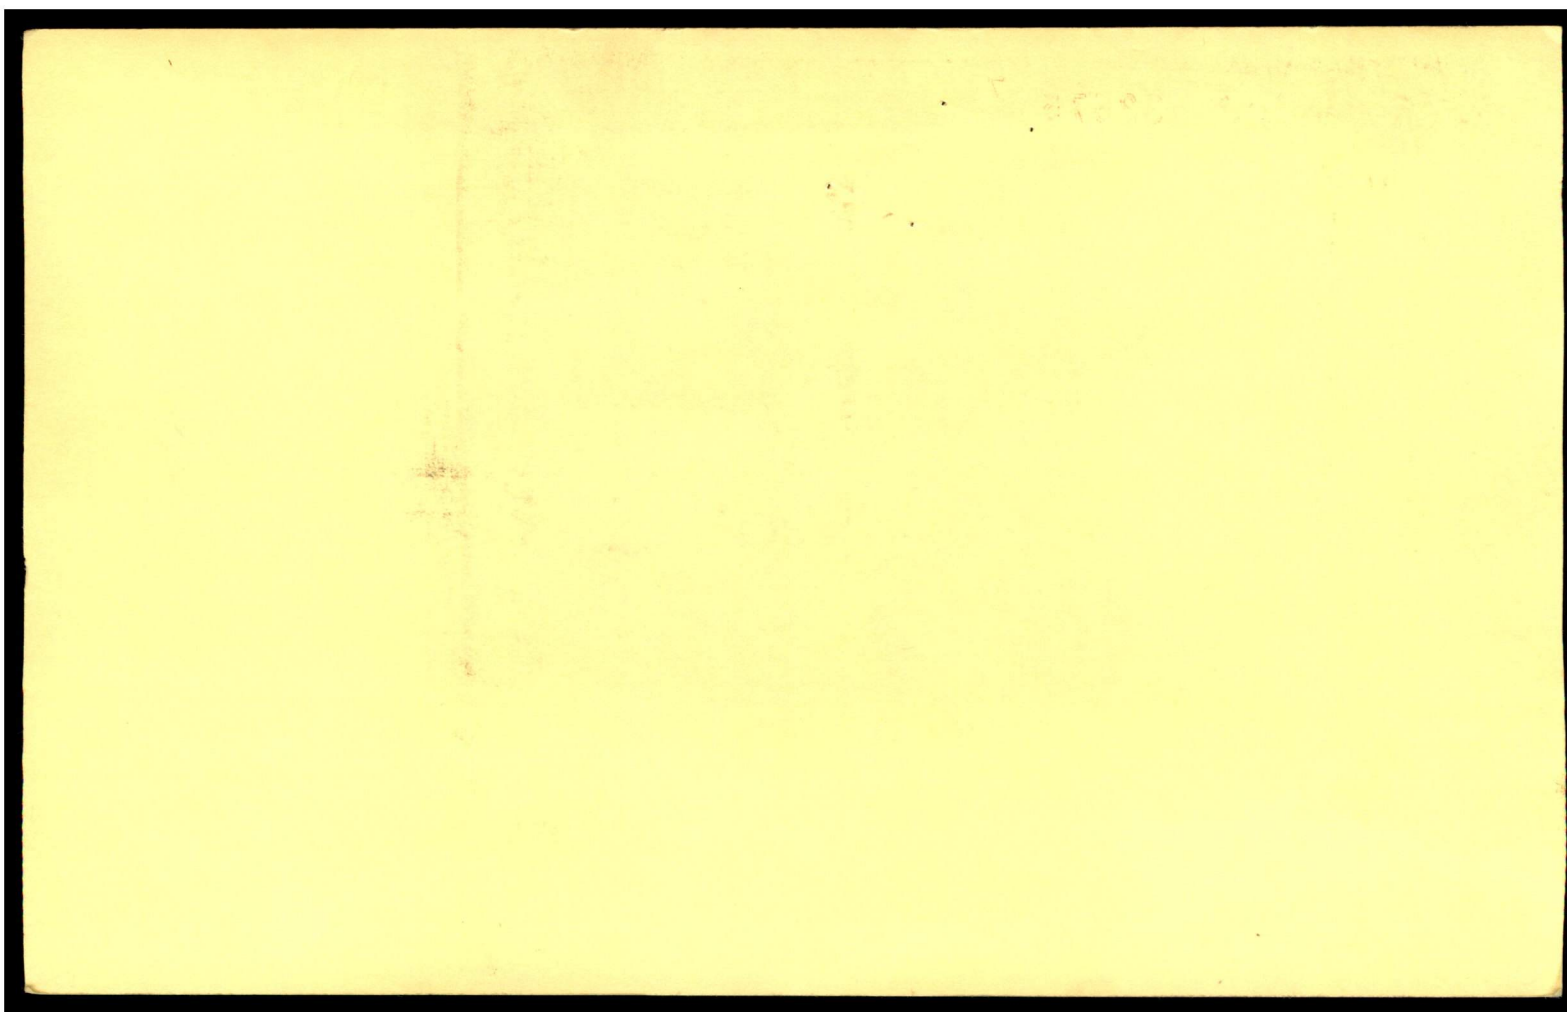

ALL STOCK BY CONTRACTOR

Aug 23, 2001


A.B.C. Disposal

SHAWMUT AVE.

JRD INC. SITE CONTR.
BUFFTREE Bldg.
GEN. CONTR.

CONTR. INSTALLED 12X8" Tapp. SLEEVE + 8" Tapp. GATE Also
INSTALLED A 2" COPPER SERVICE FOR NEW CONST. INSTALLED 75'
OF 8" PIPE + 70' 2" COPPER

MUELLER Hydt. 5 1/4" INSIDE PROP.
Hydt. G.V. W X Hydt. - 6.0'

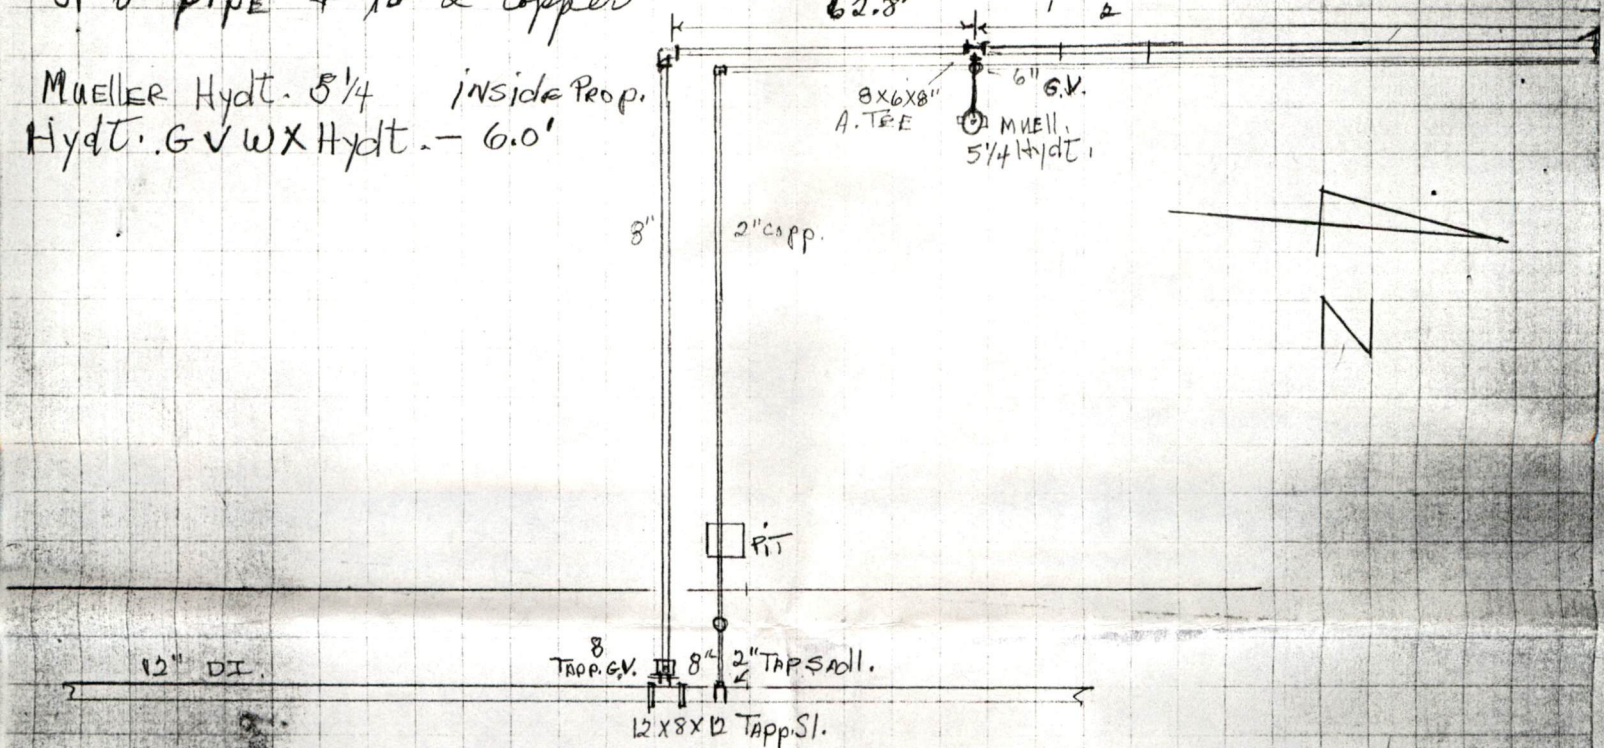

STOCK USED

- 1) 12X8X12" Tapp. SLEEVE MUEL. M.J. ✓
- 1) 8" MUEL. Tapp. GATE VALVE M.J. ✓
- 1) #10 GATE BOX ✓
- 75' 8" DI pipe ✓
- 1) 12X2" Tapp. Sdl. ✓
- 1) 2" Tap ✓
- 1) 2" CURB STOP. ✓
- 70' 2" COPP. ✓

8-27-01


CONTR. INSTALLED OF 8" MAIN + ONE 90° BEND AT A POINT 255' W X W L SHAWMUT AVE. ✓
INSIDE PROPERTY

90° BEND 55'-NXNL EXISTING Bldg. ✓
W X W L Bldg. - 14.0'

MEASURED 8" G.V. F.S.

- NXNL NASH Rd - 1191.0' ✓
- EXWL SHAWMUT AVE. - 15.0' ✓
- NXNL EXISTING Bldg. - 58.0' ✓
- EXFS # 31454 66 FT.
- 2" COPP. SER.
- NXNL NASH Rd. - 1195' ✓
- EXWL SHAWMUT AVE. - 8.6' ✓
- NXNL EXISTING Bldg. - 61.0' ✓
- EX Q/L METER PIT. - 16' ✓
- EXFS # 31454 70 FT.

2" 70'
8" NXFS. 44'

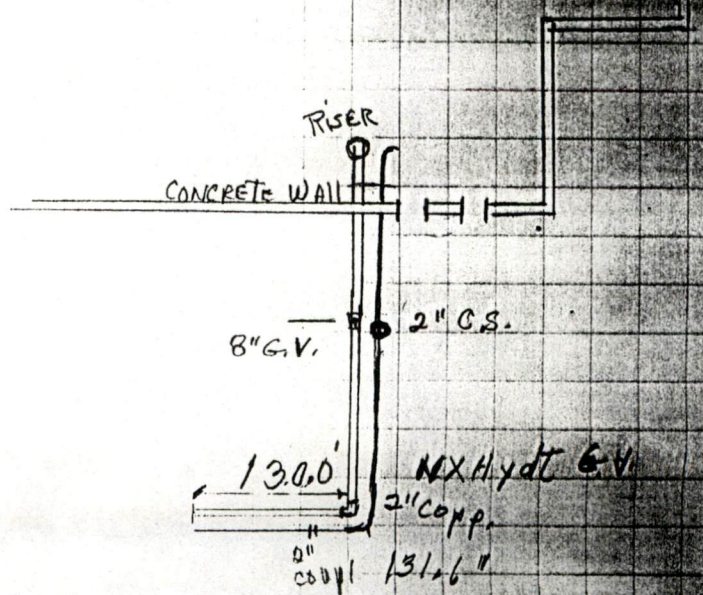

Inside Prop.
 8" G.V. CLOW RES. M.J.
 EXEL Bldg. - 6.0'
 SXNL Bldg. -



2" CS. MUELLER
 EXEL Bldg. - 6.0'
 SXNL Bldg. -

90° BEND
 EXEL Bldg. - 24.5'