

Fire Supply

SERVICE 34076

10-20-3

NEW BEDFORD WATER WORKS
APPLICATION FOR SERVICE AND METER

NEW BEDFORD

Expires 2-4-2021

2-4-2020

I HEREBY ACKNOWLEDGE the receipt of a copy of the Regulations prescribed in the Ordinance of the City, for the use of Water, and I request that the water may be furnished through a

4"

inch

DI

meter at

1256

Acushnet Ave

(FKA)

Coming off Holly St side (Cafe Europa)

at such rates as may from time to time be established by the City.

I hereby agree to pay promptly the bill for the Service pipe laid down for my premises, and to pay all dues for water, and I agree to conform to the said Regulations and to all provisions of the Water Ordinances, until written notice is given by me or my agent to cut off the supply.

P. 93

2. 11.

TELEPHONE

508 997 1087

Cafe Europa

1256 Acushnet Ave
NB MA 02745

Service laid

Size and kind of pipe

From

contractor

St.

Turned on

JTC Construction

Meter Set

Reading

Location

Building rates

Paid

Cost of Service

\$465 chkd 1780.

Paid

31-727



4" FS

(new Fire Supply)

E x E	Line Acushnet Ave.	59.0
N x S	Line Holly St.	13.7
E x W	Line building	58.0
W x E	Line building	7.0
N x N	Line building	13.7
Main to Property Line		18.0
Pipe inside Property		3.0

2/21/2020 - Inspection by Percy Reynolds

Contractor - JLC

DISPLAY PERMIT IN A CONSPICUOUS PLACE ON THE PREMISES



Commonwealth of Massachusetts

City of New Bedford

133 William Street New Bedford, MA 02740

WATER SERVICE PERMIT



Date: 2/28/2020

No. **W-20-3**

Permit Fee: \$465.00

Service Location: 1238- ACUSHNET AVE

Owner Name: FERREIRA PEDRO M

Owner Phone #: (508) 997-1087

Type of Occupancy: Commercial

Type of Work: Water - Fire Supply New 4"

Work Description: water service#34076
new 4" Fire Supply

coming from Holly St Side--

expires 02/04/2021

Contractor

Name: DEMETRI COSTA Certificate #: 076355 Type of Business: Hoisting

Address: 415 LAKE RD City/Town/State: TIVERTON RI Phone #: (508) 326-

Type of Service Pipe Size Trench Length: 0.00

Fire Service

Domestic Service

Estimated consumption of water

Estimated average daily consumption 0.00 gallons

Cross Connection? **No**

Estimated maximum day consumption 0.00 gallons

Right of Way? **No**

Are lawn sprinklers and/or lawn irrigation proposed on site? **No**

Meter Impact? **No**

Estimated fire flows required for the project site: 0.00

Street Opening Permit Required? **No**

Does the project require a fire suppression system? **No**

Required minimum static pressure for the proposed project site 0.00

Call Phone: (781) 942-9077 For Inspection

DISPLAY PERMIT IN A CONSPICUOUS PLACE ON THE PREMISES



Commonwealth of Massachusetts

City of New Bedford

133 William Street New Bedford, MA 02740



WATER SERVICE PERMIT GRANTED WITH THE USUAL CONDITIONS

COMMISSIONER

Call Phone: (781) 942-9077 For Inspection



Department of Public Infrastructure

Jamie Ponte
Commissioner

Water
Wastewater
Highways
Engineering
Cemeteries
Park Maintenance
Forestry
Energy

CITY OF NEW BEDFORD

Jonathan F. Mitchell, Mayor

To Whom It May Concern:

I Pedro Ferreira 1256 Acushnet Ave NB, being
(Name) (Mailing Address)

Owner of property located at
1256 Acushnet Ave New Bedford MA

Plot 93, Lot 11, hereby agree to allow JLC Construction
(Name)

_____, to act on my behalf including affixing my
(Mailing Address)

signature in securing permit for: Pedro FERREIRA


☐ Sewer/Drain Service Permits
☒ Water Service Permits
☐ Driveway Installation Permits
☐ Sidewalk Installation Permits

I further agree to conform to, and abide by, All City rules and ask regulations applicable to the permit (s) being applied for:


Name Pedro FERREIRA
Signature

Address

Date Telephone Number

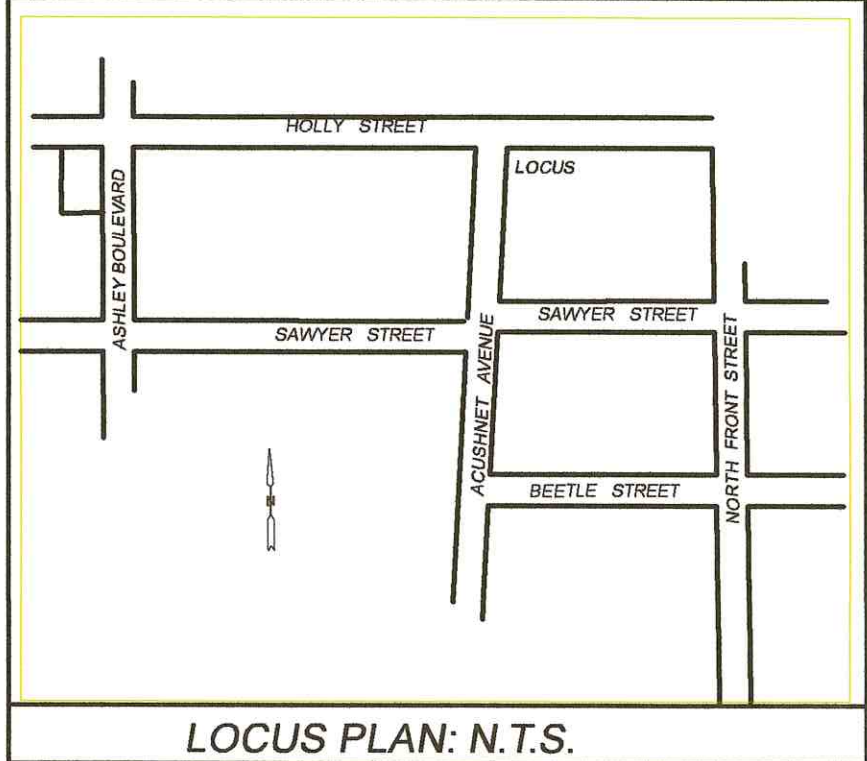


NOTES:
CONCRETE THRUST BLOCK TO BE USED ONLY WHERE IT WILL BEAR ON UNDISTURBED EARTH.
USE RESTRAINED JOINT FITTINGS (MEGALUG OR APPROVED EQUAL) WHERE CONCRETE THRUST BLOCK IS UNACCEPTABLE.
SIZE OF BLOCK OR MEGALUG TO BE DESIGNED FOR SPECIFIC CONDITIONS
*** WATER TAP NOTE: CONTRACTOR TO NOTIFY D.P.I. OF TIME AND DATE OF PIPE EXPOSURE AND COORDINATE ANY REQUIRED INSPECTIONS. CONTRACTOR TO EXPOSE MAIN AND CONFIRM SEEVE SIZE AND FIT W/ INSPECTOR (IF REQUIRED) PRIOR TO TAPPING.

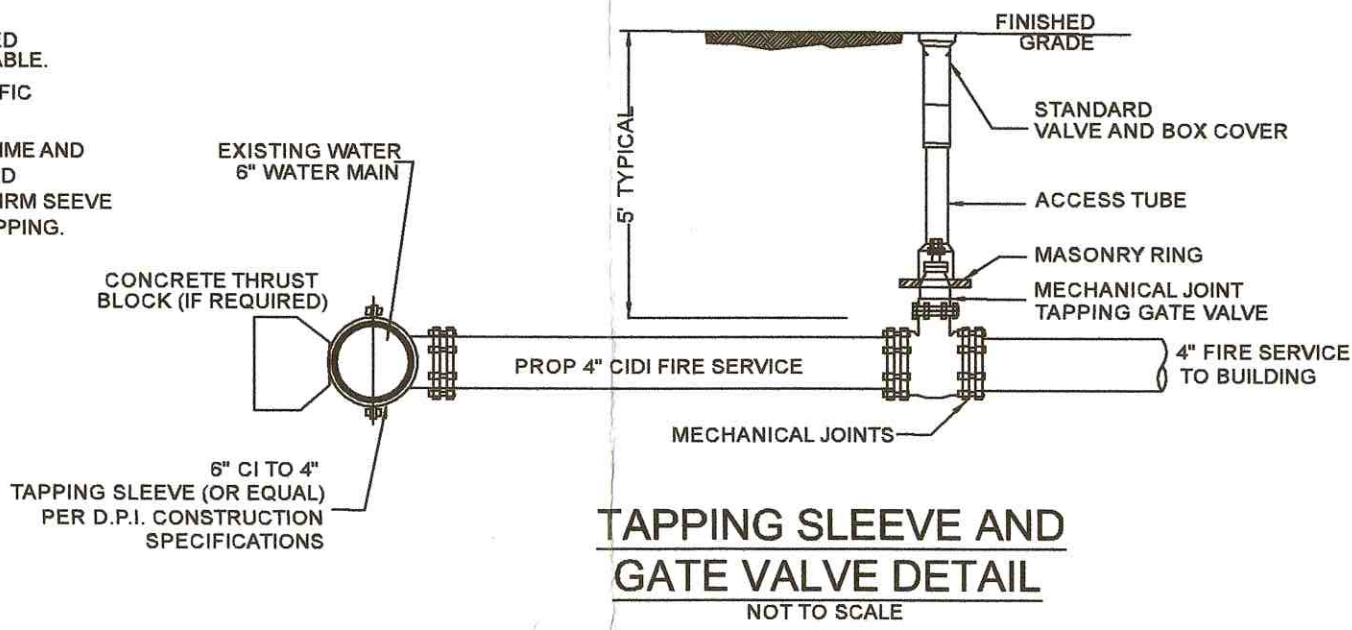

GENERAL NOTES

1. SITE IS SHOWN AS LOTS 11 ON NEW BEDFORD ASSESSORS MAP 93.
2. EXISTING UTILITIES SHOWN HAVE BEEN TAKEN FROM RECORD DRAWINGS AND FROM SURFACE EVIDENCE OBTAINED BY ON-THE-GROUND SURVEY. NO REPRESENTATION AS TO THE ACCURACY OR COMPLETENESS OF THE UTILITIES SHOWN IS MADE BY THE SURVEYOR/ENGINEER. VERIFICATION OF UTILITIES AND LOCATIONS ARE THE RESPONSIBILITY OF THE CONTRACTOR WITH THE AID OF DIG SAFE AND OTHER RESPECTIVE UTILITY COMPANIES.
3. ALL CONSTRUCTION MATERIALS AND INSTALLATION METHODS TO CONFORM TO THE CITY OF NEW BEDFORD DEPARTMENT OF PUBLIC INFRASTRUCTURE SPECIFICATIONS AND THE COMMONWEALTH OF MASSACHUSETTS DEPARTMENT OF PUBLIC WORKS CONSTRUCTION STANDARDS, AS MOST RECENTLY AMENDED.
4. CONTRACTOR SHALL KEEP RECORDS OF LOCATIONS FOR ALL UNDERGROUND UTILITIES INSTALLED FOR USE IN COMPILING AN AS-BUILT SITE PLAN.
5. CONTRACTOR TO VERIFY AND CHECK LOCATION AND ELEVATIONS (IF ANY) AS SHOWN ON THIS PLAN PRIOR TO CONSTRUCTION. CONTRACTOR SHALL BE RESPONSIBLE FOR ANY AND ALL PERMITS AS MAY BE REQUIRED. CONTRACTOR ALSO REQUIRED TO PAY ALL PERMITS AND FEES ASSOCIATED WITH COMPLETION OF THE WORK.
6. ANY LAWN AREA DISTURBED DURING CONSTRUCTION TO BE LOAM AND SEEDED AFTER PROPER BACKFILLING SEE DETAIL. ALL TRENCHES WITH IN THE EXISTING PAVEMENT TO BE REPAIRED AS PER DETAIL AND CITY D.P.I. REQUIREMENTS FOR TRENCHES WITHIN STREET.
7. LOCUS IS CURRENTLY SERVICED BY MUNICIPAL WATER AND SEWER.
8. CONTRACTOR IS TO COORDINATE WITH THE PLUMBER AND BE SURE ALL INTERIOR PLUMBING FOR THE NEW FIRE SERVICE LINE IS RELOCATED AND CONNECTED. CONTRACTOR SHALL GET WRITTEN APPROVAL FROM D.P.I. PRIOR TO START AND FOR ANY FIELD CHANGES.
9. PROPOSED 4" UNDERGROUND FIRE SERVICE TO BE INSTALLED 60" (48" MIN.) BELOW GRADE (BELOW THE FROST LINE).
10. REFER TO FIRE SPRINKLER SYSTEM SIZE, NOTES AND DETAILS AS DESIGNED BY ALLIED FIRE PROTECTION INC., AS SUPPLIED TO THIS OFFICE.

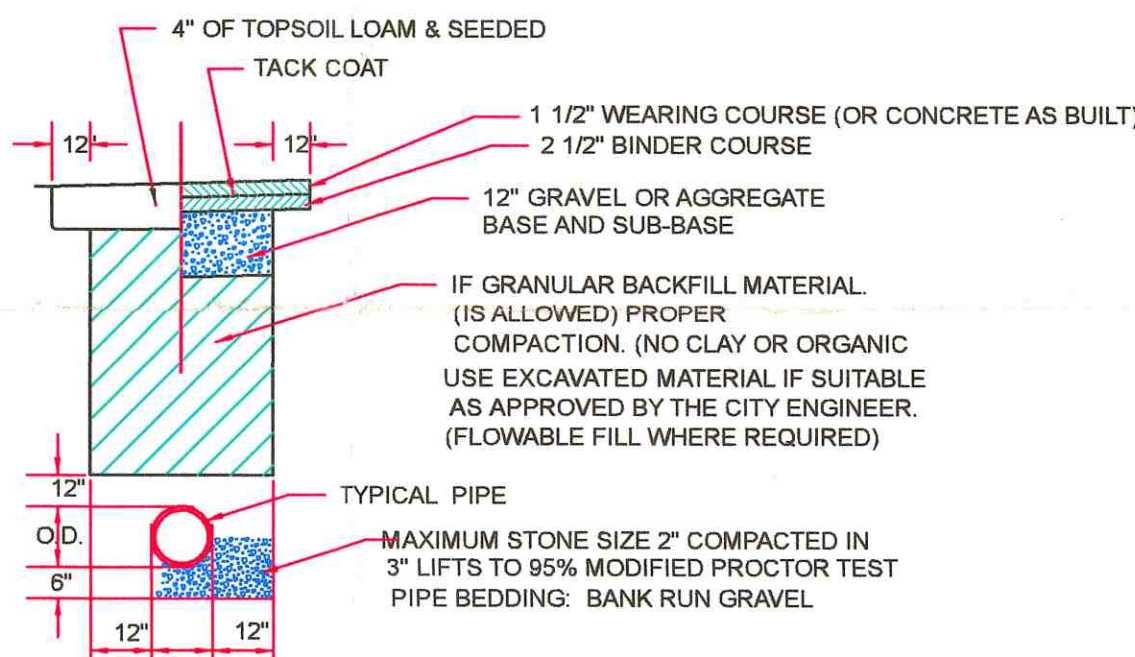

OWNER/APPLICANT:
PEDRO M. FERREIRA
1256 ACUSHNET AVE
NEW BEDFORD, MA 02746

TYPICAL TRENCH DETAILS
(NOT TO SCALE)

FIRE SERVICE LOCATION PLAN

CAFE EUROPA

1256 ACUSHNET AVENUE
ASSESSORS MAP 93, LOT 11
NEW BEDFORD, MA



ENGINEERING, LLC
P.O. BOX 1338
WESTPORT, MASSACHUSETTS 02790
(774) 319 - 5305



DATE	REVISION	BY
DATE: 1/17/2020	DESIGNED BY:	
SCALE: 1" = 20'	CHECKED BY:	
DRAWN BY: KJS	JOB No: 20-001	

