

APPLICATION No.: 10011

TAP CLEARED

LOCATION: 200 Hathaway St

OWNER: _____

31-313

MEASURES: 06/25/2018

Lead Service Line Replacement Program

1" Copper Service

Phase 1, Contractor P Gioioso & Son

Type CU, Diameter 1in, Water pressure 70

Distance from main to curb stop (ft) N/A

Distance from curb stop to meter (ft) 16.0

15.0 ft to house 1 ft wall

Distance from curb face to curb stop (ft) 2.0

Depth of service (ft) 3.7

Total length of new pipe installed (ft) 19.0

16.0 ft + 3 ft whip

Curb stop replaced: no

Corporation replaced: no

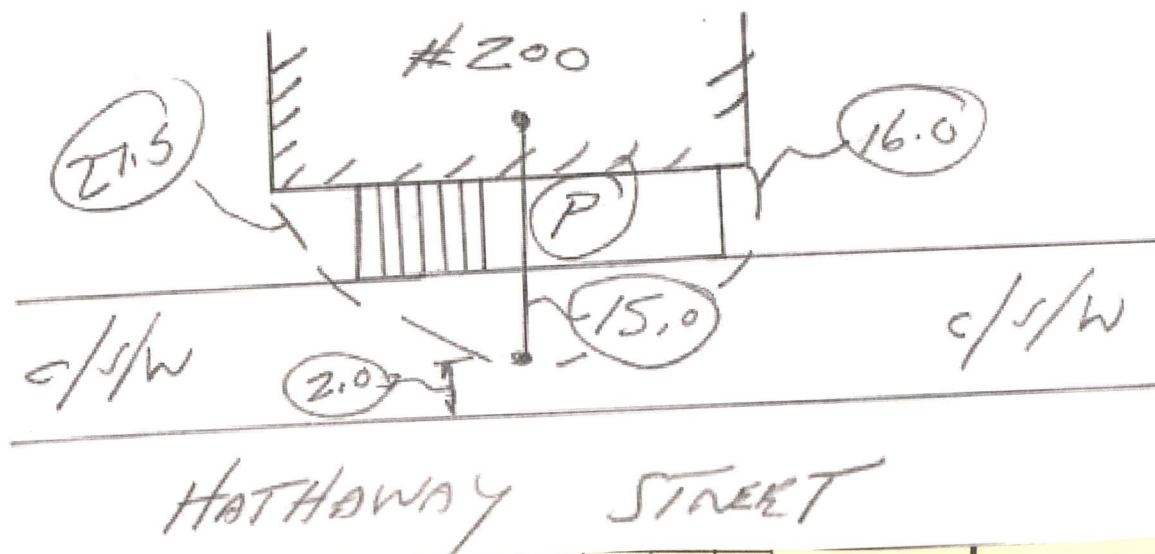
Ball valve furnished: yes size 1"

DATE

BEF.

AFT.

REMARKS

[illegible]

APPLICATION No.: 10011

TAP CLEARED

8446-15071

LOCATION: 200 Hathaway

OWNER: Ada M. Shaw Wilfred Harris

MEASURES:

5/8"

E from Cherch St. 320.6 ft.

N from S line Hathaway St. 9.2 ft.

E from W line house 2.4 ft.

Dec. 18, 1968 Renewed from $\frac{1}{2}$ ' outside curb stop to the property line
11 ft. of $\frac{3}{4}$ " copper tubing 3/4" Mueller Curb Stop
2 wipe joints. Buffalo stop box, complete

Sept. 25, 1963 Renewed with 10 ft. $\frac{3}{4}$ " copper tubing inside line
10 ft. $\frac{3}{4}$ " copper tubing

Nov. 15, 1984: Renewed from main to curb stop.
Stock: 17 ft. $\frac{3}{4}$ " curb stop 1 Caldwell stop box
1 $\frac{3}{4}$ x $\frac{3}{4}$ cop to cop coplg comp 1 $\frac{3}{4}$ x $\frac{5}{8}$ Fig. 413

[illegible]

CHARGE OUTS

[illegible]