

APPLICATION No.: 10518

TAP CLEARED

LOCATION: 104 - 106 Cove St

OWNER: ✓

31-313

MEASURES: July 28, 1903

W X McGurk St 29.2 ft

N X S line Cove St 9.4 ft

E X W line House 4.0 ft

1" Copper Service

3/25/2019 Lead Service Line Replacement Program

Phase 1, Contractor P. Gioioso & Sons

Type CU, Diameter (in) 1, Water pressure 100

Distance from main to curb stop (ft) 8

Distance curb stop to meter (ft) 14.3

Distance curb face to curb stop (ft) 1.8

Depth of service (ft) 3.7

Total length of new pipe installed (ft) 14.3

Curb stop replaced: no, size 3/4"

Corporation replaced: no, size 3/4"

Ball valve furnished: yes, size 1"

Remarks: 1-3/4" union installed 1 ft outside curb stop

DATE

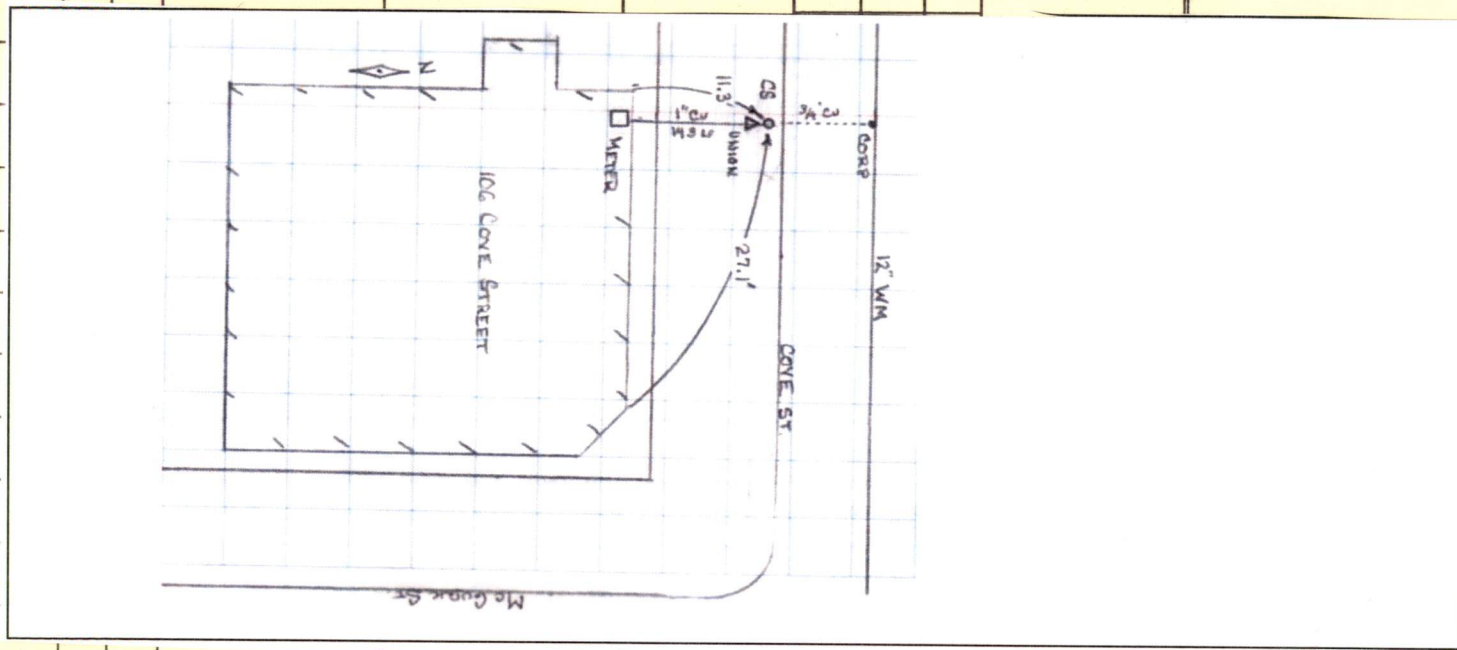
BEF.

AFT.

REMARKS

[illegible]

CHARGE OUTS

[illegible]