

APPLICATION No.: 10759

TAP CLEARED

LOCATION: 126 Holly St

OWNER:

31-313

MEASURES: W X Ashley Blvd 80.4 ft
N X S Line Holly St 7.8 ft
W X E Line House 11.2 ft

1" Copper Service

05/22/2018 Lead Service Line Replacement Program

Phase 1, Contractor P Gioioso & Son

Type CU, Diameter 1in, Water pressure 70

Distance from main to curb stop (ft) 12.0

Distance curb stop to meter (ft) 17.2

Distance from curb face to curb stop (ft) 3.0

Depth of service (ft) 3.7

Total length of new pipe installed (ft) 17.2

Curb stop replaced: no size 3/4"

Corporation replaced: no size 3/4"

Ball valve furnished: yes size 1"

Remarks: 3/4" to 1" union installed 1.0 LF outside curb stop

DATE

BEF.

AFT.

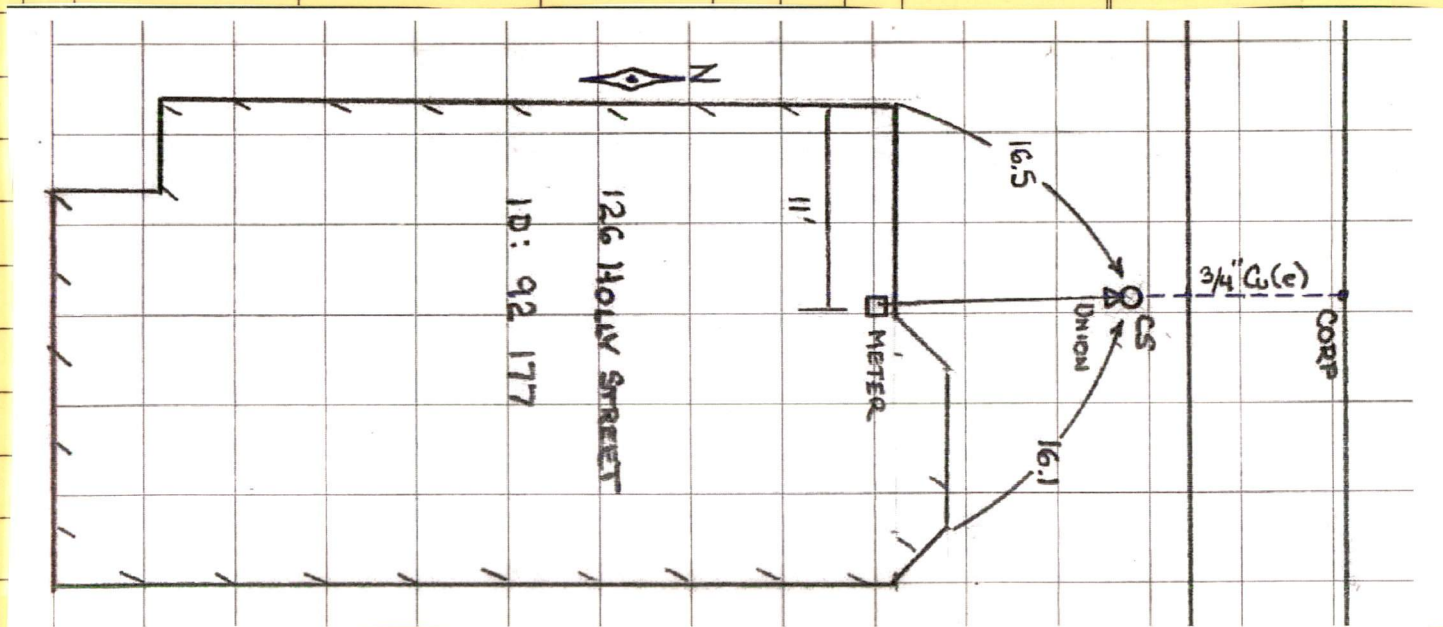
REMARKS

10/12/01

10/15/01

[illegible][illegible]

CHARGE OUTS

[illegible]