

V

APPLICATION No.: 10817

TAP CLEARED

LOCATION: 128 Hathaway St

DATE

BEF.

AFT.

REMARKS

OWNER:

31-313

MEASURES: 1" Copper Service

06/18/2018 Lead Service Line Replacement Program

Phase 1, Contractor P Gioioso & Son

Type CU, Diameter 1in, Water pressure 70

Distance from main to curb stop (ft) 11.5

Distance from curb stop to meter (ft) N/A

Distance from curb face to curb stop (ft) 1.5

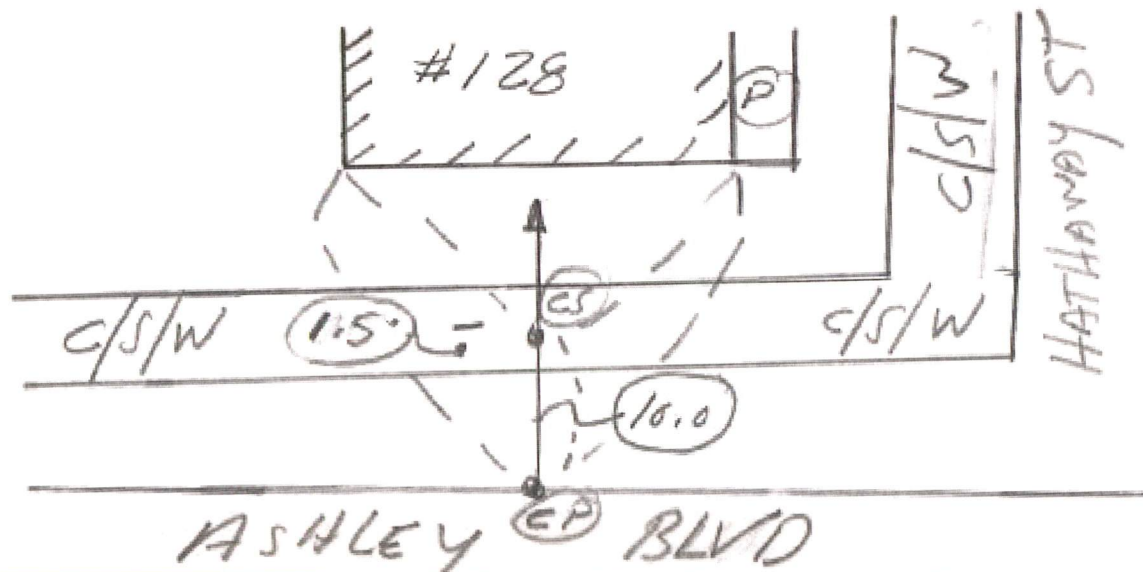
Depth of service (ft) 3.2

Total length of new pipe installed (ft) 11.5

Curb stop replaced: yes size 1"

Corporation replaced: yes size 1"

Ball valve furnished: no, size 3/4"

[illegible]

APPLICATION No.: 10817

TAP CLEARED 9049-0056

LOCATION: 128 Hathaway

OWNER: Geo Myers E. Fahey

MEASURES: S from Hathaway St. 31.3 ft.
E from W line ~~Bowditch St.~~ ^{ASHLEY BLVD.} 9.3 ft.
N from S line hous3 10.1 ft.

Mar. 11, 1970 Renewed from $\frac{1}{2}$ ft. outside to property line
10 $\frac{1}{2}$ ft. copper tubing 3/4" curb stop
2- wipe joints

April 14, 1970 Renewed from main to curb stop
8 ft. - 3/4" copper tubing 3/4" x 3/4" Hays corp. Cplg.

12/3/90: Renewed from prop line to ins. cellar
8 ft. ins. prop line Stock: 8ft. 3/4" copper tubing
1- 3/4x3/4 cop-cop cplg.==comp.=====

[illegible]

CHARGE OUTS

[illegible]