

APPLICATION No.: 11400

## TAP CLEARED

LOCATION: 616 South Second St.

OWNER:

31-313

May 16, 1906

MEASURES:

N X Cove St

78.0 ft

W X E Line Second St

9.0 ft

N X S Line House

13.3

1" Copper Service

01/09/2019 Lead Service Line Replacement Program

Phase 1, Contractor P Gioioso &amp; Son

Type CU, Diameter 1in, Water pressure 100

Distance from main to curb stop (Ft) 23

Distance curb stop to meter (Ft) 21.5

Distance from curb face to curb stop (Ft) 1

Depth of service (ft) 4.5

Total length of new pipe installed (ft) 44.5

Curb stop replaced: Yes size 1"

Corporation replaced: yes size 1"

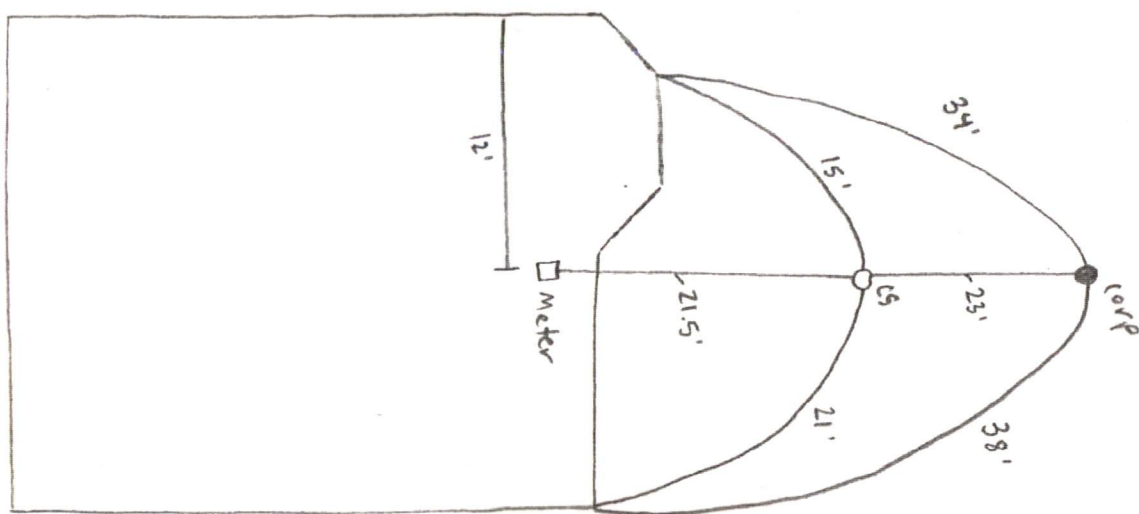
Ball valve replaced: yes size 1"

DATE

BEF.

AFT.

REMARKS

[illegible][illegible][illegible]