

APPLICATION No.: 11413

TAP CLEARED

LOCATION: 91 Jouvette St.

DATE

BEF.

AFT.

REMARKS

OWNER: James P. Cunha Et UxMEASURES: 1/2"

H lead

June 6, 1906

E from

Crapo St.

180.0 ft.

S from N line

Jouvette St.

9.0 ft.

E from W line

house

10.0 ft.

✓ Oct. 1, 1951 Renewed from curb stop to 1 ft. inside property line.

10 ft. - 3/4" Copper tubing 3/4" cop to cop stop

- - -

✓ Nov. 16, 1954 Renewed from property line to inside cellar.

7 ft. - 3/4" Copper tubing

1" Copper Service

- - -

07/29/2019 Lead Service Replacement Program

Phase 1, Contractor P Gioioso & Son

Type CU, Diameter 1in, Water pressure 100

Distance from main to curb stop (ft) 22

Distance from curb stop to meter (ft) N/A

Distance from curb face to curb stop (ft) 1.5

Depth of service (ft) 4.5

Total length of new pipe installed (ft) 22


Curb stop replaced: Yes size 1"

Corporation replaced: Yes size 1"

Ball valve replaced: no

METER HISTORY

DATE	SET OUT	SIZE	MAKE	NUMBER	READING	TEST			REMARKS
10-4-51		5/8	Hersey D	1750048					

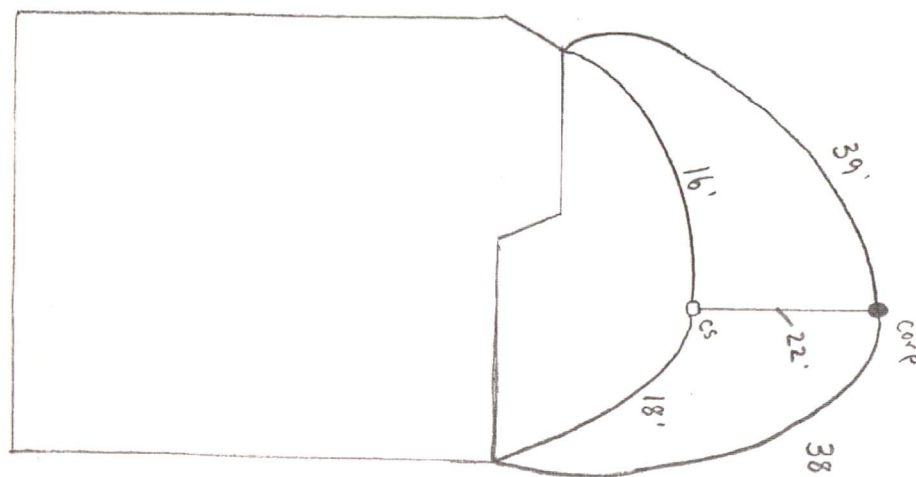

CHARGE OUTS