

APPLICATION No.: 11489

## TAP CLEARED

LOCATION: 41 Covell St

DATE

BEF.

AFT.

REMARKS

OWNER: 1

31-313

## MEASURES:

W X Belleville Ave 415.7 ft

S X N line Covell St 9.1 ft

E X W line House 13.2 ft

1" Copper Service

5/8/2019 Lead Service Line Replacement Program

Phase 1, Contractor P. Gioioso &amp; Son

Type CU, Diameter (in) 1, Water Pressure 90

Distance from main to curb stop (ft) 25.7

Distance curb stop to meter (ft) 16

Distance from curb face to curb stop (ft) 2.0

Depth of service (ft) 3.7

Total length of new pipe installed (ft) 25.7


Curb stop replaced: yes, size 1"

Corporation replace: yes 1"

Ball valve replaced: no, size 3/4"

Remarks: 1-3/4" union installed 1 ft outside curb stop

DATE	SET OUT	SIZE	MAKE	NUMBER	READING	TEST			REMARKS
	ies								

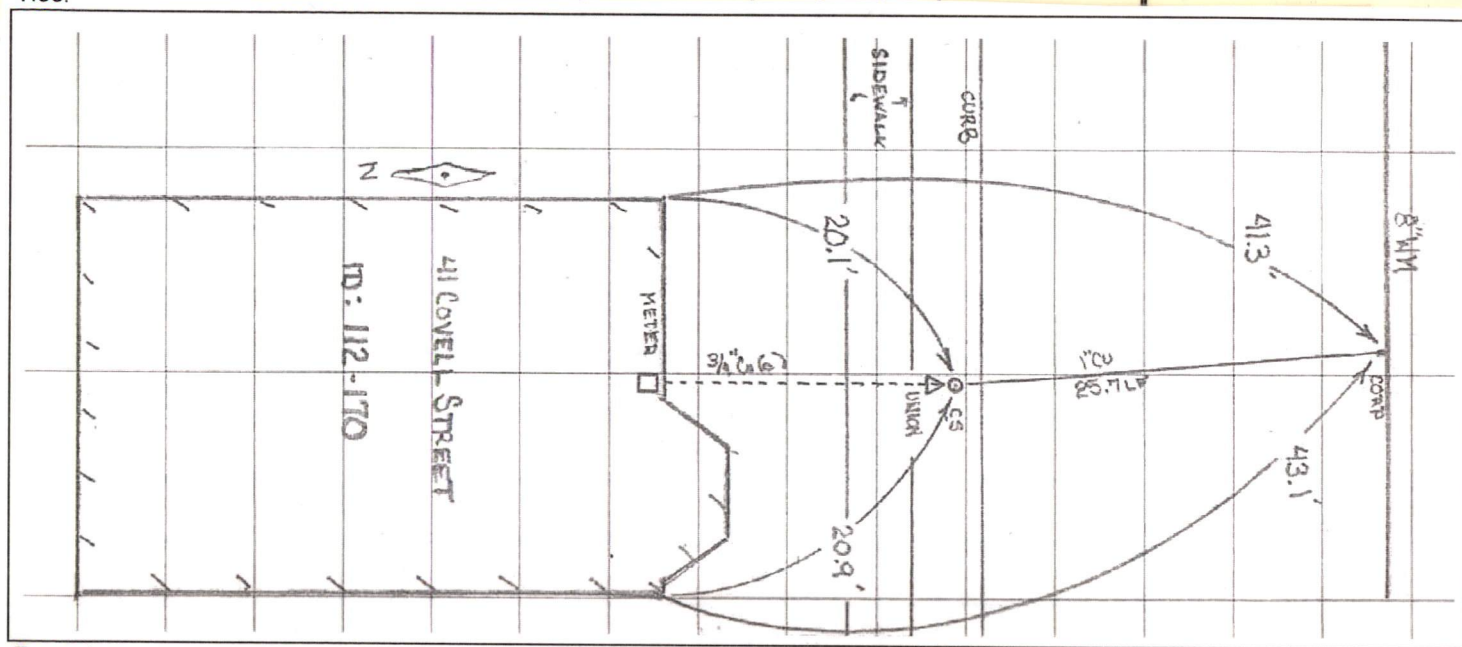

Poměrky: