

APPLICATION No.: 11544

## TAP CLEARED

LOCATION: 31 Covell St

DATE

BEF.

AFT.

REMARKS

OWNER: \

31-313

11/15/63

## MEASURES:

W X Belleville Ave 317.3 ft

S X N line Covell St 9.0 ft

E X W line House 11.7 ft

1" Copper Service

5/7/2019 - Lead service line replacement program

Phase 1, Contractor P. Gioioso &amp; Son

Type CU, Diameter (in)1, Water Pressure 90

Distance from main to curb stop (ft) 24.5

Distance curb stop to meter (ft) 20.8

Distance from curb face to curb stop (ft) 1.5

Depth of service (ft) 5.3

Total length of new pipe installed (ft) 45.3

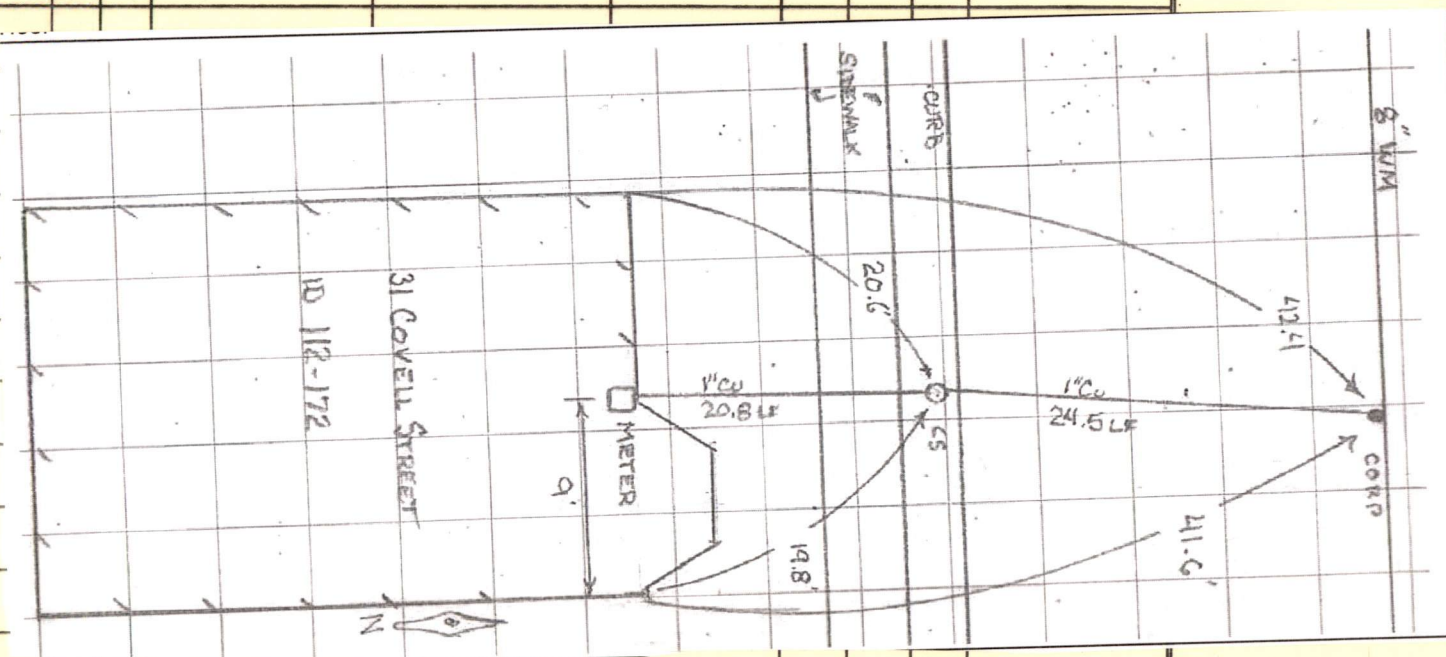
Curb stop replaced: yes, size 1"

Corporation replaced: yes, size 1"

Ball Valve replaced: yes, size 1"

[illegible]

### CHARGE OUTS

[illegible]