

✓ APPLICATION No.: 11950

LOCATION: 24 Viall St

OWNER:

31-313

MEASURES: 4/11/2019 1" Copper Service  
Lead Service Line Replacement Program  
Phase 1, Contractor P Gioioso & Son  
Type Cu, Diameter 1in, Water pressures 100  
Distance from main to curb stop (ft) N/A  
Distance from curb stop to meter (ft) 19.5  
Distance from curb face to curb stop (ft) 1  
Depth of service (ft) 4  
Total length of new pipe installed (ft) 19.5  
Curb sop replaced No, Corporation replaced: NO  
Ball valve replaced: yes size 1"

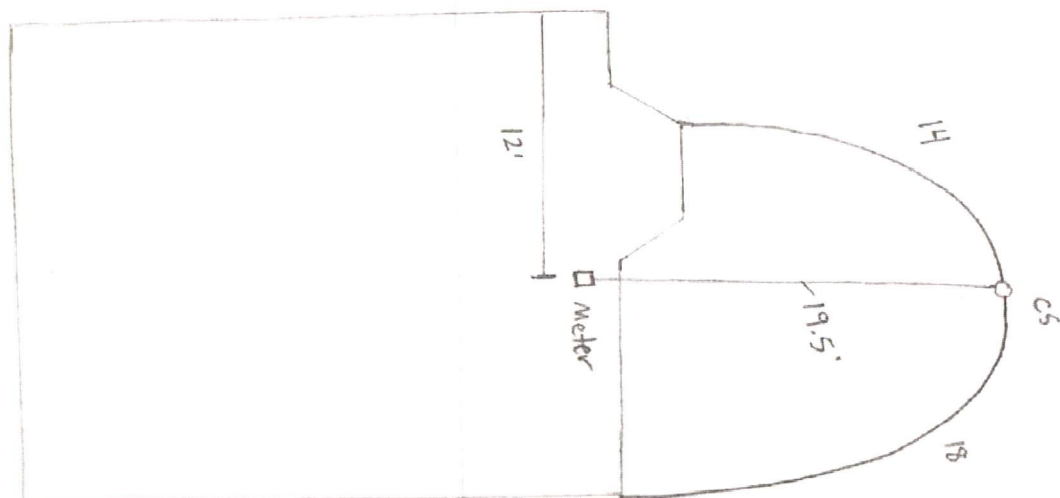
TAP CLEARED

DATE \_\_\_\_\_

BEF.

AFT.

REMARKS

[illegible]

APPLICATION No.: 11950TAP CLEARED 9105-0698LOCATION: 24 ViallOWNER: Stausislaus LipteaMEASURES: 5/8"

N from	Ruth	292.4 ft.
W from E	Viall	9.5 ft.
N from S	house	14.0 ft.

-----  
 September 26, 1972 Renewed from the main to 6" inside of curb stop.  
 24<sup>1</sup>/<sub>2</sub> ft. of 3/4" copper tubing      1 3/4" Hays curb stop  
 1 3/4" x 3/4" fig. 413 cplg.      1 Caldwell stop box  
 1 lb. wiping solder  
 -----

September 13, 1972 Renewed from the main to a point 7 ft. from  
 the main.  
 7 ft. of 3/4" copper tubing      1 5/8" x 3/4" lead connector  
 1 6" x 3/4" Christy Sleeve  
 -----

August 17, 1970 Renewed from the main to a point 9 ft. E x main.  
 9 ft. of 3/4" copper tubing      1 wipe joint  
 -----

July 2, 1969 Renewed from the main to a point 8 ft. from the main.  
 8 ft. of 3/4" copper tubing      1 3/4" x 3/4" fig. 413 cplg.  
 1 wipe joint  
 -----

1/29/91: Renewed from curb stop to prop line  
 Stock: 9ft. 3x4" copper tubing      1-3/4" curb stop  
 1-Caldwell stop box ===== 1-3/4x5/8 lead to cop adapt. xxs

DATE

BEF.

AFT.

REMARKS



[illegible]