

LOCATION: 176 Belleville Rd.

OWNER: Amedee Blanchette

MEASURES: 5/8" L lead June 30, 1908
 W from Acushnet Ave. 422.0 ft.
 N from S line Belleville Rd. 9.0 ft.
 W from E line House 3.6 ft.

Dec. 1, 1980: Renewed from 6" outside curbstop to the property line.

9.0 ft.-3/4" copper

1-3/4" curb stop 1-stop box

2-3/4" x 5/8" lead-cop. adapt. XS

Sept 12, 1996: Street excavation: Tilcon

Renewed from main to 6" outside curb stop

Stock: 9ft 3/4" copper tubing same curb stop same Caldwell stop

box 1-3/4x3/4 cop-cop cplg.comp 1-3/4x5/8 Fig 413

Insp. M Rose III

=====

4/2/2018: Lead service line replacement program phase 1

Contractor: P. Gioioso & Sons

Type: Cu, Diameter 1", Water Pressure 58

Distance from main to curb stop N/A

Distance from curb stop to meter 28.3'

Distance from curb face to curb stop 1.0'

Depth of service 4.4'

DATE BEF. AFT. REMARKS

9/12/96: tap reamed

METER HISTORY

CHARGE OUTS

[illegible]

APPLICATION No.:

OWNER:

31-313

MEASURES:

Total length of new pipe installed 31.3'

Curb Stop replaced NO: Size N/A

Corporation replaced NO: Size N/A

Ball Valve furnished YES: Size 1"


TAP CLEARED

DATE _____

BEF.

AFT.

REMARKS

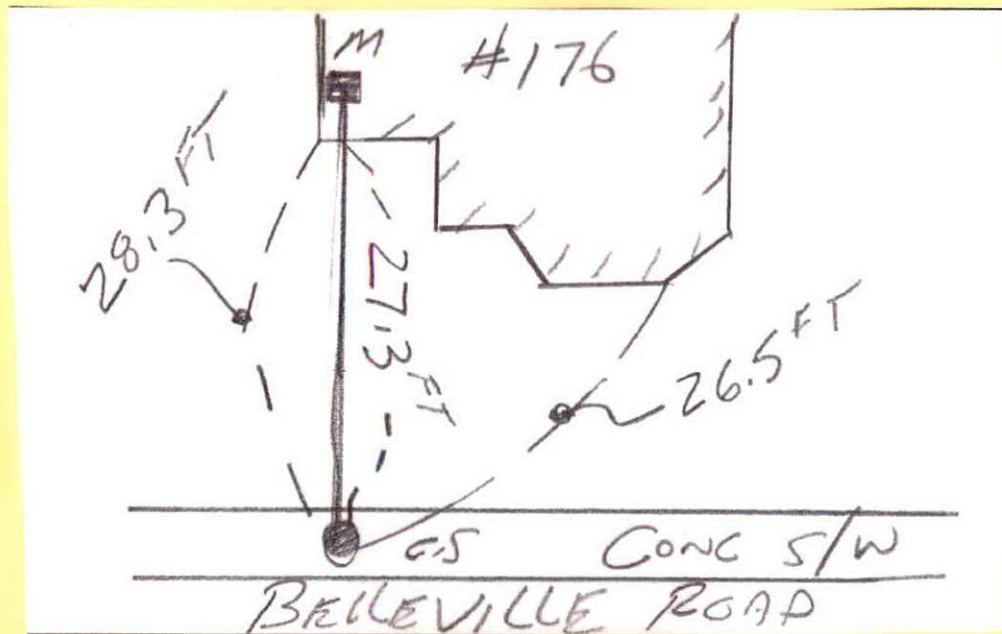

DATE	SET	CLASS	
------	-----	-------	--

[illegible]

CHARGE OUTS