

APPLICATION No.: 12290

LOCATION: 165 Hathaway St

TAP CLEARED

OWNER:

31-313

MEASURES: 1" Copper Service

06/22/2018 Lead Service Line Replacement Program

Phase 1, Contractor P Gioioso & Son

Type CU, Diameter 1in, Water pressure 67

Distance from main to curb stop (ft) N/A

Distance from curb stop to meter (ft) 14.5

13.5 ft to house + 1ft wall

Distance from curb face to curb stop (ft) 2.5

Depth of service (ft) 3.5

Total length of new pipe installed (ft) 17.5

14.5 ft + 3 ft whip

Curb stop replaced: no

Corporation replaced: no

Ball valve furnished: yes size 1"

DATE


BEF.

AFT.

REMARKS

[illegible]

## CHAPTER 10

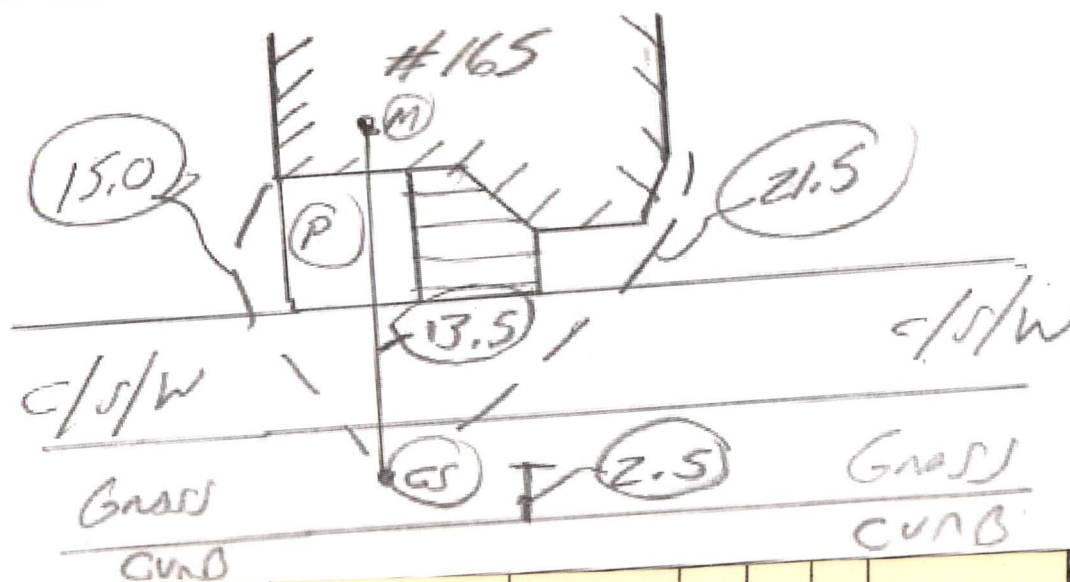

APPLICATION No.: 12290

TAP CLEARED

LOCATION: 165 Hathaway

OWNER: M. Izdebski

MEASURES: E from Brook St. 174.5 ft.  
S from N line Hathaway St. 9.0 ft.  
E from W line house 4.3 ft.

Mar. 14, 1958 Renewed from tap to a point  $5\frac{1}{2}$  ft. from tap  
 $5\frac{1}{2}'$  of  $\frac{3}{4}"$  copper tubing  $\frac{3}{4}"$  cop. to 12 f. cplg., fig 413  
 1 lb.s. wiping solder

Mar. 15, 1958 Renewed from property line to inside cellar  
7' of 3/4" copper tubing

November 12, 1975    Renewed from the curb stop to the property line.

9 ft. 3/4" copper tubing	1 curb stop
1 stop box	1 5/8" lead to copper adapter XS
1 3/4" copper coupling	

2005 Earle St sewer project 3/4 copper main-prop line



[illegible]

## CHARGE OUTS

[illegible]