

APPLICATION No.: 12395

LOCATION: 102 South St

OWNER:

31-313

MEASURES: 1" Copper Service
8/29/2018

Lead Service Replacement Program

Phase 1, Contractor P Gioioso & Son

Type CU, Diameter 1in, Water pressure 100

Distance from main to curb stop (ft) N/A

Distance curb stop to meter (ft) 26

Distance from curb face to curb stop (ft) 2

Depth of service (ft) 4.5

Total length of new pipe installed (ft) 26

Curb stop replaced: No

Corporation replaced: no

Ball valve replaced: yes size 1"

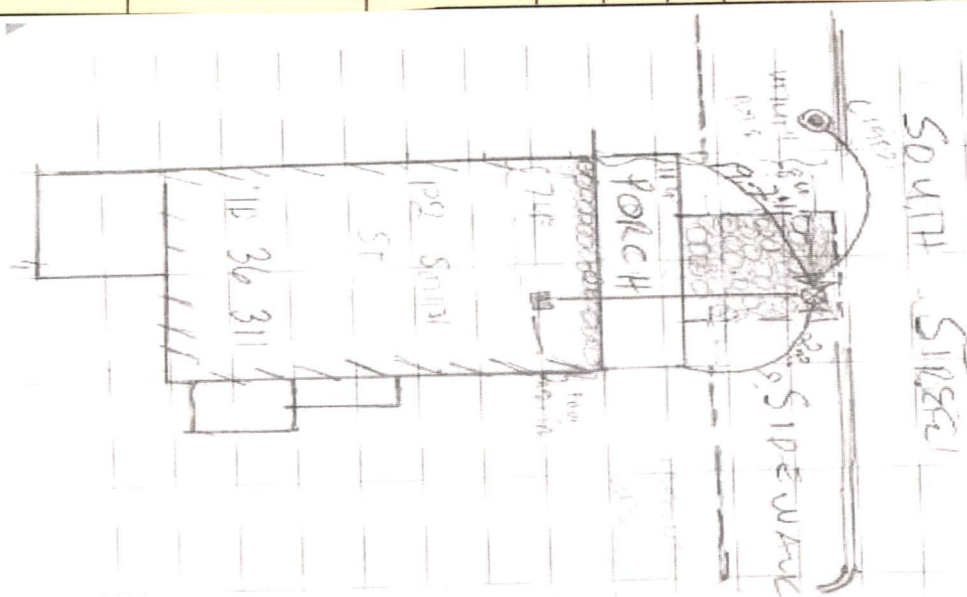
TAP CLEARED

DATE _____

BEF.

AFT.

REMARKS

[illegible][illegible]

APPLICATION No.: 12395

TAP CLEARED

LOCATION: 102 South St.

OWNER: Alice M. Murphy

MEASURES:

5/8" H lead Oct. 24, 1908
W from County St. 228.0 ft.
N from S line South St. 9.5 ft.
E from W line house 10.0 ft.

September 29, 1958 Renewed from the meter to a point 1 ft. inside
the property line.

14 ft. of 3/4" copper tubing

Stock supplied and installed by owner's plumber.

1/13/93: Renewed from main to prop line Stock: 18ft 3/4" copper
tubing 1-3/4" curb stop 1-Caldwell stop box 1-3/4x5/8 lead-cop
adapt xxs 1-3/4x5/8 Fig 413
=====

DATE

BEF.

AFT.

REMARKS

1-13-
93

9303 1629

1/13/93: tap reamed

[illegible]

CHARGE OUTS

[illegible]