

APPLICATION No.: 13056

TAP CLEARED 

LOCATION: 183 Deane St

OWNER: \_\_\_\_\_

31-313

## MEASURES:

1" Copper Service

09/23/2019 Lead service line replacement program

Phase 1, Contractor P Gioioso &amp; Son

Type CU, Diameter 1in, Water pressure 60

Distance from main to curb stop (ft) N/A

Distance from curb stop to meter (ft) 33

Distance from curb face to curb stop (ft) 1.8

Depth of service (ft) 4

Total length of new pipe installed (ft) 33

Curb stop replaced: no

Corporation replaced: no

Ball valve furnished: yes size 1"

DATE

BEF.


AFT.

REMARKS

# METER HISTORY

## CHARGE OUTS

DATE	SET OUT	SIZE	MAKE	NUMBER	READING	TEST			REMARKS

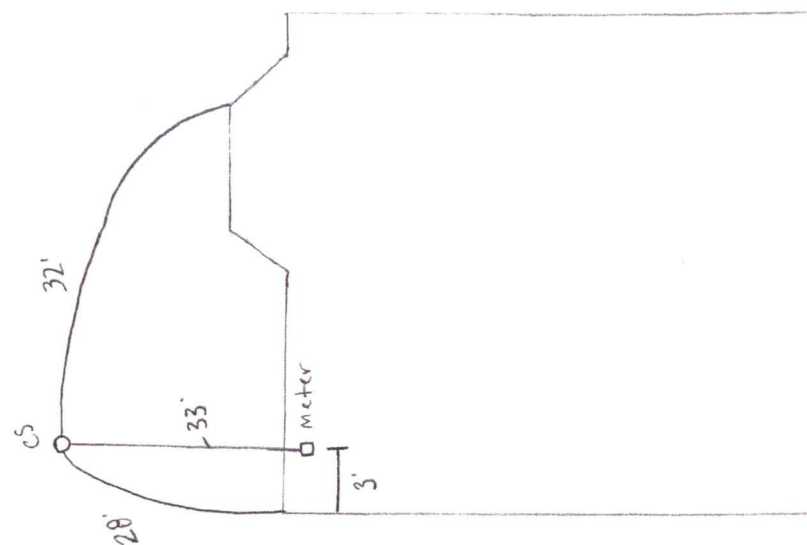

APPLICATION No.: 13056

## TAP CLEARED

LOCATION: 183 Deane St.

OWNER: Dorothy M. Hurkey

MEASURES:

5/8"

E from	Brook	286.2
S from N line	Deane	8.4
W from E line	House	2.0

Oct. 18, 1961 Renewed from  $\frac{1}{2}$  ft. outside to 4 ft. inside curb stop  
 $4\frac{1}{2}$  ft. of  $\frac{3}{4}$ " copper tubing  $\frac{3}{4}$ " cop. to cop. stop, fig. 415  
2 lbs. wiping solder

Jan. 25, 1964 Renewed from main to 3 ft. from main  
3 ft.  $\frac{3}{4}$ " copper tubing  $\frac{5}{8}$ " reused corporation coupling,  
1 lb. wiping solder

7/19/91: Capaldi Bros. renewed from main to curb stop  
Stock: 32ft.  $\frac{3}{4}$ " copper tubing 1- $\frac{3}{4}$ " curb stop  
1- Caldwell stop box, compl. 1-3/4x5/8 Fig. 413

DATE

BEF.

AFT.

REMARKS

1/25/64

REAMED

7/19/91: TAP REAMED



## METER HISTORY

[illegible]

## CHARGE OUTS