

APPLICATION No.: 13073

## TAP CLEARED

LOCATION: 395 Orchard St

OWNER:

31-313

MEASURES: Nov 23, 1909  
S X Rockland St 120.7 ft  
E X W Line Orchard St 9.0 ft  
N X S Line House 15.2 ft

1" Copper Service

10/15/2018 Lead Service Replacement Program

Phase 1, Contractor P Gioioso &amp; Son

Type CU, Diameter 1in, Water pressure 100

Distance from main to curb stop (ft) 10.2

Distance from curb stop to meter (ft) 15

Distance from curb face to curb stop (ft) 1.5

Depth of service (Ft) 3.7

Total length of new pipe installed (ft) 10.2

Curb stop replaced: Yes size 1"

Corporation replaced: Yes size 1"

Ball valve furnished: No size 3/4"

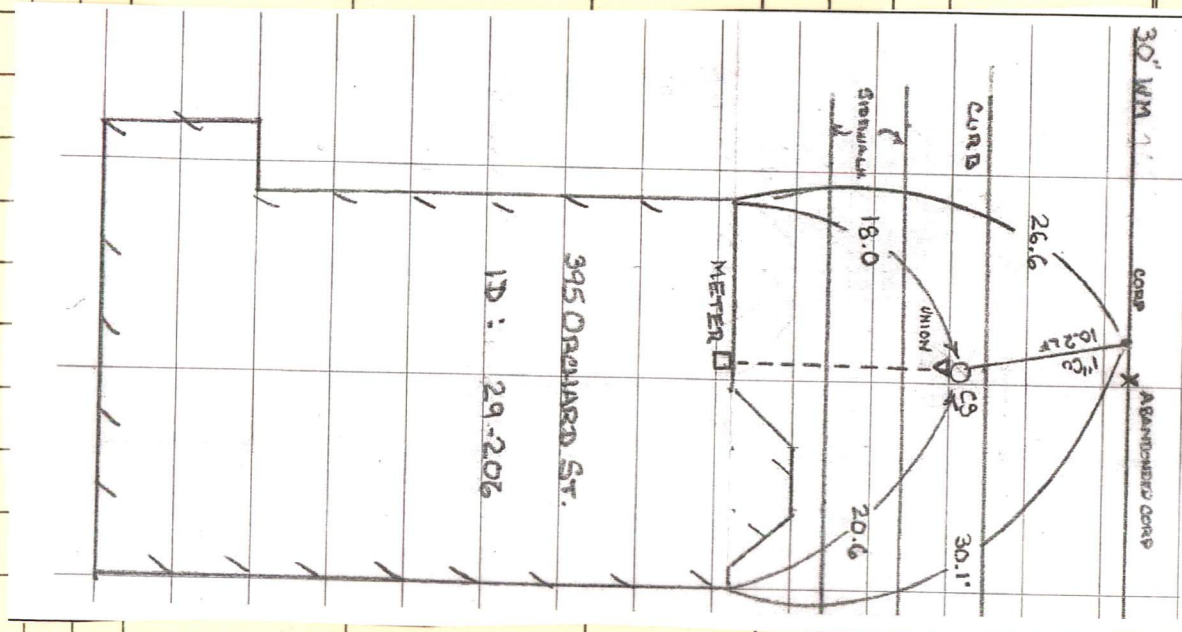
Remarks: 3/4-1 union installed 1.0 LF outside  
curb stop

DATE

BEF.

AFT.

REMARKS

[illegible][illegible]