

APPLICATION No.: 13106

TAP CLEARED

LOCATION: 208 Eugenia St

OWNER:

31-313

MEASURES:

1" Copper Service

04/18/2018 - Lead Service Line Replacement  
Program, Phase 1, Contractor P Gioioso & Son

Type CU, Diameter 1in, Water pressure 60

Distance from main to curb stop (ft) N/A

Distance from curb stop to meter (ft) 16.8

Distance from curb face to curb stop (ft) 2.0

Depth of service (ft) 3.8 ft

Total length of new pipe installed (ft) 19.8

Curb stop replaced: no

Corporation replaced: no

Ball valve furnished: yes, size 1"

Remarks: 15.8 ft curb stop to house, 1.0 ft  
house to meter, 3.0 whip

DATE

BEF.


AFT.

REMARKS

# METER HISTORY

## CHARGE OUTS

DATE	SET OUT	SIZE	MAKE	NUMBER	READING	TEST			REMARKS

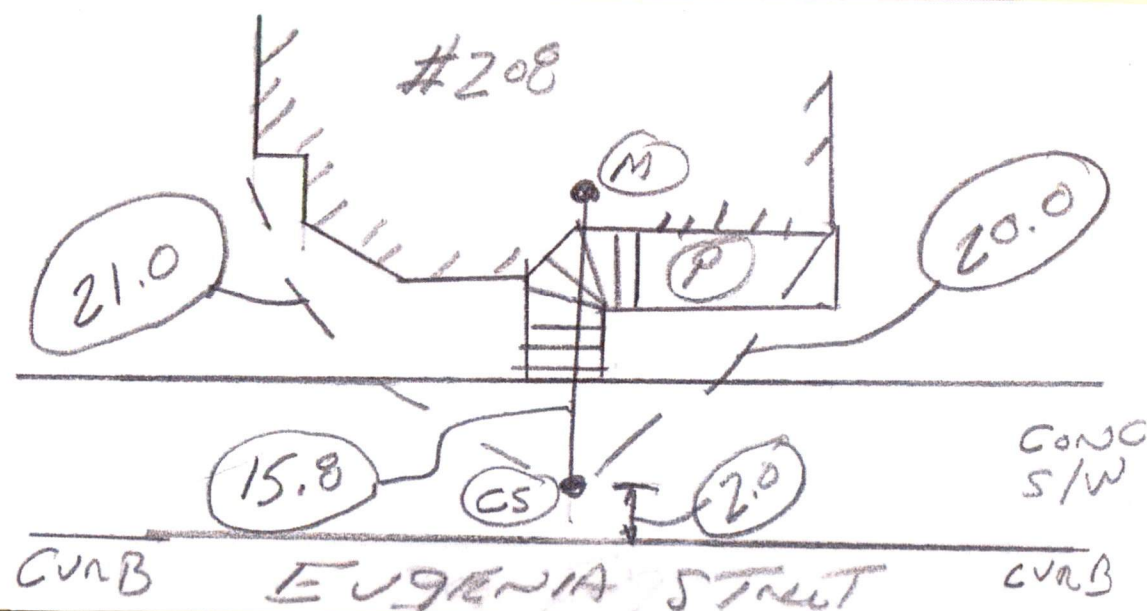

APPLICATION No.: 13106

TAP CLEARED

LOCATION: 208 Eugenia

OWNER: Mary Cardeiro

**MEASURES:**

5/8"

E from

Ashley Blvd.

134.3

N from S line

Eugenia

8.8

E from W line

Hous e

12.3

Dec. 4, 1961 Renewed from tap to 1 ft. outside curb stop  
7 ft. of 3/4" copper tubing Reused 5/8" corp. cplg.  
1 lb. wiping solder

August 16, 1977: Renewed from 6" outside curbstop to prop. line;  
9 ft.-3/4" copper; Ford curbstop; 2 wipe joints; Caldwell stop box;



## METER HISTORY

[illegible]

CHARGE OUTS.