

APPLICATION No.: 13372

LOCATION:

174 CLIFFORD ST.

OWNER:

JOSE M. TEIXEIRA

31-313

Measures:

5/8"

E from

Ashley Blvd

74.5'

N from S line

Clifford

8.6'

W from E line

Building

8.9'

1" Copper Service

09/15/2022 2022 Water main improvement program

Contractor: C. Naughton Corp.

Type CU Diameter 1"

Distance from main to curb 9'

Distance from curb stop to meter 15.50'

Distance curb face to curb stop 1.50

Depth of Service 4.50'

Total length of new pipe installed 24.50'

Curb Stop replaced yes size 1"

Corporation replaced yes 1"

Ball Valve replaced yes N/A

Remarks: Type C- 1" Copper to meter

TAP CLEARED

DATE

BEF.


AFT.

REMARKS

METER HISTORY

DATE	SET OUT	SIZE	MAKE	NUMBER	READING	TEST			REMARKS

CHARGE OUTS

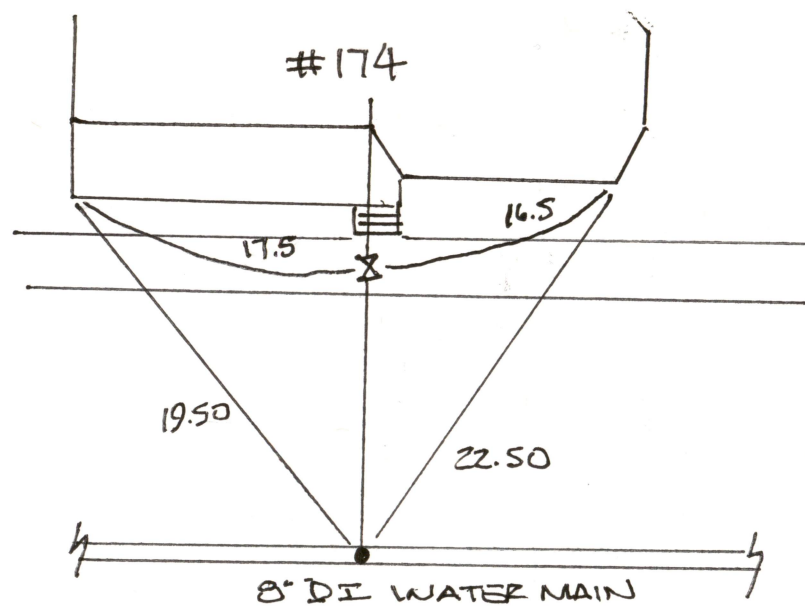

CLIFFORD ST.