

13439

154 Hathaway St

OWNER:

31-313

MEASURES: 1" Copper Service

06/21/2018 Lead Service Line Replacement Program

Phase 1, Contractor P Gioioso & Son

Type CU, Diameter 1in, Water pressure 70

Distance from main to curb stop (ft) N/A

Distance from curb stop to meter (ft) 18.5

17.5 ft to house + 1 ft wall

Distance from curb face to curb stop (ft) 1.5

Depth of service (ft) 3.7

Total length of new pipe installed (ft) 21.5

18.5 ft + 3 ft Whip

Curb stop replaced: no

Corporation replaced: no

Ball valve furnished: yes size 1"

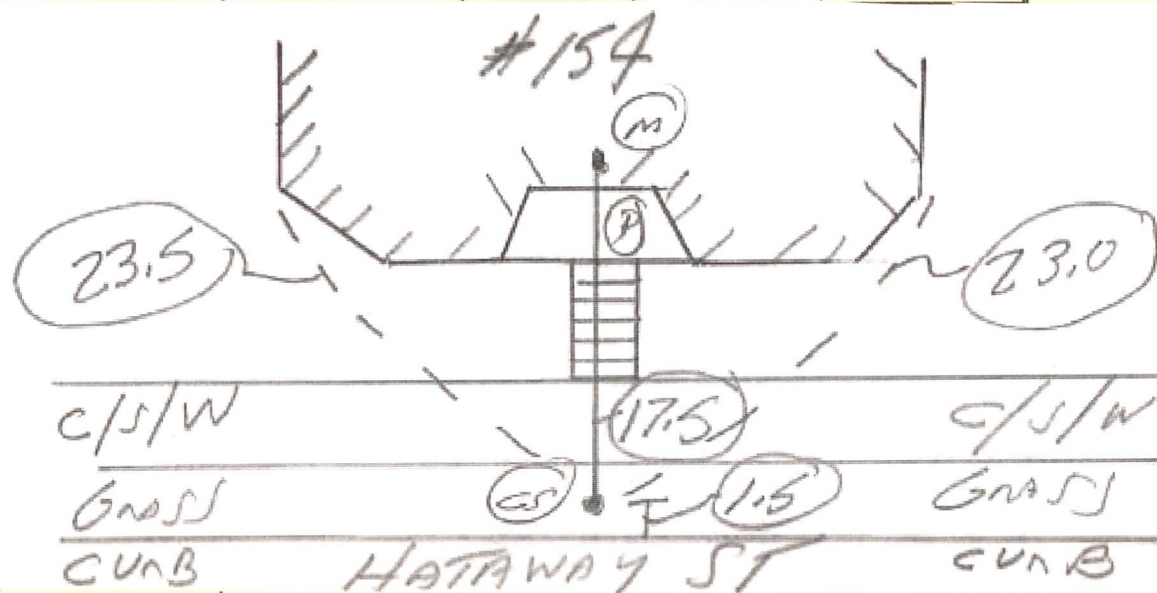
TAP CLEARED

DATE _____

BEF.

AFT.

REMARKS

[illegible]

APPLICATION No.: 13439

TAP CLEARED

LOCATION: 154 HathawayOWNER: Albert A. Montmarjnette

MEASURES: E from Brook St. 309.6 ft.
N from S line Hathaway 9.0'
E from W line house 13.8 ft.

Dec. 3, 1976 Renewed from $\frac{1}{2}$ ft. outside curb stop to
5 $\frac{1}{2}$ ft. inside curb stop.
6 ft. - $\frac{3}{4}$ " Copper tubing $\frac{3}{4}$ " Curb Stop
Stop Box 2 - $\frac{5}{8}$ " x $\frac{3}{4}$ " lead to cop.
conn.

8/19/03 Renewed from main to curb stop. Stock; 16 ft.
 $\frac{3}{4}$ " copper tubing; $\frac{3}{4}$ " curb stop; Caldwell stop box;
 $\frac{3}{4}$ " x $\frac{3}{4}$ " Fig. 413 Tap reamed

DATE

BEF.

AFT.

REMARKS

8/19/03 8:30 am 2003-340-2617

8/19/03

Tap reamed

[illegible]

CHARGE OUTS

[illegible]