

APPLICATION No.: 13440

LOCATION: 158 Hathaway St

OWNER:

31-313

MEASURES: 1" Copper Service

06/22/2018 Lead Service Line Replacement Program

Phase 1, Contractor P Gioioso & Son

Type CU, Diameter 1in, Water pressure 70

Distance from main to curb stop (ft) 8.5

Distance from curb stop to meter (ft) N/A

Distance from curbface to curb stop (ft) 2.0

Depth of service (ft) 3.7

Total length of new pipe installed (ft) 8.5

Curb stop replace: yes size 1"

Corporation replaced: yes size 1"

Ball valve furnished: no

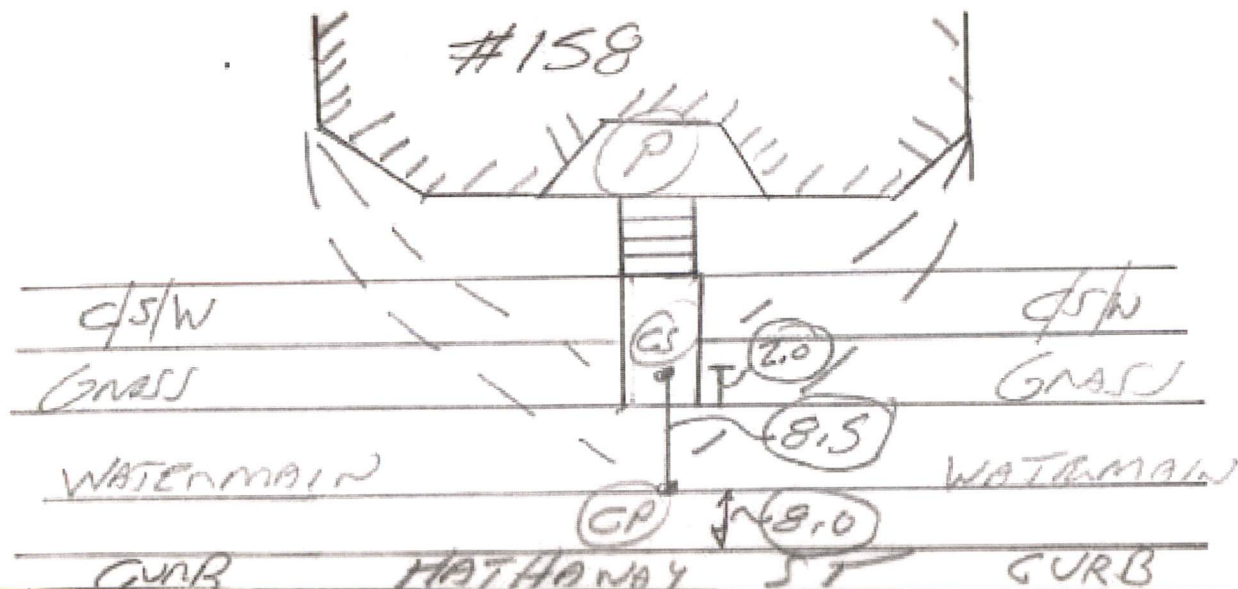
TAP CLEARED

DATE \_\_\_\_\_

BEF.

AFT.

REMARKS

[illegible]



APPLICATION No.: 13440

TAP CLEARED ✓

LOCATION: 158 Hathaway

OWNER: F Alsie

MEASURES:  $\frac{3}{4}$  Copper 06-10-1910  
E from Brook St. 259.2 ft.  
N from S line Hathaway St. 9.0 ft.  
E from W line house 14.5 ft.

DATE

BEF.

AFT.

REMARKS

12/12/58

reamed

11-2-04

11-45

2004-440-8343

1-7-11

12-10

2011-0202041

Dec. 12, 1958 Renewed from main to a point 2' inside curb stop  
12' of  $\frac{3}{4}$ " copper tubing  $\frac{3}{4}$ " copper to copper stop, fig. 415  
1" x  $\frac{3}{4}$ " cop. to I. F. cplg., Fig. 413  
1 lb. wiping solder -----

11/4/04 Renewed from curb stop to property line. Stock: 10 ft.  
 $\frac{3}{4}$ " copper tubing;  $\frac{5}{8}$ " x  $\frac{3}{4}$ " lead-cop adapt. XXS  
-----

1/11/11 - City crew renewed water service from curb stop  
to cellar

18 ft  $\frac{3}{4}$ " copper tubing; 1  $\frac{3}{4}$ " curb stop;  
1 Caldwell stop box. Foreman: Felix Fernandez  
-----

[illegible]

CHARGE OUTS.

[illegible]