

13641

✓

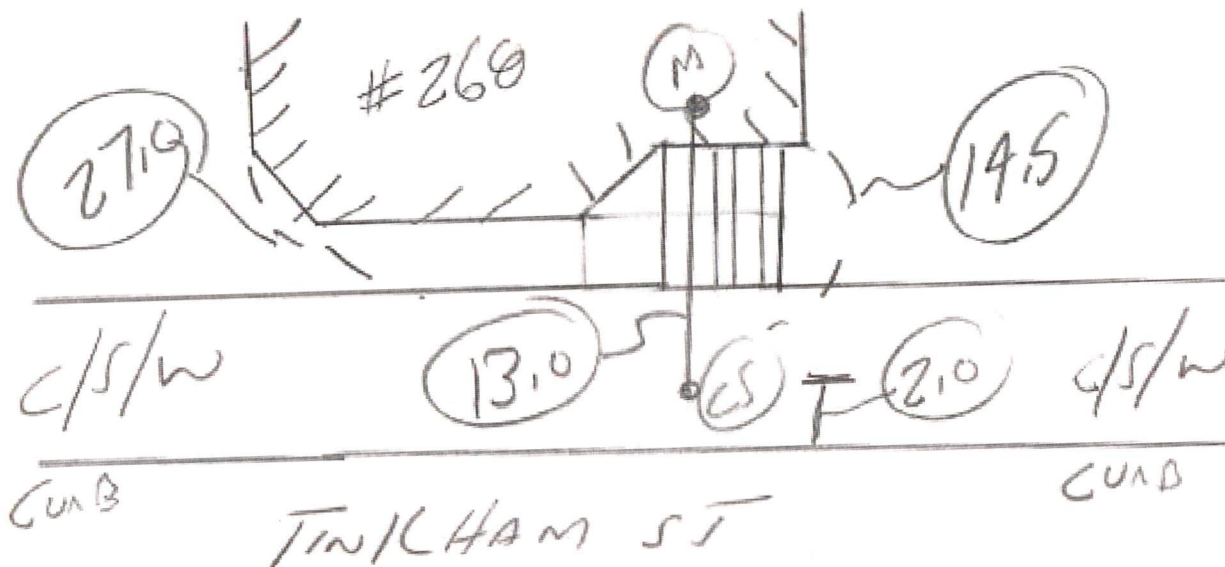
OWNER:

31-313

MEASURES: 1" Copper Service 06/13/2018
Lead Service Line Replacement Program
Phase 1, Contractor P Gioioso & Son
Type CU, Diameter 1in, Water pressure 68
Distance from main to curb stop (ft) N/A
Distance curb stop to meter (ft) 14
13.0 + 1' wall
Distance from curb stop to curb face (ft) 2
Depth of service (ft) 3.4
Total length of new pipe installed (Ft) 17
14 + 3' whip
Curb stop replaced: No Corporation replaced: No
Ball valve replaced: Yes size 1"

TAP CLEARED

[illegible]

[illegible]

APPLICATION No.: 13641

TAP CLEARED 8449-1631

LOCATION: 268 Tinkham

OWNER: Victor Saurski

MEASURES:	5/8"		
	E from	Brook	243.0 ft.
	N from S line	Tinkham	8.2 ft.
	E from W line	house	6.4 ft.

December 17, 1957 Renewed from curb stop to a point 2 ft. inside the curb stop.

2 ft. of $3/4$ " copper tubing 2 lbs. wiping solder

OCT 9 1981 - Renewed from main to the curb stop. 10.0 ft.
3/4" copper; 3/4" curb stop; stop box; 5/8" x 3/4" Fig.
413;

12/6/84: Renewed from 1/2' outside curb stop to prop.
line, Stock: 8ft.3" copper tubng 1 3/4" curb
stop 1 Caldwell stop box 1 3/4 x 5/8 lead to
cop adapt. X XS

METER HISTORY

[illegible]

CHARGE OUTS