

APPLICATION No.: 13738

## TAP CLEARED

LOCATION: 149 Crapo St

DATE

BEF.

AFT.

REMARKS

OWNER:

31-313

7/11/95 ream

7/1/11 Ream

MEASURES: October 6, 1910

S X N line Mosher St 18.2 ft

E X W line Crapo St 6.7 ft

S X S line House 1.0 ft

1" Copper Service

08/15/2019 Lead service line replacement program

Phase 1, Contractor P. Gioioso &amp; Son

Type CU, Diameter (in) 1, Water pressure 90

Distance from main to curb stop (ft) 8

Distance from curb stop to meter (ft) 92.4

Distance from curb face to curb stop (ft) 2.3

Depth of service (ft) 4.0

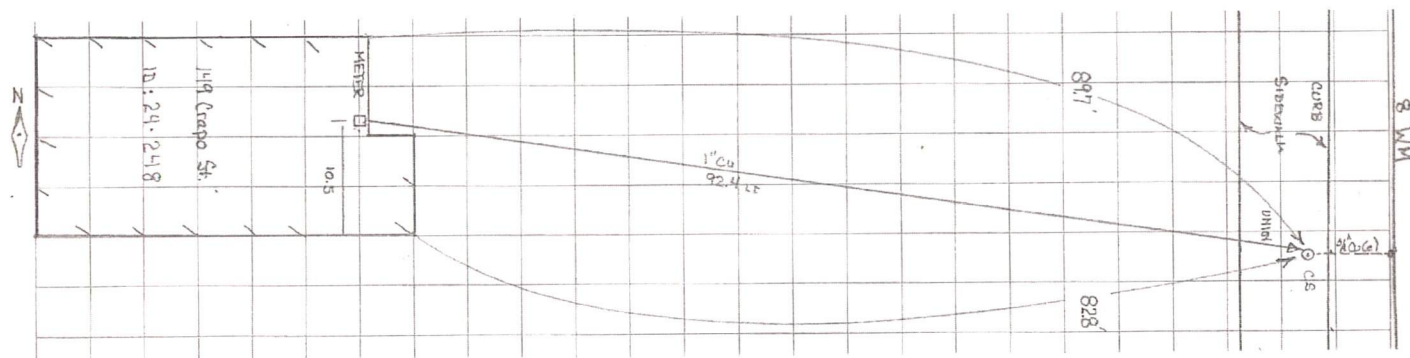
Total length of new pipe installed (ft) 92.4

Curb stop replaced: no size 3/4"

Corporation replaced: no size 3/4"

Ball valve furnished: yes size 1"

Remarks: 1-3/4" union installed where shown

[illegible][illegible]