

14681

APPLICATION No.:

LOCATION: 1902-1904 Acushnet Ave

TAP CLEARED

OWNER:

'31-313

MEASURES:

MAY 21, 1912

E from Acushnet Ave 87.0'

S from N Line Covell St 9.0'

W from E line Bldg 1.0'

Service from Covell

1" COPPER

5-13-2019: Lead service line replacement program  
phase 1 : TYPE CU, Diameter 1": Water Pressure 85

Contractor: P. Gioioso &amp; Sons

Distance from main to curb stop 26.3'

Distance curb stop to meter 20.5'

Distance from curb face to curb stop 2.4'

Depth of service 3.5'

Total length of new pipe installed 20.5'

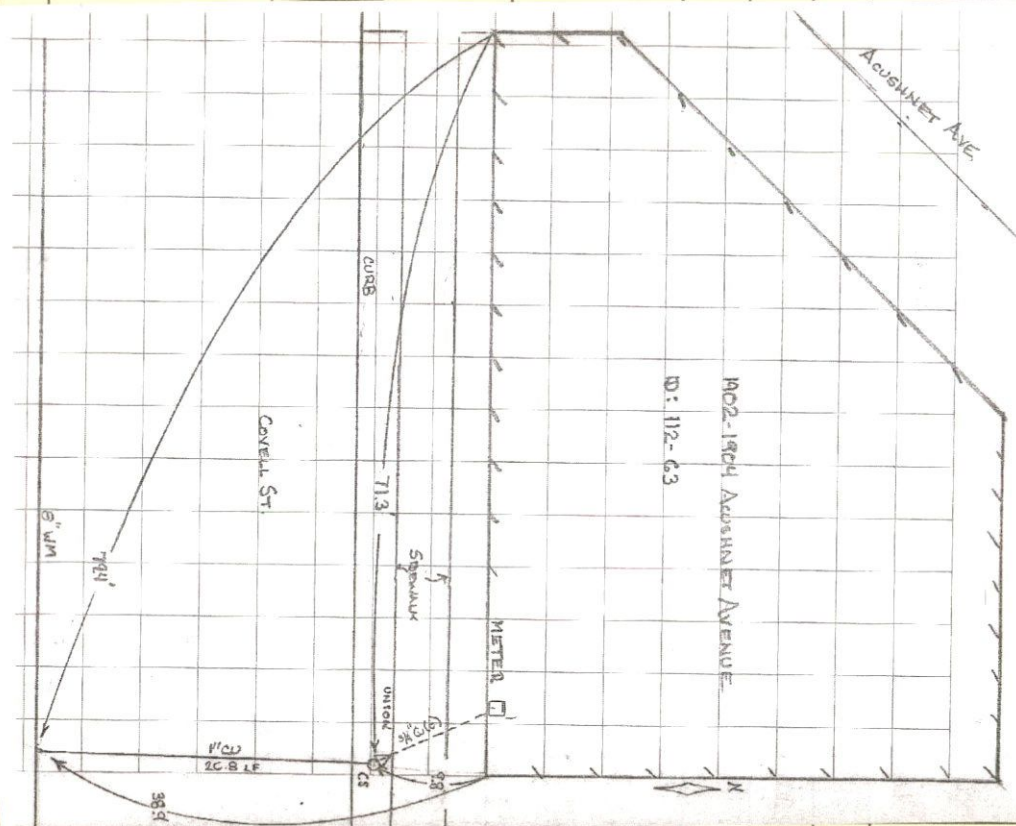
Remarks: 1 - 3/4" union installed 1ft outside  
curb stop

DATE

BEF.

AFT.

REMARKS

[illegible]

\_\_\_\_\_