

APPLICATION No.: 14791

LOCATION: 69 Covell St

OWNER: ✓

31-313

MEASURES:

E X Acushnet Ave 364.0 ft

S X N line Covell St 9.0 ft

E X W line House 10.5 ft

1" Copper service

5/6/2019 Lead service line replacement program

PHase 1, Contractor P. Gioioso & Son

Type: CU, Diameter (in) 1, Water Pressure 90

Distance from main to curb stop (ft) 26

Distance curb stop to meter (ft) 20.5

Distance from curb face to curb stop (ft) 1.8

Depth of service (ft) 3.6

Total length of new pipe installed (ft) 20.5

Curb stop replace: no size 3/4"

Corporation replaced: no, size 3/4"

Ball valve furnished: yes, size 1"

Remarks: 1-3/4" union installed 1ft outside curb stop

TAP CLEARED

DATE


BEF.

AFT.

REMARKS

METER HISTORY							
DATE	SET OUT	SIZE	MAKE	NUMBER	READING	TEST	REMARKS

CHARGE OUTS

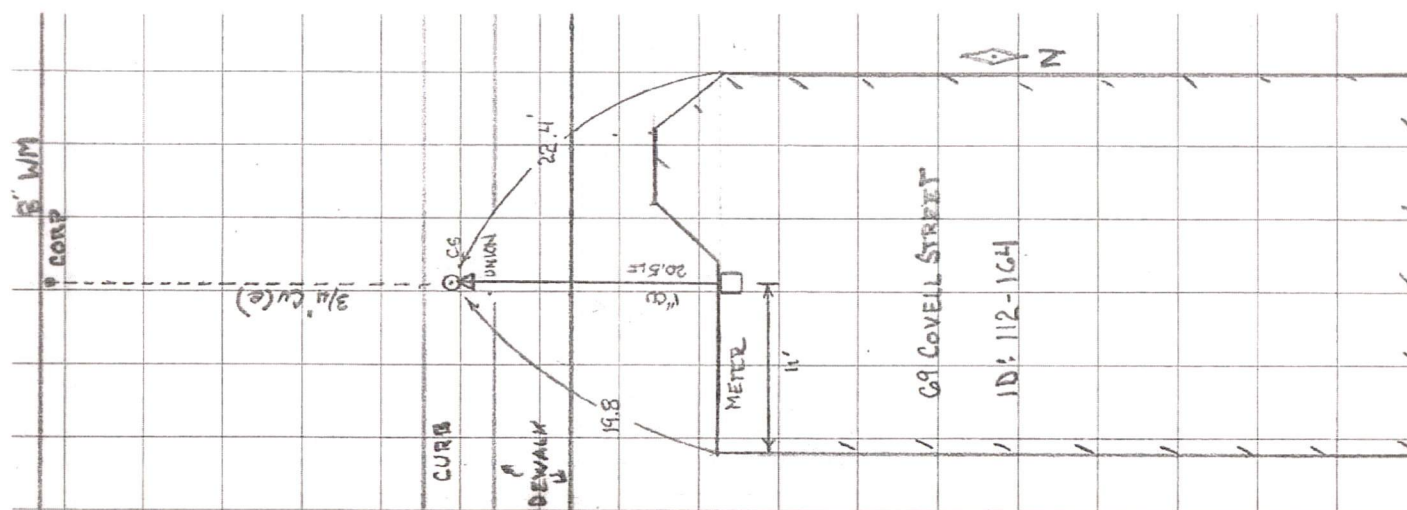

APPLICATION No.: 162260 5/8"

LOCATION: Rear 69 Covell St. Faces Hadley

OWNER: Edward J. Belliveau

MEASURES: 5/8"

TAP CLEARED

[illegible]

[illegible]

CHARGE OUTS

[illegible]