

APPLICATION No.: 15170

LOCATION: 23 W Rodney French Blvd

OWNER:

31-313

| | | |
|-----------|----------------------------|---------|
| MEASURES: | S X Welcome St | 38.0 Ft |
| | E X W Line W Rodney french | 11.0 ft |
| | S X S Line Lunch Cart. | 5.6 ft |

1" Copper Service 4/8/2019

Lead Service Line Replacement Program

Phase 1, Contractor P Gioioso & Son

Type CU, Diameter 1in, Water pressure 100

Distance from main to curb stop (ft) 15

Distance from curb stop to meter (ft) 14.5

Distance from curb face to curb stop (ft) 2.3

Depth of service (ft) 4

Total length of new pipe installed (ft) 14.5

Curb stop replaced: No size 3/4"

Corporation replaced: No size 3/4"

Ball valve replaced: Yes size 1"

Remarks: 1-3/4" union installed 1LF outside curb stop

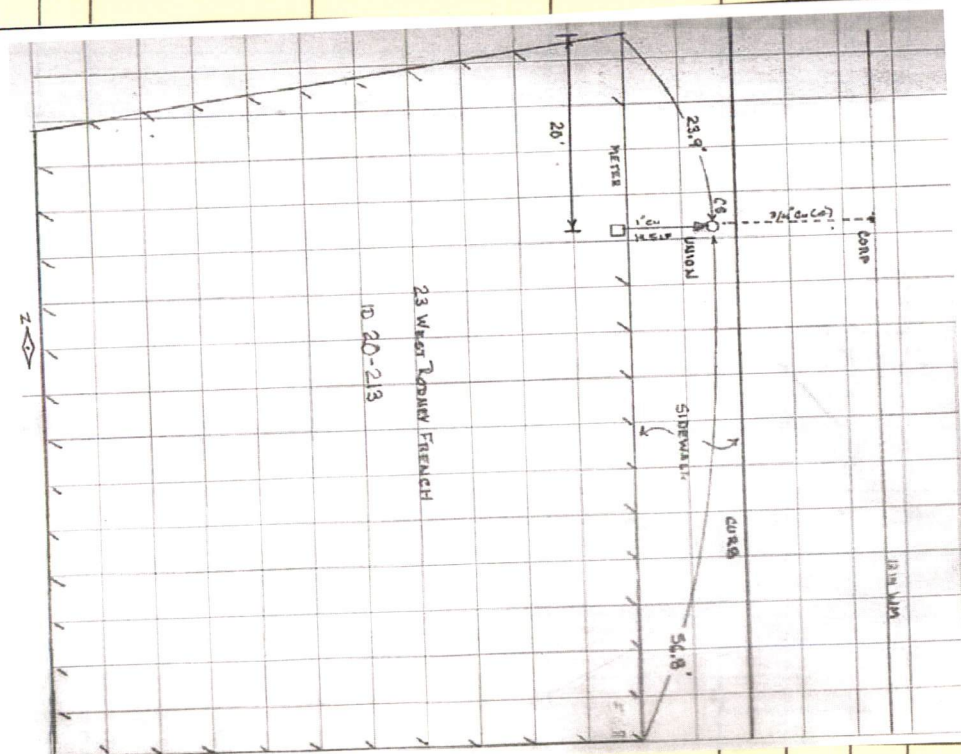
TAP CLEARED

DATE _____

BEF.

AFT.

REMARKS

[illegible]

APPLICATION No.: 15564c

TAP CLEARED

LOCATION: 27 W. Freenh Ave.

OWNER:

MEASURES:

5/8"

Conn. of Ser. # 15170. Trench dug by taker.

DATE

BEF.

AFT.

REMARKS

7

[illegible]

CHARGE OUTS