

APPLICATION No.: 15401

LOCATION:

123 CLIFFORD ST.

OWNER:

JOS. Cousineau

31-313

Measures:	5/8"	H Lead	10.03.1913
	E from	Arlington	56.3'
	S from N line	Clifford	9'
	W from E line	House	15'

1" Copper Service

09/12/2022 2022 Water main improvement program

Contractor: C. Naughton Corp.

Type CU Diameter 1"

Distance from main to curb 24'

Distance from curb stop to meter 15'

Distance curb face to curb stop 2'

Depth of Service 4'

Total length of new pipe installed 39'

Curb Stop replaced yes size 1"

Corporation replaced yes 1"

Ball Valve replaced yes N/A

Remarks: Type C-1" Copper to meter 20' Lead pipe removed

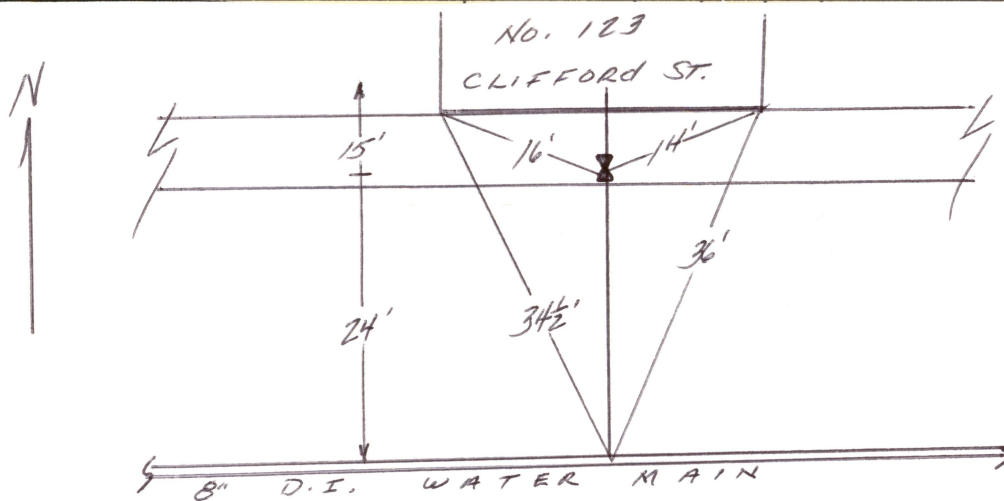
TAP CLEARED

DATE

BEF.

AFT.

REMARKS

[illegible]

C L I F F O R D S T.