

669-677,693

APPLICATION No.: 15604

LOCATION: ~~693~~ Purchase Cor. Spring

OWNER: N.B. Gas &amp; Ed lt. Co

MEASURES: 4" Darling Gate Iron box Old gate removed: 6/2/83

~~W from W line Purchase 54.4 ft.~~~~N from S line Spring 15.1 ft.~~~~W from E line Bldg. 51.7 ft.~~**FIRE SUPPLY**

June 2, 1983 Contractor melted out joint on the 8 x 8 x 6  
tee on Spring St. main. Installed in the following order:

4 ft. - 6" ductile pipe

6" x 4" reducer, mech.

2 ft. - 4" Ductile pipe

4" 1/4 Bend, mech.

3 ft. - 4" ductile pipe

18" pc. of 4" ductile pipe

4" gate valve, mech.

19 ft. - 4" ductile pipe into bldg.

All fittings are rodded.

One leadite joint on 8 x 8 x 6 tee made by Water Dept.

Contractor supplied all material &amp; installed all material.

Measures of 4" gate valve:

N x N line Bldg. 19.6 ft.

W x W line Purchase St. 51.3 ft.

2/14/07 Repaired gate box with #10 Gate box cover. Monty


TAP CLEARED

DATE

BEF.

AFT.

REMARKS

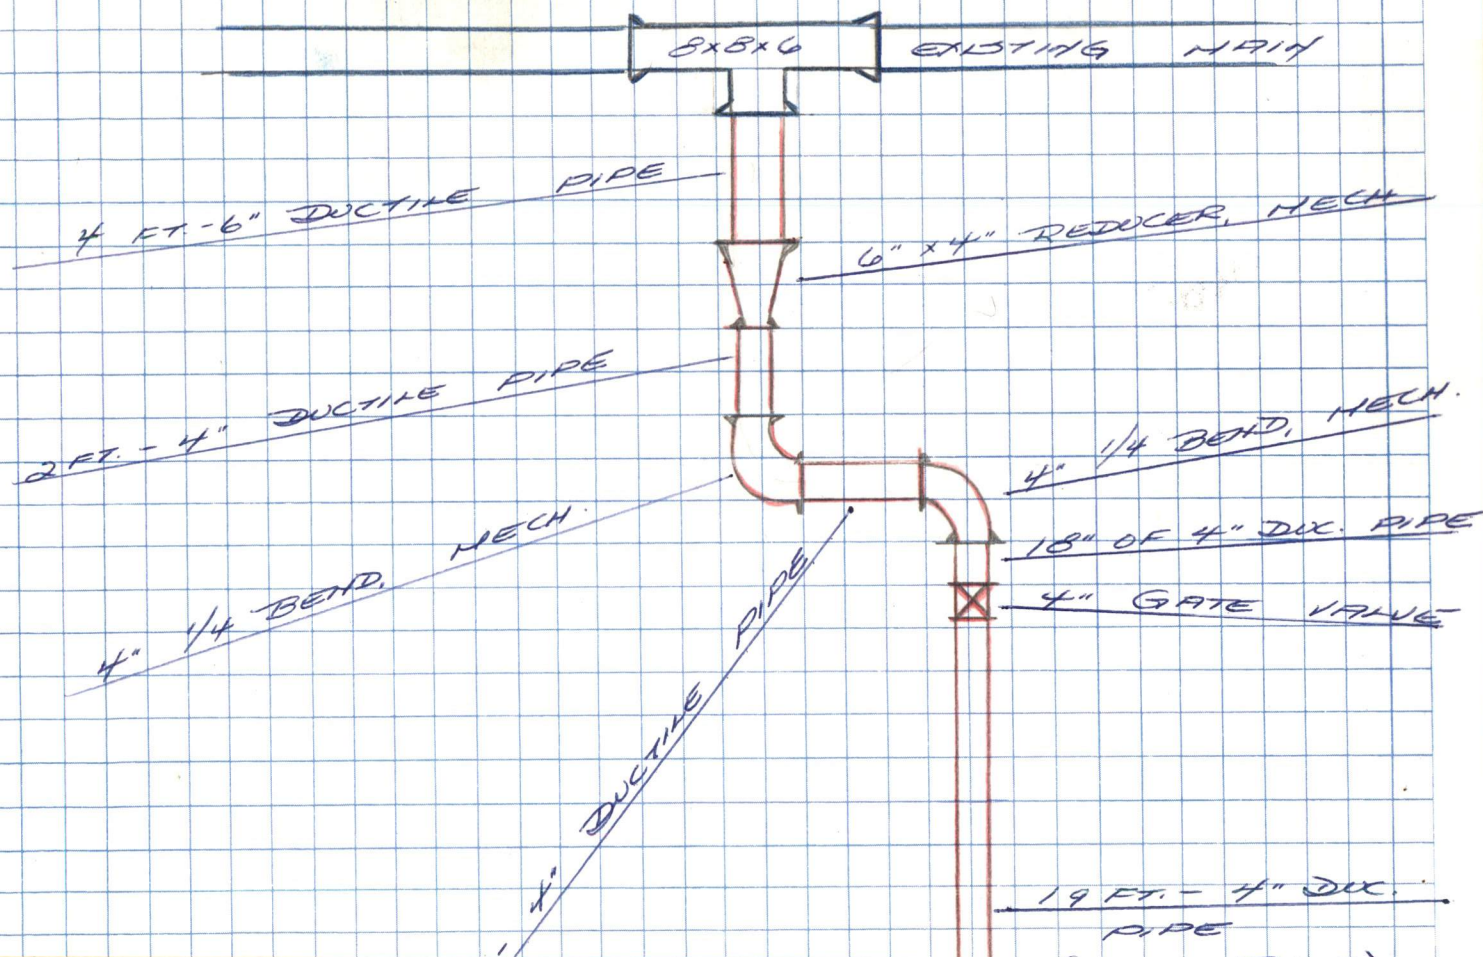



669-671, 677, 693

APPLICATION No.: 30063

TAP CLEARED



LOCATION: S.W. cor. Purchase & Spring Sts.

OWNER: Boston Invest & Dev. Co.

MEASURES: 8" C.I.C.L. Ductile Pipe 12/6/82

E from E line Pleasant St. 150.0 ft.  
N x S line Spring St. 23.0 ft.

FIRE SUPPLY

2/14/07 Repaired gate box with #10 Gate box cover. Monty

-----

DATE

BEF.

AFT.

REMARKS

[illegible]

## CHARGE OUTS

[illegible]

665 APPLICATION No.: 15604

TAP CLEARED ✓

LOCATION: Purchase S.W. Cor. Spring

OWNER: N.B. Gas Co.

MEASURES: 4"

W from W line  
N from S line  
W from E line

Darling Gate	Iron Gate
Purchase	54.4 ft.
Spring	15.1 ft.
Bldg.	51.7 ft.

DATE

BEF.

AFT.

REMARKS



[illegible]

## CHARGE OUTS

[illegible]