

APPLICATION No.: 15620 3/4" L lead

TAP CLEARED

LOCATION: 401 Ashley Blvd.

OWNER: S. Piervauszky

MEASURES: 3/4"

L lead

Mar. 20, 1914

N from

Eugenia

25.7 ft.

E from W line

Ashley Blvd.

10.0 ft.

N from S line

Blgd.

23.0 ft.

Nov. 4, 1957 Renewed from a point 6" outside curb stop  
to a point 4 ft. inside curb stop.

4 1/2 ft. - 3/4" copper tubing; 1-3/4" copper stop, fig.

415 Red Hed; 2# wiping solder.

The electric duct is 4 ft. west from the stop box 3 ft.  
deep.

Feb. 23, 1965 Reenewed servcie from main to curb stop.  
10 ft. - 3/4" copper tubing; 1-3/4" copper cplg. A1525;  
1-3/4" reused corp. cplg.; Tap reamed

12/16/92: Renewed from outisde curb stop to prop line Inst.new  
curb stop Stock: 10ft 3/4" copper tubing 1-3/4" curb stop  
1-Caldwell stop box 1-3/4x5/8 lead-cop adapt.xxs

=====

4/4/18: Lead service line replacement program phase 1  
Contractor: P. Gioioso & Sons.  
Type: CU, Diameter 1", Water Pressure 65

Distance curB stop to meter 18.0'

Distance from curB face to curB stop 7.3'

Depth of service 3.3'

Total length of new pipe install 21.0'

Distance from main to curb stop (ft): N/A

DATE

BEF.

AFT.

REMARKS

12-16-

92

9251 1465

## METER HISTORY

## CHARGE OUTS

[illegible]

15620

APPLICATION No.:

TAP CLEARED

LOCATION:

401 Ashley Blvd

DATE

BEF.

AFT.


REMARKS

OWNER:

31-313

MEASURES:

CurB stop replaced: NO Size N/A  
Corporation replaced: NO Size N/A  
BALL Valve furnished: YES Size 1"

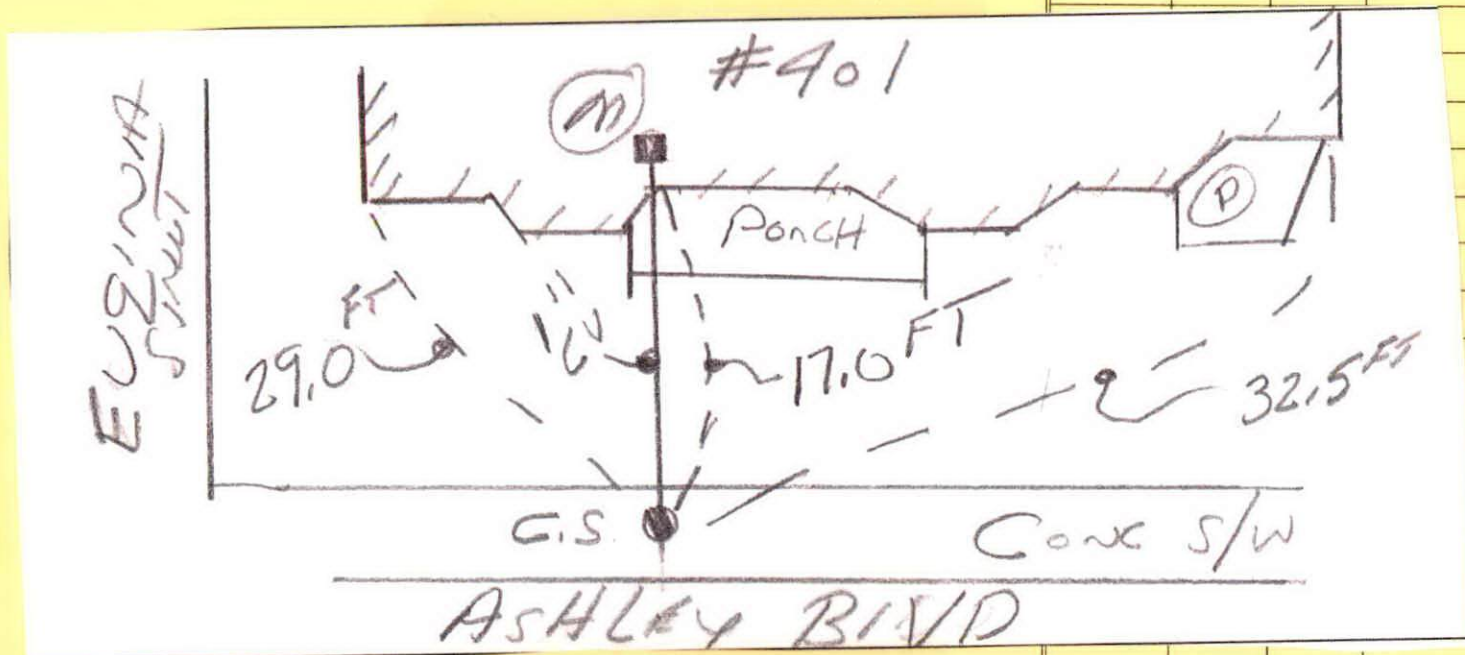



[illegible]