

APPLICATION No.: 15646

TAP CLEARED

LOCATION: 5 Hemlock St

DATE

BEF.

AFT.

REMARKS

OWNER:

31-313

MEASURES:

April 3, 1914

S X Fair St (west)

47.0 ft

E X W Line Hemlock St

9.0 ft

S X N Line House

11.0 ft

1" Copper Service

09/27/2018 Lead Service Line Replacement Program

Phase 1, Contractor P Gioioso & Son

Type CU, Diameter 1in, Water pressure 100

Distance from main to curb stop (ft) 42

Distance from curb stop to meter (ft) 23

Distance from curb face to curb stop (ft) 3

Depth of service (ft) 5

Total length of new pipe installed (ft) 65

Curb stop replaced: yes size 1"

Corporation replaced: yes size 1"

Ball valve furnished: yes size 1"

5 Hemlock St

Date:10/28/2016

Contractor: Riley Brothers

Service Broken, repaired by DPI

LCXXS - 5/ 5/8" to 3/4" Lead to Copper 8 x 3/4" coupling XXS Units 1 UOM Each


CSValve - 3/4" Curb Stop Valve 3/4 Units 1 UOM Each

Cop 3/4 Box of 3/4" Copper Tubing Units 6 UOM Feet

METER HISTORY

CHARGE OUTS

DATE	SET OUT	SIZE	MAKE	NUMBER	READING	TEST			REMARKS

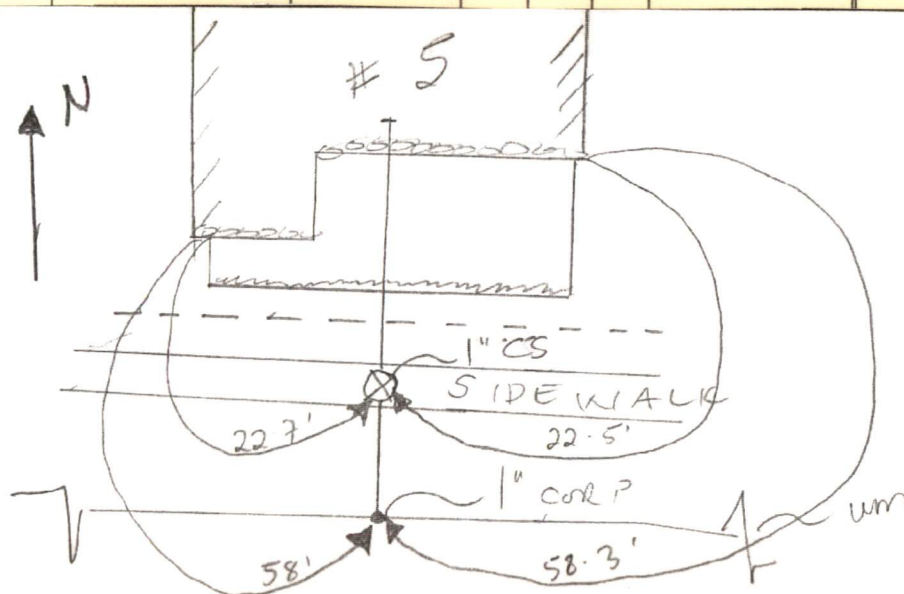

33896

5 Hemlock st

FIRE SUPPLY

31-313

MEASURES:

s x s line of ~~house~~ fair 33'

e x w line of ~~house~~ hemlock 7'

n x n line of house 5'

e x e line of house 18'

main to inside prop 40'

pipe to inside prop 16'

6-10-16 JLC installed new fire supply. Inspected: P Reynolds

TAP CLEARED

DATE _____

BEF.

AFT.

REMARKS

[illegible]

CHARGE OUTS