

APPLICATION No.: 16245

TAP CLEARED

LOCATION: 227 Eugenia St

DATE _____

BEF.

AFT.

REMARKS

OWNER:

31-313

MEASURES: W X Ashley Blvd	125.1 ft
S X N line Eugenia St	8.4 ft
E X W line House	11.6 ft

1" Copper Service

04/11/2018 Lead Service Line Replacement Program

Phase 1, Contractor P Gioioso & Son

Type CU, Diameter 1in, Water pressure 60

Distance from main to curb stop (ft) N/A

Distance from curb stop to meter (ft) 19.2

Distance from curb face to curb stop (ft) 1.2

Depth of service (ft) 3.5

Total length of new pipe installed (ft) 22.2

Curb stop replaced: no


Corporation replaced: no

Ball valve furnished: yes size 1"

Remarks: 18.2 ft curb stop to house, 1.0 wall
to meter, 3.0 whip

[illegible]

CHARGE OUTS

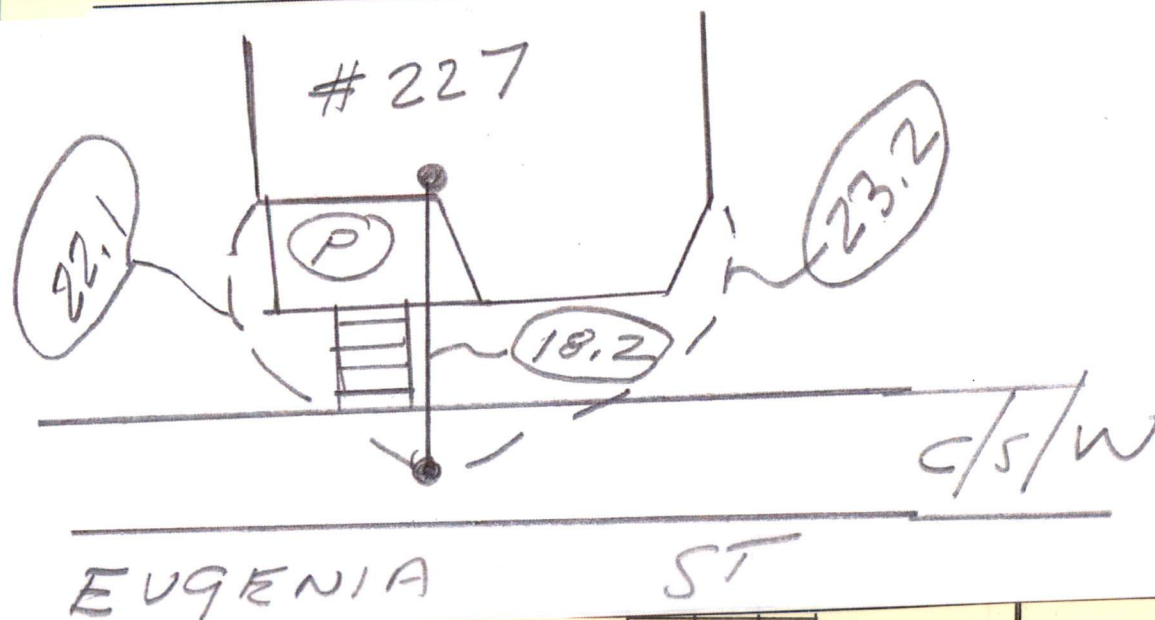

APPLICATION No.: 16245

TAP CLEARED

LOCATION: 227 Eugenia

OWNER: Helen Olyarczyk

MEASURES:

5/8"

W from	Ashley Blvd.	125.1
S from Nline	Eugenia	8.4
E from W line	House	11.6

Nov. 23, 1976 Renewed from $\frac{1}{2}$ ft. outside curb stop to a point 5 ft. inside curb stop.

5½ ft. - 3/4" Copper tubing 3/4" Curb Stop
Caldwell Stop Box 2 - 5/8" x 3/4" lead to cop.
conn.

12/27/13 City crew renewed water service from main
to property line.

Stock: 25ft - 3/4" copper tubing; 1 - 3/4" curb stop;
1 - Caldwell stop box; 1 - 5/8"x3/4" XXS lead to cop
adapt; 1 - 5/8"x3/4" Fig 413; Tap reamed R.Cormier

R. Cormier

METER HISTORY

[illegible]

CHARGE OUTS