

APPLICATION No.: 16324

LOCATION: 172 Hathaway St

OWNER:

31-313

MEASURES: 06/21/2018

Lead service line replacement program

Phase 1, Contractor P Gioioso & Son

1" Copper Service

Type CU, Diameter 1in, Water pressure 70

Distance from main to curb stop (ft) N/A

Distance from curb stop to meter (ft) 14.5

13.5 ft to house + 1 ft wall

Distance from curb face to curb stop (ft) 2.5

Depth of service (ft) 3.8

Total length of new pipe installed (ft) 17.5

14.5 + 3 ft whip

Curb stop replaced: no

Corporation replaced: no

Ball valve furnished: yes size 1"

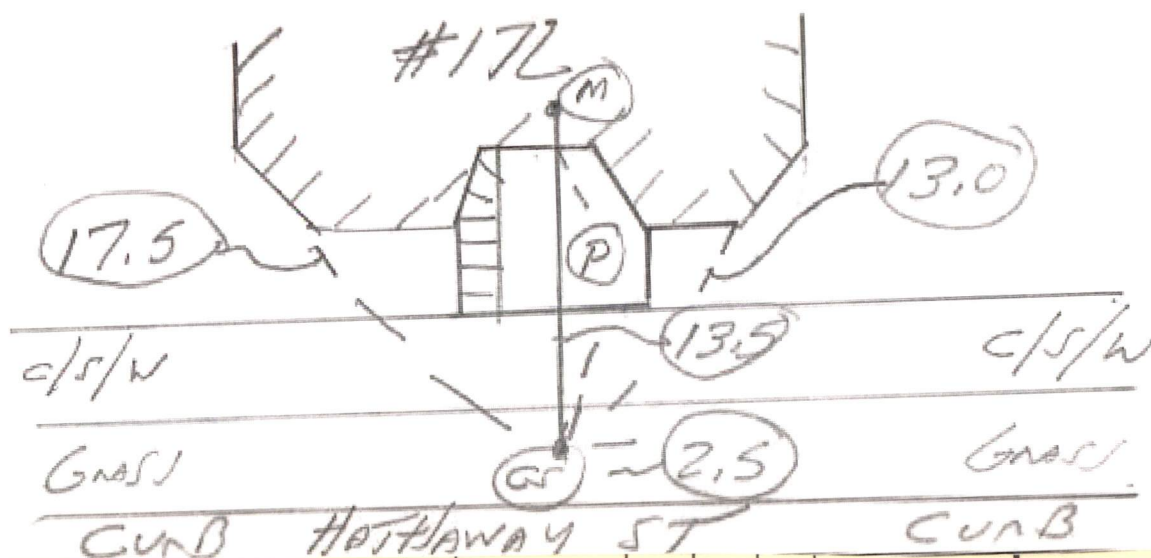
TAP CLEARED

DATE _____

BEF.

AFT.

REMARKS

[illegible]

APPLICATION No.: 16324

TAP CLEARED

LOCATION: 172 Hathaway

OWNER: Alpha Picard

MEASURES: E from Brook St. 63.5 ft.
N from S line Hathawayst 8.3 ft.
E from W line house 12.0 ft.

Jan. 26, 1962 Renewed from $\frac{1}{2}$ ft. outside curb stop to 3 ft. inside curb stop.
 $3\frac{1}{2}$ of $3/4$ " copper tubing
 $3/4$ " cop. to cop. stop, fig. 415 - R.H.
 2- lbs. wiping solder

12/20/78: Renewed from 8" outside curbstop to 4 ft. inside. 4.8 ft.-3/4" copper; 3/4" curb stop; 2-5/8" x 3/4" lead-cop. adapt. XXS; Caldwell stop box;

11/4/04 Renewed from main to property line. Stoxck: 18 ft. 3/4" copper tubing; 3/4" curb stop; Caldwell stop box; 5/8" x 3/4" lead-cop adapt. XXS; 5/8" x 3/4" Fig. 413 Tap reamed

DATE _____

BEF.

AFT.

REMARKS

11.2.04

11:45

2004.440-8347

11/4/04

Tap

Reamed

[illegible]

CHARGE OUTS

[illegible]