

APPLICATION No.: 16502

TAP CLEARED

LOCATION: 216 - 218 Eugenia St

DATE \_\_\_\_\_

BEF.

AFT.

REMARKS

OWNER:

31-313

**MEASURES:**

1" Copper Service

04/13/2018 Lead Service Line REplacement

Program, Phase 1, Contractor P Gioioso & Son

Type CU, Diameter 1in, Water pressure 58

Distance from main to curb stop (ft) 9.0

Distance from curb stop to meter (ft) N/A

Distance from curb face to curb stop (ft)

Depth of service (ft) 4.0

Total length of new pipe

Curb stop replaced: yes size 1"

Corporation replaced: yes size


Ball valve furnished: no

Remarks: 9.0 main to curl

— 30 —

[illegible]

### CHARGE OUTS

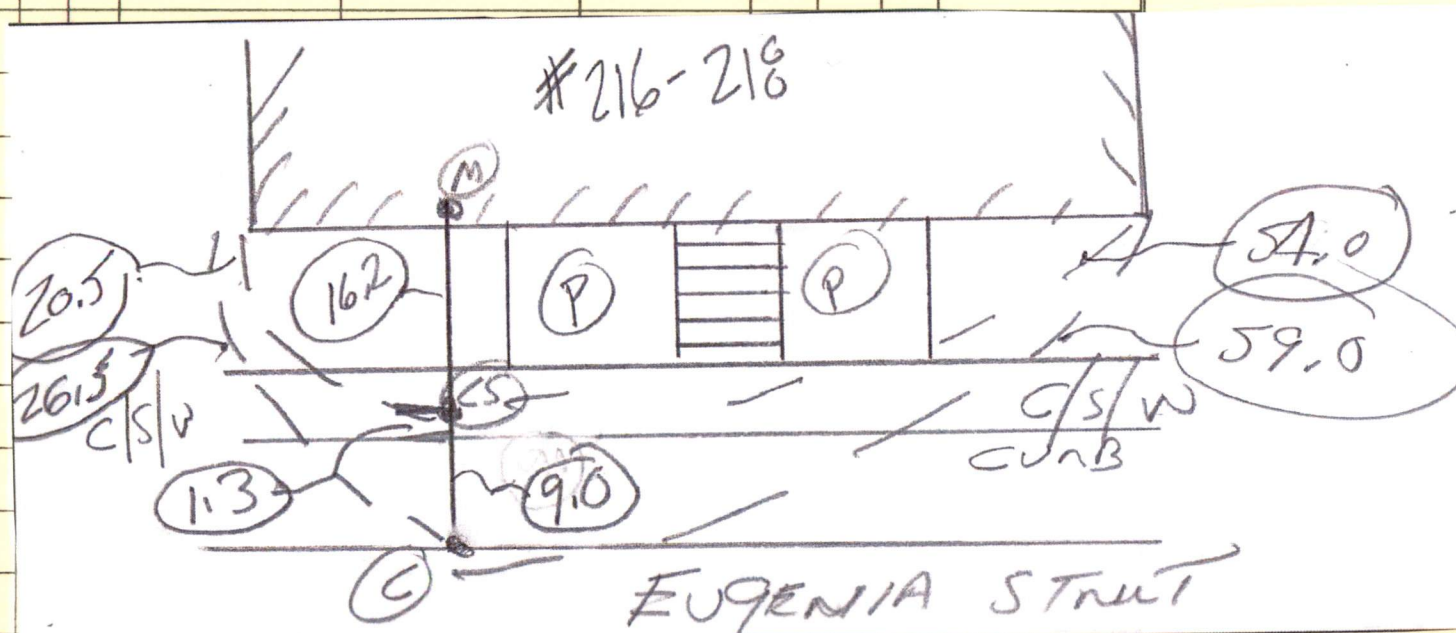



APPLICATION No. 16502

216-18 Eugenia, S.E. Cor. Ashley Blvd.

TAP CLEARED 8629-3264

LOCATION:

OWNER:

Amos Taylor

MEASURES:

5/8"

E from	Ashley Blvd.	57.0
N from Sline	Eugenia	9.2
W from E line	House	10.2

Sept. 29, 1966 Renewed from property line to inside of bildg.  
12 ft. - 3/4" copper tubing

7/21/86: Renewed from 1/2' outside curb stop to prop line.  
(2 ft. ins. prop line) Stock: 11 ft. 3/4" copper tubing  
1 - 3/4" curb stop 1 - Caldwell stop box 1 - 3/4x5/8 lead to  
cop adapt. xs. 1 - 3/4 x 3/4 cop to cop cplg. comp.  
=====

DATE

BEF.

AFT.

REMARKS

## METER HISTORY

[illegible]

## CHARGE OUTS



APPLICATION No.: 16502 5/8" L lead

TAP CLEARED

LOCATION: 212-4 Eugenia S.E. Cor. Bowditch

DATE

BEF.

AFT.

REMARKS

OWNER: Chas E. Taylor

MEASURES: 5/8"

L lead

Jan. 7, 1916

E from

Bowditch

57.0 ft.

N from S line

Eugenia

9.2 ft.

W from E line

House

10.2 ft.

[illegible]

## CHARGE OUTS

[illegible]